


1 FOURTH FLOOR HVAC PLAN
1/8"=1'-0"



MECHANICAL NOTES:

- SEE ARCHITECTURAL DRAWINGS FOR DOOR SCHEDULE AND UNDERCUT DOOR INFORMATION.
- SEE ARCHITECTURAL DRAWINGS FOR REFLECTED CEILING PLAN AND EXACT LOCATION OF ALL CEILING MOUNTED DIFFUSERS, REGISTERS AND GRILLES.
- SEE DRAWINGS M301 AND M302 FOR CLASSROOM VENTILATION UNITS (CVU) PIPING CONNECTION DETAILS.
- SEE DRAWING M404 FOR OPEN MECHANICAL AREA DETAIL AND OUTSIDE AIR DUCTWORK LAYOUT.
- LOCATE TRANSFER AIR GRILLES $TG-24 \times 8$ AT 1'-0" ABOVE FINISHED FLOOR. SEE TG DETAIL ON DRAWING M406.
- ALL WALL OPENINGS SHALL BE PROVIDED WITH $TG-24 \times 16$ TRANSFER AIR GRILLES AND ARE LOCATED ABOVE THE CEILING. SEE TG DETAIL ON DRAWING M406.
- PROVIDE $TG-24 \times 8$ TRANSFER AIR GRILLES FOR TOILET ROOMS WHERE SHOWN. LOCATE TRANSFER AIR GRILLES AT 9'-0" ABOVE FINISHED FLOOR. SEE TG DETAIL ON DRAWING M406.

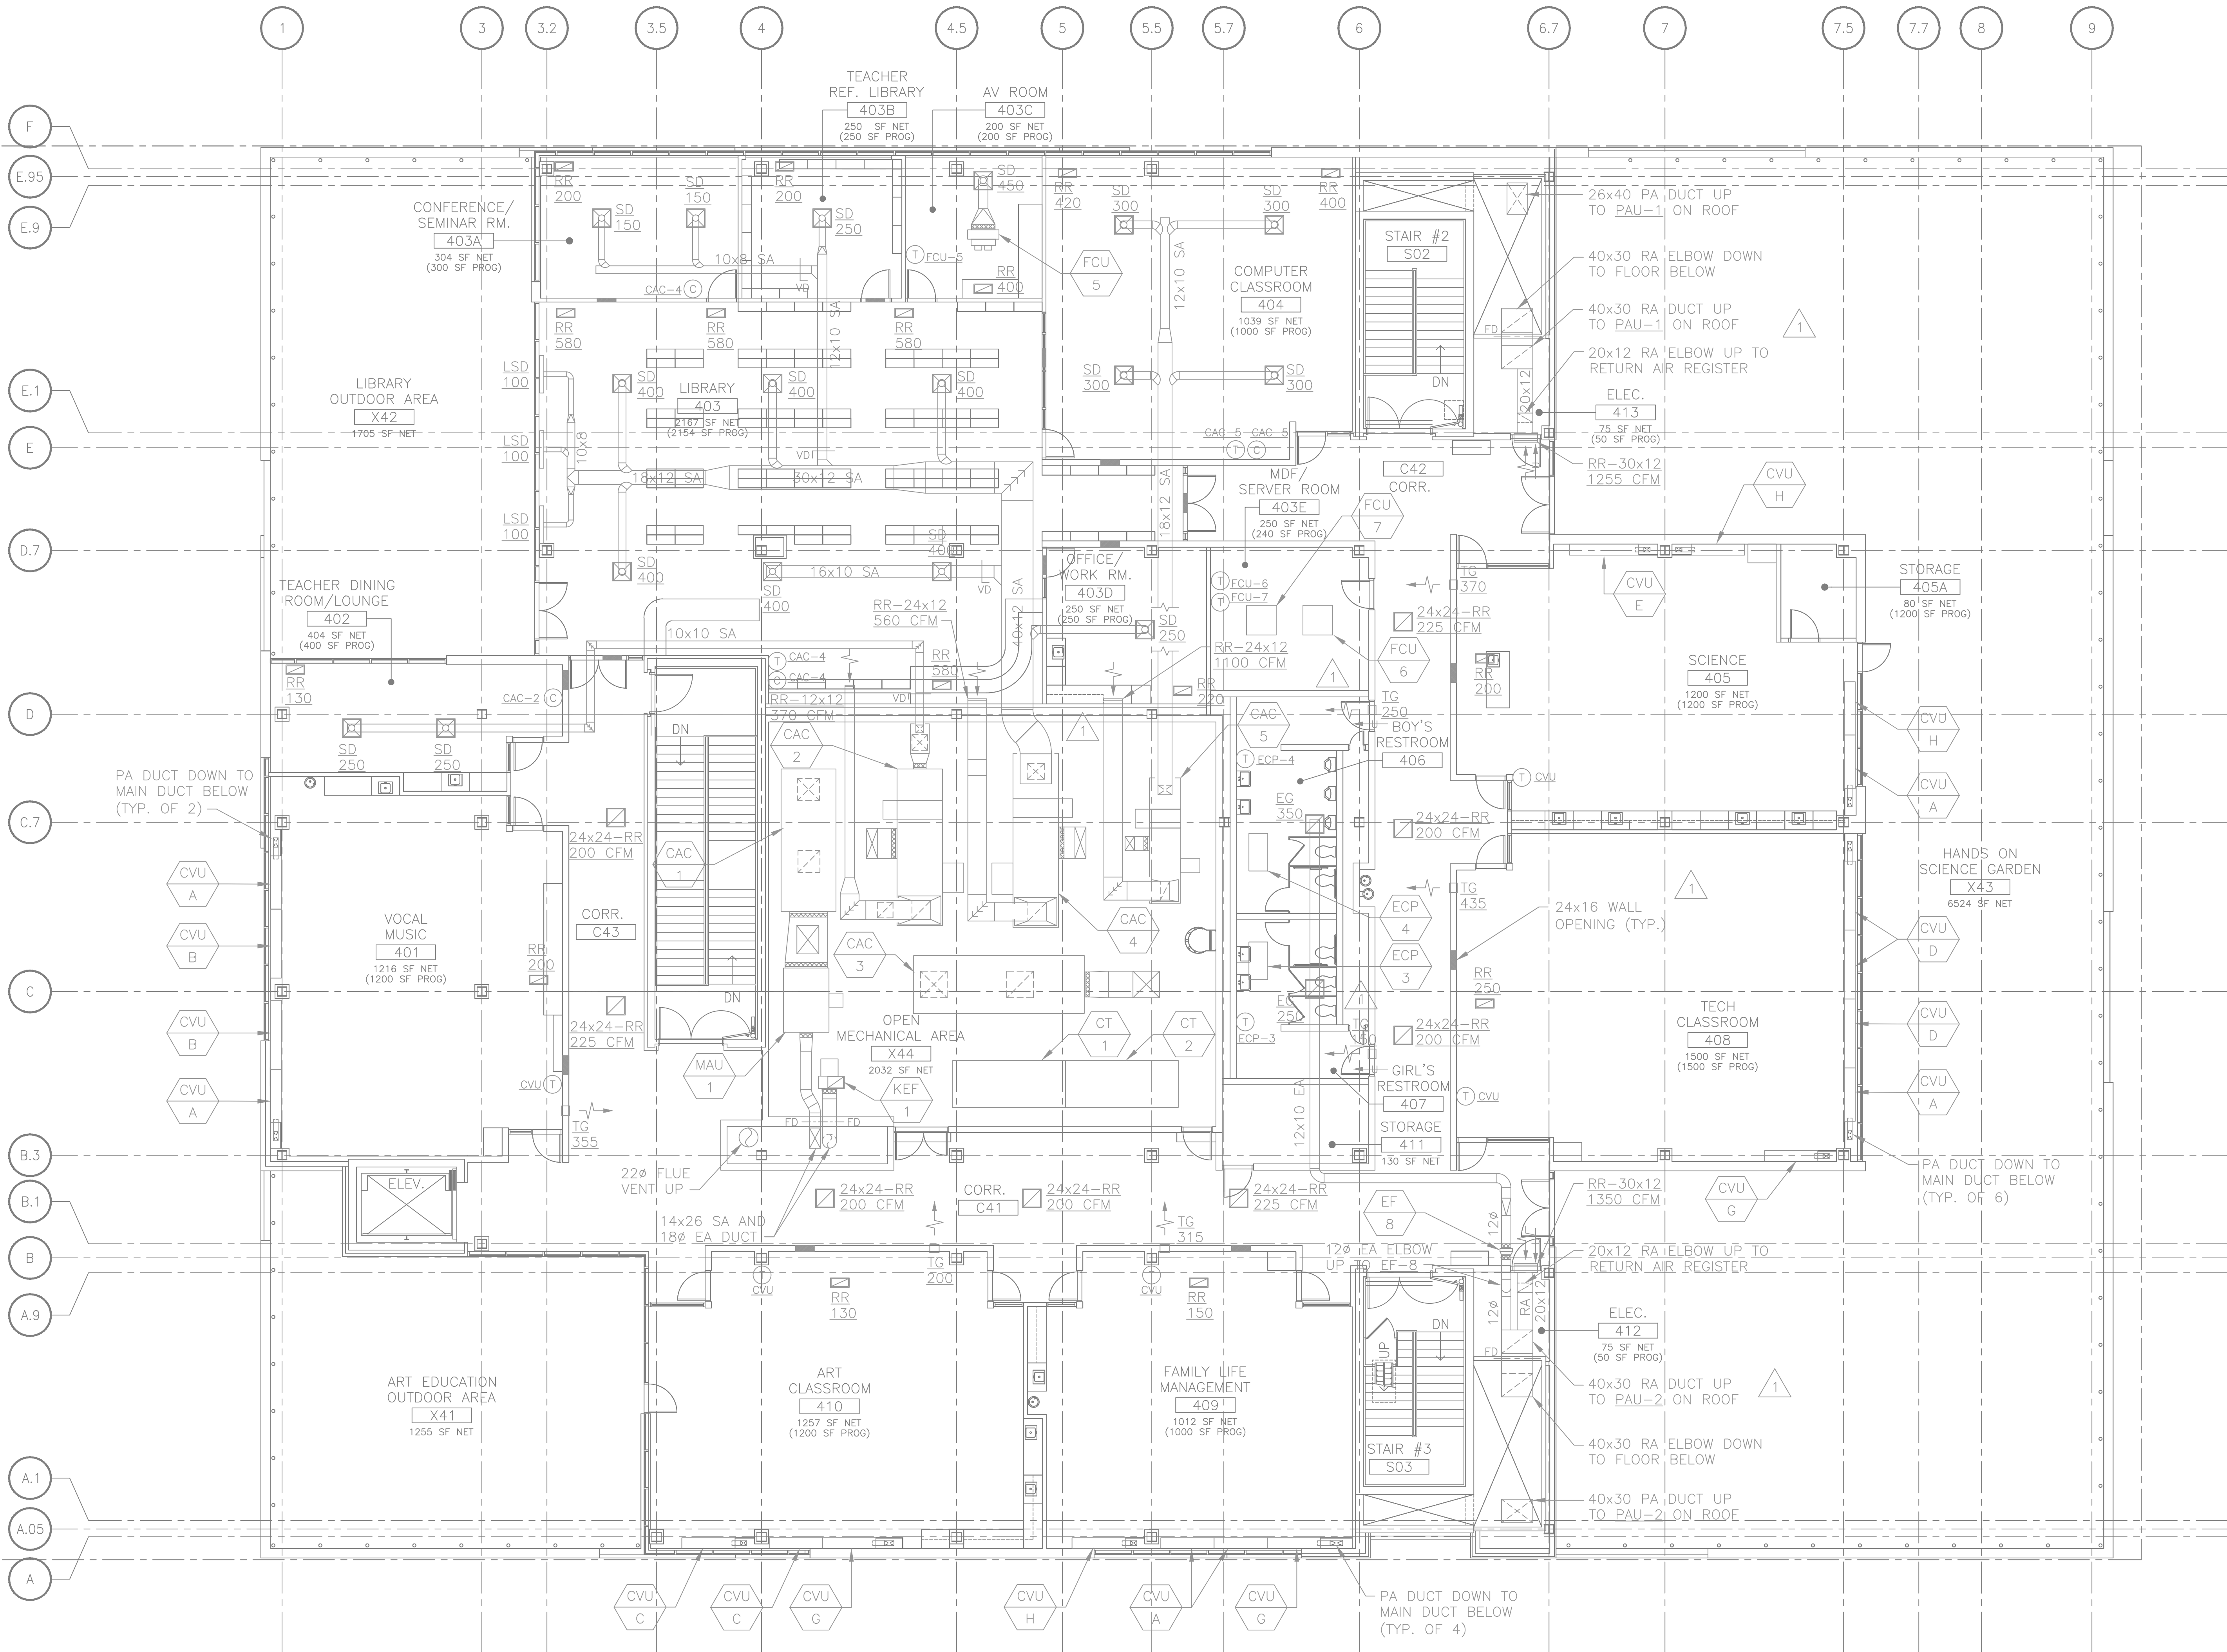