



September 19, 2022

School District of Philadelphia
Office of Environmental Management & Services
440 North Broad Street
3rd Floor – Portal C
Philadelphia, PA 19130

Attention: Mr. Stephen Link

Reference: EPA RRP Oversight and Lead Dust Surface Wipe Sampling
Fell Elementary School,
900 West Oregon Avenue, Philadelphia, PA 19148
Criterion's Project Number: **212787**

Dear Mr. Link,

Criterion Laboratories, Inc. (Criterion), was requested by the School District of Philadelphia's Office of Environmental Management Services (OEMS) to perform clearance testing following a paint stabilization project being performed by the School District Painters within various rooms at Fell Elementary School located at 900 West Oregon Avenue in Philadelphia, PA (the "School"). The stabilization was performed by School District Painters.

Criterion's EPA RRP and Dust Clearance Wipe certified inspectors, Mr. Jonathon McKinnon, Ms. Lauren Pickett, Mr. CJ Karoly, Mr. Mike Barth, and Mr. JaTear Gardener, performed oversight of the project. The inspectors performed visual inspections of all work areas. Once a work area had passed the visual inspection, the cleaning verification visual RRP wipe test was conducted. In child occupied areas, the inspectors also collected floor and windowsill samples and submitted them to Criterion's in-house laboratory for analysis by Flame Atomic Absorption Spectrophotometry (FAAS).


Analysis by FAAS of the post-cleaning wipe samples revealed concentrations of lead dust to be non-detected and below the United States Department of Environmental Protection Agency's (EPA) maximum allowable lead dust levels are <10 µg/ft² for floors or <100 µg/ft² for windowsills.

Philadelphia School District
Mr. Stephen Link
September 19, 2022
Page 2

As the damaged paint found during the initial lead assessment completed by Criterion in September 2020 was repaired, a lead safe certificate can be issued for this school. Please find attached a copy of the lead safe certificate.

If you should have any questions, please do not hesitate to contact me at 215-244-1300, extension 1033.

Sincerely,

A handwritten signature in black ink, appearing to read "Ian Forster", with a horizontal line extending to the right.

Ian Forster
Project Manager

Attachments



**Philadelphia Department of Public Health
Certification of School Lead Safe Status**

By signing this certificate, I confirm that I have done a visual inspection of the areas where children have access, including contact surfaces where children store their equipment or materials, and confirm these areas do not have deteriorated lead-based paint. A certified risk assessor or lead dust sampling technician completed verification wipe tests in accordance with the EPA's RRP guidelines and confirms they meet the EPA's cleanliness standard. A certified risk assessor or lead dust sampling technician collected interior dust wipe samples in compliance with EPA regulations in work areas and confirms they did not contain lead contaminated dust in excess of EPA dust lead standards in Pre-K, Kindergarten, and 1st Grade classrooms as well as the restrooms, offices, cafeterias, gymnasiums, and auditoriums these children routinely occupy. This certificate is valid for 4 years from date of verification.

Fell Elementary School

School Name

900 West Oregon Avenue, Philadelphia, PA 19148

Street Address

Criterion Laboratories – Jonathon McKinnon

Certifying Company (print)

Lead Dust Sampling Technician - D-I-19014-19-748615

Risk Assessor, Lead Inspector PA Lic. #, EPA Firm Certification or Lead Dust Sampling Technician Certification #

Jonathon McKinnon

Inspector/Risk Assessor or Dust Wipe Sampling Technician Name (Signature)

May 17, 2022

Date of Verification

Stephen Link, 215.400.5768, slink@philasd.org

School Official Name, Telephone and E-mail Address

Please note: A visual inspection of the areas listed above has been completed by a certified risk assessor and no damage to Lead Based Painted surfaces was observed. This school will be reassessed within 4 years of this certification.

CRITERION LABORATORIES, INC.

400 STREET ROAD, BENSLEM, PA 19020
PHONE: (215) 244-1300, FAX: (215) 244-4349
WWW.CRITERIONLABS.COM

Certificate of Attendance and Successful Completion

Dust Sampling Technician – English
Per 40 CFR Part 745.225


Christopher Karoly

3232 Skippack Pike, Lansdale, PA 19446

Certificate Number: D-I-19014-18-747435



Course Date: 11/20/2018
Examination Date: 11/20/2018
Expiration Date: 11/20/2023



JAMES A. WELTZ, CIH
Training Manager / Principal Instructor

Number
754110

Expiration Date
05/10/2025

Certificate of Training

CRITERION LABORATORIES, INC.

HEREBY CERTIFIES THAT

Christopher Karoly

3116 Livingston Street, Philadelphia, PA 19134

HAS SUCCESSFULLY COMPLETED AN 8 HOUR COURSE ENTITLED

Lead Risk Assessor Refresher

INCLUDING CLASSROOM INSTRUCTION


APPROVED FOR EPA/PA ACCREDITATION, 40 CFR 745 and TSCA SECTION 402/404

ON THIS 10th DAY OF MAY 2022

400 Street Road
Bensalem, PA 19020
(215) 244-1300 - Phone
(215) 244-4349 - Fax
www.criterionlabs.com

Course is conducted in English

DIRECTOR: _____



JAMES A. WELTZ, CIH

CRITERION LABORATORIES, INC.

400 STREET ROAD, BENSLEM, PA 19020
PHONE: (215) 244-1300, FAX: (215) 244-4349
WWW.CRITERIONLABS.COM

Certificate of Attendance and Successful Completion

Dust Sampling Technician – English
Per 40 CFR Part 745.225


Ja'tear Gardner

519 Nel Drive, Fairless Hills, PA 19030

Certificate Number: D-I-19014-22-754119



Course Date: 5/11/2022
Examination Date: 5/11/2022
Expiration Date: 5/11/2027

A handwritten signature in black ink, appearing to read 'J. Weltz', written in a cursive style.

JAMES A. WELTZ, CIH
Training Manager / Principal Instructor

CRITERION LABORATORIES, INC.

400 STREET ROAD, BENSLEM, PA 19020
PHONE: (215) 244-1300, FAX: (215) 244-4349
WWW.CRITERIONLABS.COM

Certificate of Attendance and Successful Completion

Lead RRP Initial – English
Per 40 CFR Part 745.225

Ja'tear Gardner

519 Nel Drive, Fairless Hills, PA 19030

Certificate Number: R-I-19014-22-754218



Course Date: 6/8/2022
Examination Date: 6/8/2022
Expiration Date: 6/8/2027

A handwritten signature in black ink, appearing to read "J. Weltz". The signature is fluid and cursive.

JAMES A. WELTZ, CIH
Training Manager / Principal Instructor

CRITERION LABORATORIES, INC.

400 STREET ROAD, BENSLEM, PA 19020
PHONE: (215) 244-1300, FAX: (215) 244-4349
WWW.CRITERIONLABS.COM

Certificate of Attendance and Successful Completion

Dust Sampling Technician – English
Per 40 CFR Part 745.225


Jonathan McKinnon

49 Winfield Road, Erial, NJ 08081

Certificate Number: D-I-19014-19-748615



Course Date: 4/3/2019
Examination Date: 4/3/2019
Expiration Date: 4/3/2024



JAMES A. WELTZ, CIH
Training Manager / Principal Instructor

CRITERION LABORATORIES, INC.

400 STREET ROAD, BENSLEM, PA 19020
PHONE: (215) 244-1300, FAX: (215) 244-4349
WWW.CRITERIONLABS.COM

Certificate of Attendance and Successful Completion

Lead RRP Initial – English
Per 40 CFR Part 745.225


Jonathan McKinnon

49 Winfield Road, Erial, NJ 08081

Certificate Number: R-I-19014-19-748640



Course Date: 4/5/2019
Examination Date: 4/5/2019
Expiration Date: 4/5/2024



JAMES A. WELTZ, CIH
Training Manager / Principal Instructor

CRITERION LABORATORIES, INC.

400 STREET ROAD, BENSLEM, PA 19020
PHONE: (215) 244-1300, FAX: (215) 244-4349
WWW.CRITERIONLABS.COM

Certificate of Attendance and Successful Completion

Dust Sampling Technician – English
Per 40 CFR Part 745.225


Lauren Pickett

15 Ferry Road, Doylestown, PA 18901

Certificate Number: D-I-19014-19-747813



Course Date: 1/24/2019
Examination Date: 1/24/2019
Expiration Date: 1/24/2024



JAMES A. WELTZ, CIH
Training Manager / Principal Instructor

CRITERION LABORATORIES, INC.

400 STREET ROAD, BENSLEM, PA 19020
PHONE: (215) 244-1300, FAX: (215) 244-4349
WWW.CRITERIONLABS.COM

Certificate of Attendance and Successful Completion

Lead RRP Initial – English
Per 40 CFR Part 745.225


Lauren Pickett

15 Ferry Road, Doylestown, PA 18901

Certificate Number: R-I-19014-18-747456



Course Date: 12/3/2018
Examination Date: 12/3/2018
Expiration Date: 12/3/2023



JAMES A. WELTZ, CIH
Training Manager / Principal Instructor

CRITERION LABORATORIES, INC.

400 STREET ROAD, BENSLEM, PA 19020
PHONE: (215) 244-1300, FAX: (215) 244-4349
WWW.CRITERIONLABS.COM


Certificate of Attendance and Successful Completion

Lead RRP Initial – English
Per 40 CFR Part 745.225


Michael Barth

1101 Glenwood Court, Woodbury Heights, NJ 08097

Certificate Number: R-I-19014-18-747455

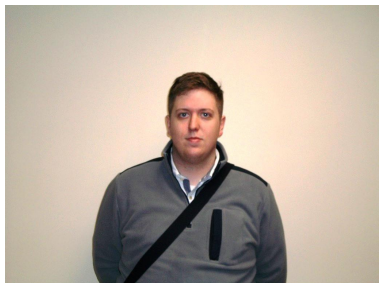

Course Date: 12/3/2018
Examination Date: 12/3/2018
Expiration Date: 12/3/2023



JAMES A. WELTZ, CIH
Training Manager / Principal Instructor

CRITERION LABORATORIES, INC.

400 STREET ROAD, BENSALEM, PA 19020
PHONE: (215) 244-1300, FAX: (215) 244-4349
WWW.CRITERIONLABS.COM


Certificate of Attendance and Successful Completion

Dust Sampling Technician – English
Per 40 CFR Part 745.225


Michael Barth

1101 Glenwood Court, Woodbury Heights, NJ 08097

Certificate Number: D-I-19014-19-747814

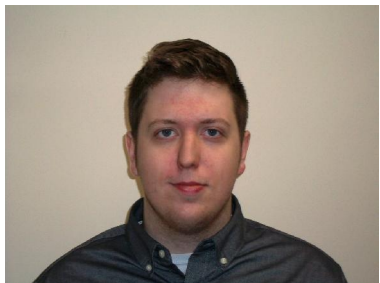

Course Date: 1/24/2019
Examination Date: 1/24/2019
Expiration Date: 1/24/2024

A handwritten signature in black ink, appearing to read 'J. Weltz'.

JAMES A. WELTZ, CIH
Training Manager / Principal Instructor

United States Environmental Protection Agency

This is to certify that



School District of Philadelphia Office of
Environmental Management Services

has fulfilled the requirements of the Toxic Substances Control Act (TSCA) Section 402, and has received certification to conduct lead-based paint renovation, repair, and painting activities pursuant to 40 CFR Part 745.89

In the Jurisdiction of:

All EPA Administered States, Tribes, and Territories

This certification is valid from the date of issuance and expires January 25, 2027

NAT-50914-3

Certification #

January 11, 2022

Issued On



Michelle Price, Chief

Lead, Heavy Metals, and Inorganics Branch

CRITERION LABORATORIES, INC.

400 STREET ROAD, BENSALEM, PA 19020
PHONE: (215) 244-1300, FAX: (215) 244-4349
WWW.CRITERIONLABS.COM

Certificate of Attendance and Successful Completion

**Lead RRP Initial – English
Per 40 CFR Part 745.225**

Season Hall

1916 Monument Street, Philadelphia, PA 19121

Certificate Number: R-I-19014-20-750791



**Course Date: 3/11/2020
Examination Date: 3/11/2020
Expiration Date: 3/11/2025**



JAMES A. WELTZ, CIH
Training Manager / Principal Instructor

Task ID	Element	Flavor	On Site Room Name	Student/Teacher Occupied	Component	Description of Paint and Plaster Damage	XRF (positive/ negative)	Name of Firm	Date of Renovation	Brief Description of Renovation	Name of Assigned Renovator	Name(s) of Trained Worker(s), if used	Name of Dust Sampling Technician, Inspector, or Risk Assessor, if used	Copies of renovator and dust sampling technician qualifications (training certificates, certifications) on file	Certified renovator provided training to workers on posting warning signs	Certified renovator provided training to workers on setting up plastic containment barriers	Certified renovator provided training to workers on maintaining containment	Certified renovator provided training to workers on avoiding spread of dust to adjacent areas	Certified renovator provided training to workers on waste handling	Certified renovator provided training to workers on post-renovation cleaning	Certified renovator provided training to workers on test kit or test results from an EPA-recognized laboratory on collected paint chip sample, used by certified renovator to determine whether lead was present on components affected by renovation	If yes to the previous, identify the method used, type of test kit used (if applicable), laboratory used to conduct paint chip analysis, describe sampling location and results
	1	1	Classroom 109	Yes	W1	Chipping	Positive	Criterion Laboratories, Inc.	2/28/22-3/3/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	1	Classroom 109	Yes	W2	Partially Inaccessible/Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Classroom 109	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Classroom 109	Yes	W4	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Classroom 109 Coat Closet	Yes	W2	Flaking	Positive	Criterion Laboratories, Inc.	2/28/22-3/3/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	1	Classroom 109 Coat Closet	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Classroom 109 Coat Closet	Yes	W3	Cracking/Flaking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Classroom 109 Coat Closet	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Music Room	Yes	W2	None	Positive	Criterion Laboratories, Inc.	3/31/22-4/6/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	2	Classroom 200	Yes	W1	Cracking/Flaking	Positive	Criterion Laboratories, Inc.	1/21/2022-2/1/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	2	Classroom 200	Yes	W2	Cracking/Flaking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 200	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 200	Yes	W3	Flaking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	RM2 Storage Closet A	Yes	W1	None	Positive	Criterion Laboratories, Inc.	3/31/22-4/6/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	B	RM2 Storage Closet A	Yes	W2	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	RM2 Storage Closet A	Yes	W3	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	RM2 Storage Closet A	Yes	W4	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	RM2 Storage Closet A	Yes	Ceiling	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 200	Yes	W4	Cracking/flaking	Positive	Criterion Laboratories, Inc.	1/21/2022-2/1/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	2	Classroom 200	Yes	W4	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 200	Yes	W4	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 200 Coat Closet	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 200 Coat Closet	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 200 Coat Closet	Yes	W2	Cracking/Partially Inaccessible	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 200 Coat Closet	Yes	W3	Flaking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 200 Coat Closet	Yes	W4	Cracking/Partially Inaccessible	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 201	Yes	W3	Chipping	Positive	Criterion Laboratories, Inc.	1/21/2022-2/1/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	2	Classroom 201	Yes	W1	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 201	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 201	Yes	W4	Flaking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 201 Coat Closet	Yes	W1	Cracking/Alligating	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 201 Coat Closet	Yes	W2	Flaking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 201 Coat Closet	Yes	W4	Cracking/Alligating	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 202	Yes	W1	Cracking	Positive	Criterion Laboratories, Inc.	1/18/22-1/24/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	2	Classroom 202	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 202	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 202	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 202	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 203	Yes	W3	Chipping	Positive	Criterion Laboratories, Inc.	1/25/22-2/3/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	2	Classroom 203	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 203	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 203	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Classroom 100	Yes	W1	None	Positive	Criterion Laboratories, Inc.	3/14/22-3/22/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Mike Barth	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	1	Classroom 100	Yes	W2	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 203	Yes	W4	Cracking	Positive	Criterion Laboratories, Inc.	1/21/2022-	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	2	Classroom 203	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Classroom 100	Yes	W4	None	Positive	Criterion Laboratories, Inc.	3/14/22-3/22/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Mike Barth	☑	☑	☑	☑	☑	☑	☑	XRF	XRF

Task ID	Element	Flavor	On Site Room Name	Student/Teacher Occupied	Component	Description of Paint and Plaster Damage	XRF (positive/ negative)	Name of Firm	Date of Renovation	Brief Description of Renovation	Name of Assigned Renovator	Name(s) of Trained Worker(s), if used	Name of Dust Sampling Technician, Inspector, or Risk Assessor, if used	Copies of renovator and dust sampling technician qualifications (training certificates, certifications) on file	Certified renovator provided training to workers on posting warning signs	Certified renovator provided training to workers on setting up plastic containment barriers	Certified renovator provided training to workers on maintaining containment	Certified renovator provided training to workers on avoiding spread of dust to adjacent areas	Certified renovator provided training to workers on waste handling	Certified renovator provided training to workers on post-renovation cleaning	Certified renovator provided training to workers on test kit or test results from an EPA-recognized laboratory on collected paint chip sample, used by certified renovator to determine whether lead was present on components affected by renovation	If yes to the previous, identify the method used, type of test kit used (if applicable), laboratory used to conduct paint chip analysis, describe sampling location and results
	1	2	Classroom 204	Yes	W3	Chipping	Positive	Criterion Laboratories, Inc.	1/26/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	1	Women's Restroom	Yes	W2	None	Positive															
	1	2	Classroom 204	Yes	W3	Chipping	Positive	Criterion Laboratories, Inc.	1/26/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	2	Classroom 206 Closet B	Yes	W4	Cracking	Positive															
	1	2	Classroom 207	Yes	W1	Flaking	Positive	Criterion Laboratories, Inc.	2/4/22-2/14/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	2	Classroom 207	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 207	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 207	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 207	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 207 Coat Closet	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	East Hallway	Yes	W3	None	Positive	Criterion Laboratories, Inc.	2/9/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	1	East Hallway	Yes	W3	None	Positive	Criterion Laboratories, Inc.	2/9/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	2	Classroom 207 Coat Closet	Yes	W2	Cracking	Positive	Criterion Laboratories, Inc.	2/4/22-2/14/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	1	East Hallway	Yes	W4	None	Positive	Criterion Laboratories, Inc.	2/9/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	2	Classroom 207 Coat Closet	Yes	W3	Partially Inaccessible/Cracking	Positive	Criterion Laboratories, Inc.	2/4/22-2/14/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	1	Classroom 101	Yes	W1	None	Positive	Criterion Laboratories, Inc.	3/14/22-3/22/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Mike Barth	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	1	Classroom 101	Yes	W2	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Classroom 101	Yes	W3	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 207 Coat Closet	Yes	W4	Cracking/Chipping	Positive	Criterion Laboratories, Inc.	2/4/22-2/14/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	1	Classroom 101	Yes	W4	None	Positive	Criterion Laboratories, Inc.	3/14/22-3/22/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Mike Barth	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	2	Classroom 208	Yes	W3	Chipping	Positive															
	1	1	Counselor	Yes	W1	None	Positive															
	1	2	Classroom 208	Yes	W2	Chipping	Positive	Criterion Laboratories, Inc.	2/4/22-2/11/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	2	Classroom 208	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 208	Yes	W4	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 208 Coat Closet	Yes	W1	Flaking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Counselor	yes	W4	None	Positive															
	1	2	Classroom 208 Coat Closet	Yes	W2	Flaking	Positive	Criterion Laboratories, Inc.	2/4/22-2/11/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	1	Classroom 102	Yes	W1	None	Positive	Criterion Laboratories, Inc.	3/7/22-3/10/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	2	Classroom 208 Coat Closet	Yes	W3	Chipping	Positive	Criterion Laboratories, Inc.	2/4/22-2/11/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	2	Classroom 208 Coat Closet	Yes	W4	Flaking	Positive	Criterion Laboratories, Inc.	2/4/22-2/11/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	2	Classroom 209	Yes	W1	Cracking	Positive	Criterion Laboratories, Inc.	2/11/22-2/17/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	2	Classroom 209	Yes	W2	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Auditorium Stage Dressing Room - Classroom 100 Side	Yes	W3	None	Positive	Criterion Laboratories, Inc.	4/8/22-4/14/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF

Task ID	E l e m e n t	F l o o r	On Site Room Name	Student/ Teacher Occupied	Component	Description of Paint and Plaster Damage	XRF (positive/ negative)	Name of Firm	Date of Renovation	Brief Description of Renovation	Name of Assigned Renovator	Name(s) of Trained Worker (s), if used	Name of Dust Sampling Technician, Inspector, or Risk Assessor, if used	Copies of renovator and dust sampling technician qualifications (training certificates, certifications) on file	Certified renovator provided training to workers on posting warning signs	Certified renovator provided training to workers on setting up plastic containment barriers	Certified renovator provided training to workers on maintaining containment	Certified renovator provided training to workers on avoiding spread of dust to adjacent areas	Certified renovator provided training to workers on waste handling	Certified renovator provided training to workers on post- renovation cleaning	Certified renovator provided training to workers on test kit or test results from an EPA-recognized laboratory on collected paint chip sample, used by certified renovator to determine whether lead was present on components affected by renovation	If yes to the previous, identify the method used, type of test kit used (if applicable), laboratory used to conduct paint chip analysis, describe sampling location and results
	1	1	Classroom 102 Restroom	Yes	W1	None	Positive	Criterion Laboratories, Inc.	3/7/22- 3/11/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	1	Classroom 102 Restroom	Yes	W2	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Classroom 102 Restroom	Yes	W3	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Classroom 102 Restroom	Yes	W4	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 209	Yes	W3	Cracking/Chipping	Positive	Criterion Laboratories, Inc.	2/11/22- 2/17/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	2	Classroom 209	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 209	Yes	W2	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 209	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 209 Coat Closet	Yes	W3	Flaking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Auditorium Entrance Stairwell across from Classroom 104	Yes	W1	None	Positive	Criterion Laboratories, Inc.	1/13/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	1	Auditorium Entrance Stairwell across from Classroom 104	Yes	W2	None	Positive	Criterion Laboratories, Inc.	1/13/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	1	Auditorium Entrance Stairwell across from Classroom 104	Yes	W3	None	Positive	Criterion Laboratories, Inc.	1/13/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	1	Auditorium Entrance Stairwell across from Classroom 104	Yes	W4	None	Positive	Criterion Laboratories, Inc.	1/13/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	2	Classroom 209 Coat Closet	Yes	W4	Chipping	Positive	Criterion Laboratories, Inc.	2/11/22- 2/17/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	1	Auditorium Entrance Stairwell across from Classroom 105	Yes	W2	None	Positive	Criterion Laboratories, Inc.	1/13/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	1	Auditorium Entrance Stairwell across from Classroom 105	Yes	W3	None	Positive	Criterion Laboratories, Inc.	1/13/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	1	Auditorium Entrance Stairwell across from Classroom 105	Yes	W4	None	Positive	Criterion Laboratories, Inc.	1/13/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	3	Classroom 300	Yes	W3	Chipping	Positive	Criterion Laboratories, Inc.	12/15/21- 12/21/21	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	3	Classroom 300	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Classroom 300	Yes	W4	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Classroom 300	Yes	W2	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Classroom 300	Yes	W3	Moisture Damage/Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Classroom 103	Yes	W1	None	Positive	Criterion Laboratories, Inc.	3/7/22- 3/09/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	1	Classroom 103	Yes	W3	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Classroom 103	Yes	W4	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Classroom 104	Yes	W1	None	Positive	Criterion Laboratories, Inc.	3/7/22- 3/9/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	3	Classroom 300	Yes	W4	Chipping	Positive	Criterion Laboratories, Inc.	12/15/21- 12/21/21	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	3	Classroom 301	Yes	W1	Cracking	Positive	Criterion Laboratories, Inc.	12/15/21- 12/23/21	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	3	Classroom 301	Yes	W2	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Classroom 301	Yes	W3	Flaking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Classroom 302	Yes	W2	Chipping	Positive	Criterion Laboratories, Inc.	12/27/21- 12/29/21	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF

Task ID	E l e m e n t	F l o o r	On Site Room Name	Student/ Teacher Occupied	Component	Description of Paint and Plaster Damage	XRF (positive/ negative)	Name of Firm	Date of Renovation	Brief Description of Renovation	Name of Assigned Renovator	Name(s) of Trained Worker (s), if used	Name of Dust Sampling Technician, Inspector, or Risk Assessor, if used	Copies of renovator and dust sampling technician qualifications (training certificates, certifications) on file	Certified renovator provided training to workers on posting warning signs	Certified renovator provided training to workers on setting up plastic containment barriers	Certified renovator provided training to workers on maintaining containment	Certified renovator provided training to workers on avoiding spread of dust to adjacent areas	Certified renovator provided training to workers on waste handling	Certified renovator provided training to workers on post- renovation cleaning	Certified renovator provided training to workers on test kit or test results from an EPA-recognized laboratory on collected paint chip sample, used by certified renovator to determine whether lead was present on components affected by renovation	If yes to the previous, identify the method used, type of test kit used (if applicable), laboratory used to conduct paint chip analysis, describe sampling location and results
	1	1	Girl's Restroom	Yes	W2	None	Positive	Criterion Laboratories, Inc.	1/3/22- 1/18/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	B	East Hallway; South End	Yes	W3	Cracking	Positive															
	1	1	Main Office Storage Closet	Yes	W1	Partially Inaccessible	Positive	Criterion Laboratories, Inc.	3/24/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	B	East Hallway; South End	Yes	W4	Cracking	Positive	Criterion Laboratories, Inc.	12/13/21- 12/15/21	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	CJ Karoly	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	B	Facilities Storage (former classroom)	Yes	W1	Cracking	Positive	Criterion Laboratories, Inc.	3/18/22- 3/23/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	B	Facilities Storage (former classroom)	Yes	W2	Moisture Damage	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Facilities Storage (former classroom)	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Facilities Storage (former classroom)	Yes	W4	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Auditorium Stage Dressing Room - Classroom 100 Side	Yes	Ceiling	None	Positive															
	1	B	Facilities Storage (former classroom)	Yes	Ceiling	Moisture Damage	Positive	Criterion Laboratories, Inc.	3/18/22- 3/23/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	B	Fire Stair Tower	Yes	Ceiling	Moisture Damage	Positive															
	1	B	Fire Stair Tower	Yes	W2	Moisture Damage	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Fire Tower Stairwell	Yes	Ceiling	Moisture Damage	Positive	Criterion Laboratories, Inc.	3/7/22- 3/8/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	1	Girl's Restroom	yes	W2	Cracking	Positive	Criterion Laboratories, Inc.	1/3/22- 1/18/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	1	Girl's Restroom	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Teacher's Lounge 216	Yes	W3	None	Positive	Criterion Laboratories, Inc.	2/11/22- 2/17/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	1	Girl's Restroom	Yes	W2	Cracking/Moisture Damage	Positive	Criterion Laboratories, Inc.	1/3/22- 1/18/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	1	Girl's Restroom	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Girl's Restroom	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Girl's Restroom	Yes	Ceiling	Moisture Damage	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Girl's Restroom	yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Girl's Restroom	Yes	Ceiling	Moisture Damage	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Girl's Restroom	Yes	W3	Moisture Damage	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Gymnasium	Yes	Ceiling	Moisture Damage	Positive	Criterion Laboratories, Inc.	3/31/22- 3/31/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	B	Gymnasium	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Gymnasium	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Gymnasium	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Gymnasium	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Gymnasium	Yes	Ceiling	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Gymnasium Office	Yes	Ceiling	Moisture Damage	Positive	Criterion Laboratories, Inc.	3/10/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	B	Gymnasium Office	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Gymnasium Office	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Gymnasium Office	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Gymnasium Office	Yes	W4	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Gymnasium Office	Yes	Ceiling	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Gymnasium Office	Yes	Ceiling	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Hallway outside Classrooms 300 - 302	Yes	Floor	Friction	Positive	Criterion Laboratories, Inc.	12/13/21- 12/15/21	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	CJ Karoly	☑	☑	☑	☑	☑	☑	☑	XRF	XRF

Task ID	Element	Floor	On Site Room Name	Student/Teacher Occupied	Component	Description of Paint and Plaster Damage	XRF (positive/ negative)	Name of Firm	Date of Renovation	Brief Description of Renovation	Name of Assigned Renovator	Name(s) of Trained Worker(s), if used	Name of Dust Sampling Technician, Inspector, or Risk Assessor, if used	Copies of renovator and dust sampling technician qualifications (training certificates, certifications) on file	Certified renovator provided training to workers on posting warning signs	Certified renovator provided training to workers on setting up plastic containment barriers	Certified renovator provided training to workers on maintaining containment	Certified renovator provided training to workers on avoiding spread of dust to adjacent areas	Certified renovator provided training to workers on waste handling	Certified renovator provided training to workers on post-renovation cleaning	Certified renovator provided training to workers on test kit or test results from an EPA-recognized laboratory on collected paint chip sample, used by certified renovator to determine whether lead was present on components affected by renovation	If yes to the previous, identify the method used, type of test kit used (if applicable), laboratory used to conduct paint chip analysis, describe sampling location and results				
	1	3	Hallway outside Classrooms 300 - 302	Yes	W2	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above				
	1	3	Hallway outside Classrooms 300 - 302	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above				
	1	3	Hallway outside Classrooms 300 - 302	Yes	W4	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above				
	1	3	Hallway outside Classrooms 307 - 309	Yes	Floor	Friction	Positive	Criterion Laboratories, Inc.	12/13/21-12/15/21	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	CJ Karoly	see above	see above	see above	see above	see above	see above	see above	see above	XRF	XRF			
	1	3	Hallway outside Classrooms 307 - 309	Yes	W2	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above			
	1	3	Hallway outside Classrooms 307 - 309	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above			
	1	3	Hallway outside Classrooms 307 - 309	Yes	W4	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above			
	1	B	Hallway outside of Cafeteria B	Yes	Ceiling	Flaking	Positive	Criterion Laboratories, Inc.	12/13/21-12/15/21	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	CJ Karoly	see above	see above	see above	see above	see above	see above	see above	see above	see above	XRF	XRF		
	1	1	West Hallway	Yes	W3	None	Positive																			
	1	B	Hallway outside of Cafeteria B	Yes	W1	Cracking	Positive	Criterion Laboratories, Inc.	12/13/21-12/15/21	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	CJ Karoly	see above	see above	see above	see above	see above	see above	see above	see above	see above	XRF	XRF		
	1	B	Hallway outside of Cafeteria B	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above		
	1	B	Hallway outside of Cafeteria B	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above		
	1	B	Hallway outside of Cafeteria B	Yes	Ceiling	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above		
	1	2	Hallway outside of Classrooms 200 - 202	Yes	Floor	Friction	Positive	Criterion Laboratories, Inc.	12/13/21-12/15/21	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	CJ Karoly	see above	see above	see above	see above	see above	see above	see above	see above	see above	XRF	XRF		
	1	2	Hallway outside of Classrooms 200 - 202	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above		
	1	2	Hallway outside of Classrooms 200 - 202	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above		
	1	1	Center Hallway between Classrooms 103 - 106	Yes	W3	None	Positive	Criterion Laboratories, Inc.	2/2/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	see above	see above	see above	see above	see above	see above	see above	see above	see above	XRF	XRF		
	1	2	Hallway outside of Classrooms 200 - 202	Yes	W4	Chipping	Positive	Criterion Laboratories, Inc.	12/13/21-12/15/21	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	CJ Karoly	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	XRF	XRF	
	1	2	Hallway outside of Classrooms 207-209	yes	Floor	Friction	Positive	Criterion Laboratories, Inc.	12/13/21-12/15/21	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	CJ Karoly	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	XRF	XRF	
	1	2	Hallway outside of Classrooms 207-209	yes	W2	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above		
	1	2	Hallway outside of Classrooms 207-209	yes	W1	Friction	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above		
	1	2	Hallway outside of Classrooms 207-209	yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above		
	1	2	Hallway outside of Classrooms 207-209	yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above		
	1	2	Hallway outside of Classrooms 207-209	yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above		
	1	B	Hallway outside of PTA Cafeteria and Girls Restroom	Yes	Ceiling	Chipping	Positive	Criterion Laboratories, Inc.	12/13/21-12/15/21	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	CJ Karoly	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	XRF	XRF	
	1	B	Hallway outside of PTA Cafeteria and Girls Restroom	Yes	W1	Cracking	Positive	Criterion Laboratories, Inc.	12/13/21-12/15/21	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	CJ Karoly	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	XRF	XRF
	1	1	Classroom 103 Coat Closet	Yes	W1	None	Positive	Criterion Laboratories, Inc.	3/7/22-3/9/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	XRF	XRF	
	1	B	Hallway outside of PTA Cafeteria and Girls Restroom	Yes	W2	Cracking	Positive	Criterion Laboratories, Inc.	12/13/21-12/15/21	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	CJ Karoly	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	XRF	XRF
	1	1	Classroom 103 Coat Closet	Yes	W3	Partially Inaccessible	Positive	Criterion Laboratories, Inc.	3/7/22-3/9/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	XRF	XRF
	1	B	Hallway outside of PTA Cafeteria and Girls Restroom	Yes	W3	Cracking	Positive	Criterion Laboratories, Inc.	12/13/21-12/15/21	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	CJ Karoly	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	XRF	XRF
	1	1	Classroom 104 Coat Closet	Yes	W1	None	Positive	Criterion Laboratories, Inc.	3/7/22-3/9/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	XRF	XRF
	1	B	Hallway outside of PTA Cafeteria and Girls Restroom	Yes	W4	Cracking	Positive	Criterion Laboratories, Inc.	12/13/21-12/15/21	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	CJ Karoly	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	XRF	XRF
	1	1	Classroom 104 Coat Closet	Yes	W3	Partially Inaccessible	Positive	Criterion Laboratories, Inc.	3/7/22-3/9/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	XRF	XRF
	1	B	Hallway outside of PTA Cafeteria and Girls Restroom	Yes	Ceiling	Chipping	Positive	Criterion Laboratories, Inc.	12/13/21-12/15/21	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	CJ Karoly	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	XRF	XRF
	1	B	Hallway outside Rooms 1-3	Yes	Ceiling	Flaking	Positive	Criterion Laboratories, Inc.	12/13/21-12/15/21	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	CJ Karoly	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	XRF	XRF

Task ID	Element	Floor	On Site Room Name	Student/Teacher Occupied	Component	Description of Paint and Plaster Damage	XRF (positive/ negative)	Name of Firm	Date of Renovation	Brief Description of Renovation	Name of Assigned Renovator	Name(s) of Trained Worker(s), if used	Name of Dust Sampling Technician, Inspector, or Risk Assessor, if used	Copies of renovator and dust sampling technician qualifications (training certificates, certifications) on file	Certified renovator provided training to workers on posting warning signs	Certified renovator provided training to workers on setting up plastic containment barriers	Certified renovator provided training to workers on maintaining containment	Certified renovator provided training to workers on avoiding spread of dust to adjacent areas	Certified renovator provided training to workers on waste handling	Certified renovator provided training to workers on post-renovation cleaning	Certified renovator provided training to workers on test kit or test results from an EPA-recognized laboratory on collected paint chip sample, used by certified renovator to determine whether lead was present on components affected by renovation	If yes to the previous, identify the method used, type of test kit used (if applicable), laboratory used to conduct paint chip analysis, describe sampling location and results	
	1	B	Stairwell and Foyer beside Boy's Restroom	Yes	W2	Cracking	Positive	Criterion Laboratories, Inc.	12/13/21-12/15/21	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	CJ Karoly	☑	☑	☑	☑	☑	☑	☑	XRF	XRF	
	1	B	Stairwell and Foyer beside Boy's Restroom	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
	1	B	Stairwell and Foyer beside Boy's Restroom	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
	1	2	Classroom 209 Coat Closet	Yes	W1	None	Positive	Criterion Laboratories, Inc.	2/11/22-2/17/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF	
	1	2	Classroom 209 Coat Closet	Yes	W2	Partially Inaccessible	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
	1	B	Stairwell beside Basement Facilities Storage Room	Yes	Floor	Friction	Positive																
	1	B	Stairwell beside Basement Facilities Storage Room	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
	1	3	Classroom 307	Yes	W3	None	Positive	Criterion Laboratories, Inc.	1/4/22-1/12/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF	
	1	B	Stairwell beside Basement Facilities Storage Room	Yes	W3	Chipping	Positive	Criterion Laboratories, Inc.	12/13/21-12/15/21	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	CJ Karoly	☑	☑	☑	☑	☑	☑	☑	☑	XRF	XRF
	1	B	Stairwell beside Basement Facilities Storage Room	Yes	W4	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
	1	B	Stairwell beside Cafeteria B	Yes	Floor	Friction	Positive	Criterion Laboratories, Inc.	12/13/21-12/15/21	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	CJ Karoly	☑	☑	☑	☑	☑	☑	☑	XRF	XRF	
	1	B	Stairwell beside Cafeteria B	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
	1	B	Stairwell beside Cafeteria B	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
	1	B	Stairwell beside Cafeteria B	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
	1	1	Stairwell beside Classroom 102	Yes	Floor	Friction	Positive																
	1	1	Stairwell beside Classroom 102	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
	1	1	Stairwell beside Classroom 102	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
	1	1	Stairwell beside Classroom 102	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
	1	1	Stairwell beside Classroom 107	Yes	Floor	Friction	Positive																
	1	1	Stairwell beside Classroom 107	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
	1	1	Stairwell beside Classroom 107	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
	1	1	Stairwell beside Classroom 107	Yes	W4	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
	1	3	Stairwell beside Classroom 302	Yes	Floor	Friction	Positive																
	1	3	Stairwell beside Classroom 302	Yes	W3	Friction	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
	1	3	Stairwell beside Classroom 302	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
	1	3	Stairwell beside Classroom 302	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
	1	3	Stairwell beside Classroom 302	Yes	Ceiling	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
	1	3	Classroom 301	Yes	W4	None	Positive																
	1	3	Stairwell beside Classroom 307	Yes	Floor	Friction	Positive																
	1	3	Stairwell beside Classroom 307	Yes	W3	Friction	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
	1	3	Stairwell beside Classroom 307	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
	1	3	Stairwell beside Classroom 307	Yes	W2	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
	1	3	Classroom 310	Yes	W1	None	Positive	Criterion Laboratories, Inc.	1/11/22-1/18/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF	
	1	3	Classroom 310	Yes	W2	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
	1	3	Stairwell beside Classroom 307	Yes	W4	Cracking	Positive																
	1	1	Stairwell outside of Main Office	Yes	Floor	Friction	Positive																
	1	1	Stairwell outside of Main Office	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
	1	1	Stairwell outside of Main Office	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
	1	B	Storage Closet beside Southeast Stairwell	Yes	Ceiling	Moisture Damage	Positive	Criterion Laboratories, Inc.	12/13/21-12/15/21	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	CJ Karoly	☑	☑	☑	☑	☑	☑	☑	XRF	XRF	
	1	B	Storage Closet beside Southeast Stairwell	Yes	Ceiling	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
	1	3	Storage Room across from Classroom 307	Yes	W1	Cracking	Positive	Criterion Laboratories, Inc.	1/6/22-1/12/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	☑	☑	☑	☑	☑	☑	☑	XRF	XRF	

Task ID	Element	Flavor	On Site Room Name	Student/Teacher Occupied	Component	Description of Paint and Plaster Damage	XRF (positive/ negative)	Name of Firm	Date of Renovation	Brief Description of Renovation	Name of Assigned Renovator	Name(s) of Trained Worker(s), if used	Name of Dust Sampling Technician, Inspector, or Risk Assessor, if used	Copies of renovator and dust sampling technician qualifications (training certificates, certifications) on file	Certified renovator provided training to workers on posting warning signs	Certified renovator provided training to workers on setting up plastic containment barriers	Certified renovator provided training to workers on maintaining containment	Certified renovator provided training to workers on avoiding spread of dust to adjacent areas	Certified renovator provided training to workers on waste handling	Certified renovator provided training to workers on post-renovation cleaning	Certified renovator provided training to workers on test kit or test results from an EPA-recognized laboratory on collected paint chip sample, used by certified renovator to determine whether lead was present on components affected by renovation	If yes to the previous, identify the method used, type of test kit used (if applicable), laboratory used to conduct paint chip analysis, describe sampling location and results
	1	3	Storage Room across from Classroom 307	Yes	W2	Moisture Damage	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Storage Room across from Classroom 307	Yes	Ceiling	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Storage Room beside Classroom 200	Yes	W1	Cracking	Positive	Criterion Laboratories, Inc.	2/28/22-3/4/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Max Curran	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	XRF	XRF
	1	2	Storage Room beside Classroom 200	Yes	W2	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Storage Room beside Classroom 200	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Storage Room beside Classroom 200	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Storage Room beside Classroom 200	Yes	Ceiling	Moisture Damage	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Teacher's Lounge 215	Yes	W3	Chipping	Positive	Criterion Laboratories, Inc.	4/12/22-4/14/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	XRF	XRF
	1	2	Teacher's Lounge 215	Yes	W1	Friction	Positive	Criterion Laboratories, Inc.	4/12/22-4/14/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	XRF	XRF
	1	3	Classroom 308	Yes	W1	None	Positive	Criterion Laboratories, Inc.	1/11/22-1/18/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	XRF	XRF
	1	2	Teacher's Lounge 215	Yes	W1	Chipping	Positive	Criterion Laboratories, Inc.	4/12/22-4/14/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	XRF	XRF
	1	2	Teacher's Lounge 215	Yes	W2	Friction	Positive	Criterion Laboratories, Inc.	4/12/22-4/14/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	XRF	XRF
	1	3	Classroom 308	Yes	W4	None	Positive	Criterion Laboratories, Inc.	1/11/22-1/18/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	XRF	XRF
	1	2	Teacher's Lounge 215	Yes	W2	Friction	Positive	Criterion Laboratories, Inc.	4/12/22-4/14/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	XRF	XRF
	1	2	Teacher's Lounge 215	Yes	W1	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Teacher's Lounge 215	Yes	W1	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Teacher's Lounge 215	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Teacher's Lounge 215	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Teacher's Lounge 215	Yes	W4	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Teacher's Lounge 215	Yes	W4	Friction	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Teacher's Lounge 215	Yes	W4	Flaking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Teacher's Lounge 215 Storage Closet	Yes	W1	Chipping	Positive	Criterion Laboratories, Inc.	4/14/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	XRF	XRF
	1	2	Teacher's Lounge 215 Storage Closet	Yes	W1	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Teacher's Lounge 215 Storage Closet	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Storage Room across from Classroom 307	Yes	W1	None	Positive	Criterion Laboratories, Inc.	1/6/22-1/12/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	XRF	XRF
	1	2	Teacher's Lounge 215 Storage Closet	Yes	W1	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Storage Room across from Classroom 307	Yes	W2	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Storage Room across from Classroom 307	Yes	W3	Partially Inaccessible	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Storage Room across from Classroom 307	Yes	W3	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Storage Room across from Classroom 307	Yes	W4	Partially Inaccessible	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Storage Room across from Classroom 307	Yes	W4	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Teacher's Lounge 215 Storage Closet	Yes	W1	Chipping	Positive	Criterion Laboratories, Inc.	4/14/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	XRF	XRF
	1	2	Teacher's Lounge 215 Storage Closet	Yes	W3	Alligating	Positive	Criterion Laboratories, Inc.	4/14/22	paint & plaster stabilization	School District of Philadelphia	School District of Philadelphia	Jonathan McKinnon	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	XRF	XRF

Task ID	E l e m e n t	F l o o r	On Site Room Name	Warning signs posted at entrance to work area	Work area contained to prevent spread of dust and debris	All objects in the work area removed or covered (interiors)	HVAC ducts in the work area closed and covered (interiors)	Windows in the work area closed (interiors)	Doors in the work area closed and sealed (interiors)	Doors that must be used in the work area covered to allow passage but prevent spread of dust	Floors in the work area covered with taped-down plastic (interiors)	Waste contained on-site and while being transported off-site	Work site properly cleaned after renovation	All chips and debris picked up, protective sheeting misted, folded dirty side inward, and taped for removal	Light lenses inspected (Y/N)	Surfaces above light fixtures inspected (Y/N)	Work area surfaces and objects cleaned using HEPA vacuum and/or wet cloths or mops (interior)	Certified renovator post-renovation cleaning verification	Describe the results of post-renovation cleaning verification, including the number of wet and dry cloths used	If dust clearance testing was performed instead, attach a copy of the report	I certify under penalty of law that the previous information is true and complete (name and title)	Date signed
1	2	1	Classroom 204	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	30 DCC Wipes, 3 Colorimetric	Floor: < 6.86 µg/ft2 Windowsill: <3.368 µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	1/28/22
1	1	1	Women's Restroom																			
1	2	1	Classroom 204	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	30 DCC Wipes, 3 Colorimetric	Floor: < 6.86 µg/ft2 Windowsill: <3.368 µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	1/28/22
1	2	1	Classroom 206 Closet B																			
1	2	1	Classroom 207	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	30 (2x) DCC Wipes, 3 Colorimetric	Floor: 7.43 µg/ft2 Windowsill: <3.789 µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	2/14/22
1	2	1	Classroom 207	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
1	2	1	Classroom 207	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
1	2	1	Classroom 207	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
1	2	1	Classroom 207	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
1	2	1	Classroom 207 Coat Closet	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
1	1	1	East Hallway	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	30 DCC Wipes	n/a	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	2/9/22
1	1	1	East Hallway	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	30 DCC Wipes	n/a	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	2/9/22
1	2	1	Classroom 207 Coat Closet	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	30 (2x) DCC Wipes, 3 Colorimetric	Floor: 7.43 µg/ft2 Windowsill: <3.789 µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	2/14/22
1	1	1	East Hallway	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	30 DCC Wipes	n/a	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	2/9/22
1	2	1	Classroom 207 Coat Closet	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	30 (2x) DCC Wipes, 3 Colorimetric	Floor: 7.43 µg/ft2 Windowsill: <3.789 µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	2/14/22
1	1	1	Classroom 101	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	30 DCC Wipes	Floor: <5 µg/ft Windowsill: <3.6 µg/ft	Mike Barth, Industrial Hygienist/Environmental Scientist	3/22/22
1	1	1	Classroom 101	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
1	1	1	Classroom 101	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
1	2	1	Classroom 207 Coat Closet	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	30 (2x) DCC Wipes, 3 Colorimetric	Floor: 7.43 µg/ft2 Windowsill: <3.789 µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	2/14/22
1	1	1	Classroom 101	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	30 DCC Wipes	Floor: <5 µg/ft Windowsill: <3.6 µg/ft	Mike Barth, Industrial Hygienist/Environmental Scientist	3/22/22
1	2	1	Classroom 208																	Floor: < 5 µg/ft2 Windowsill: 13.12 µg/ft2		
1	1	1	Counselor																			
1	2	1	Classroom 208	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	30 DCC Wipes, 3 Colorimetric	Floor: < 5 µg/ft2 Windowsill: 13.12 µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	2/11/22
1	2	1	Classroom 208	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
1	2	1	Classroom 208	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
1	2	1	Classroom 208 Coat Closet	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
1	1	1	Counselor																			
1	2	1	Classroom 208 Coat Closet	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	30 DCC Wipes, 3 Colorimetric	Floor: < 5 µg/ft2 Windowsill: 13.12 µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	2/11/22
1	1	1	Classroom 102	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	30 DCC Wipes, 3 colorimetric	Floor: < 5 µg/ft2 Windowsill: 10.61 µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	3/10/22
1	2	1	Classroom 208 Coat Closet	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	30 DCC Wipes, 3 Colorimetric	Floor: < 5 µg/ft2 Windowsill: 13.12 µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	2/11/22
1	2	1	Classroom 208 Coat Closet	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	30 DCC Wipes, 3 Colorimetric	Floor: < 5 µg/ft2 Windowsill: 13.12 µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	2/11/22
1	2	1	Classroom 209	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	30 DCC Wipes, 3 Colorimetric	Floor: <5 µg/ft2 Windowsill: 15.15 µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	2/19/22
1	2	1	Classroom 209	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
1	1	1	Auditorium Stage Dressing Room - Classroom 100 Side	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	120 DCC Wipes, 12 colorimetric	Floor: µg/ft2 Windowsill: µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	

Task ID	Element	Floor	On Site Room Name	Warning signs posted at entrance to work area	Work area contained to prevent spread of dust and debris	All objects in the work area removed or covered (interiors)	HVAC ducts in the work area closed and covered (interiors)	Windows in the work area closed (interiors)	Doors in the work area closed and sealed (interiors)	Doors that must be used in the work area covered to allow passage but prevent spread of dust	Floors in the work area covered with taped-down plastic (interiors)	Waste contained on-site and while being transported off-site	Work site properly cleaned after renovation	All chips and debris picked up, protective sheeting misted, folded dirty side inward, and taped for removal	Light lenses inspected (Y/N)	Surfaces above light fixtures inspected (Y/N)	Work area surfaces and objects cleaned using HEPA vacuum and/or wet cloths or mops (interior)	Certified renovator post-renovation cleaning verification	Describe the results of post-renovation cleaning verification, including the number of wet and dry cloths used	If dust clearance testing was performed instead, attach a copy of the report	I certify under penalty of law that the previous information is true and complete (name and title)	Date signed
1	1	1	Classroom 102 Restroom	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	5 DCC Wipes (2x) "Initial floor samples failed (26.86 µg/ft2), recleaned and passed."	Floor: < 5 µg/ft2 Window sill: 19.2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	3/11/22
1	1	1	Classroom 102 Restroom	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
1	1	1	Classroom 102 Restroom	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
1	1	1	Classroom 102 Restroom	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
1	2	2	Classroom 209	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	30 DCC Wipes, 3 Colorimetric	Floor: <5 µg/ft2 Windowsill: 15.15 µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	2/19/22
1	2	2	Classroom 209	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
1	2	2	Classroom 209	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
1	2	2	Classroom 209	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
1	2	2	Classroom 209 Coat Closet	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
1	1	1	Auditorium Entrance Stairwell across from Classroom 104	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	3 DCC Wipes	n/a	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	1/13/22
1	1	1	Auditorium Entrance Stairwell across from Classroom 104	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	3 DCC Wipes	n/a	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	1/13/22
1	1	1	Auditorium Entrance Stairwell across from Classroom 104	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	3 DCC Wipes	n/a	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	1/13/22
1	1	1	Auditorium Entrance Stairwell across from Classroom 104	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	3 DCC Wipes	n/a	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	1/13/22
1	2	2	Classroom 209 Coat Closet	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	30 DCC Wipes, 3 Colorimetric	Floor: <5 µg/ft2 Windowsill: 15.15 µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	2/19/22
1	1	1	Auditorium Entrance Stairwell across from Classroom 105	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	3 DCC Wipes	n/a	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	1/13/22
1	1	1	Auditorium Entrance Stairwell across from Classroom 105	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	3 DCC Wipes	n/a	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	1/13/22
1	1	1	Auditorium Entrance Stairwell across from Classroom 105	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	3 DCC Wipes	n/a	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	1/13/22
1	1	1	Auditorium Entrance Stairwell across from Classroom 105	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	3 DCC Wipes	n/a	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	1/13/22
1	3	3	Classroom 300	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	40 Wet DCC Wipes, 4 Colorimetric	Floor: < 5 µg/ft2 Windowsill: 56.37 µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	12/22/21
1	3	3	Classroom 300	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
1	3	3	Classroom 300	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
1	3	3	Classroom 300	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
1	1	1	Classroom 103	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	30 DCC Wipes, 3 colorimetric	Floor: < 5 µg/ft2 Windowsill: 4.98 µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	3/10/22
1	1	1	Classroom 103	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
1	1	1	Classroom 103	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
1	1	1	Classroom 104	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	30 DCC Wipes, 3 colorimetric	Floor: < 5 µg/ft2 Windowsill: <3.6 µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	3/10/22
1	3	3	Classroom 300	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	40 Wet DCC Wipes, 4 Colorimetric	Floor: < 5 µg/ft2 Windowsill: 56.37 µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	12/22/21
1	3	3	Classroom 301	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	40 Wet DCC Wipes, 3 Colorimetric	Initial FAAS samples failed (Floor: 38.76 µg/ft2 Windowsill: 241.33 µg/ft2). Recleaned and retested.	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	12/29/21
1	3	3	Classroom 301	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
1	3	3	Classroom 301	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
1	3	3	Classroom 302	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	24 Wet DCC Wipes, 3 Colorimetric	Floor: < 5 µg/ft2 Windowsill: <3.83 µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	12/29/21

Task ID	E l e m e n t	F l o o r	On Site Room Name	Warning signs posted at entrance to work area	Work area contained to prevent spread of dust and debris	All objects in the work area removed or covered (interiors)	HVAC ducts in the work area closed and covered (interiors)	Windows in the work area closed (interiors)	Doors in the work area closed and sealed (interiors)	Doors that must be used in the work area covered to allow passage but prevent spread of dust	Floors in the work area covered with taped-down plastic (interiors)	Waste contained on-site and while being transported off-site	Work site properly cleaned after renovation	All chips and debris picked up, protective sheeting misted, folded dirty side inward, and taped for removal	Light lenses inspected (Y/N)	Surfaces above light fixtures inspected (Y/N)	Work area surfaces and objects cleaned using HEPA vacuum and/or wet cloths or mops (interior)	Certified renovator post-renovation cleaning verification	Describe the results of post-renovation cleaning verification, including the number of wet and dry cloths used	If dust clearance testing was performed instead, attach a copy of the report	I certify under penalty of law that the previous information is true and complete (name and title)	Date signed
	1	1	Girl's Restroom	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	10 DCC Wipes, 2 Colorimetric	Floor: <5 µg/ft2 Windowsill: 14.67 µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	1/19/22
	1	B	East Hallway; South End																			
	1	1	Main Office Storage Closet	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	DCC Wipes	n/a	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	
	1	B	East Hallway; South End	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	40 DCC Wipes	n/a	CJ Karoly-Environmental Scientist	12/15/21
	1	B	Facilities Storage (former classroom)	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	16 DCC Wipes	n/a	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	3/23/22
	1	B	Facilities Storage (former classroom)	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Facilities Storage (former classroom)	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Facilities Storage (former classroom)	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Auditorium Stage Dressing Room - Classroom 100 Side																			
	1	B	Facilities Storage (former classroom)	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	16 DCC Wipes	n/a	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	3/23/22
	1	B	Fire Stair Tower	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Fire Stair Tower	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Fire Tower Stairwell	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	Wet DCC Wipes	n/a	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	
	1	1	Girl's Restroom	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	10 DCC Wipes, 2 Colorimetric	Floor: <5 µg/ft2 Windowsill: 14.67 µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	1/19/22
	1	1	Girl's Restroom	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Teacher's Lounge 216	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	10 DCC Wipes, 2 Colorimetric	Floor: 8.24 µg/ft2 Windowsill: <3.765 µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	2/17/22
	1	1	Girl's Restroom	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	10 DCC Wipes, 2 Colorimetric	Floor: <5 µg/ft2 Windowsill: 14.67 µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	1/19/22
	1	1	Girl's Restroom	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Girl's Restroom	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Girl's Restroom	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Girl's Restroom	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Girl's Restroom	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Gymnasium	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	20 DCC Wipes, 3 colorimetric	Floor @ B.E. office work area: < 5 µg/ft2, Floor @ Boiler Room work area: <5 µg/ft2 Windowsill: 10.25 µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	4/1/22
	1	B	Gymnasium	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Gymnasium	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Gymnasium	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Gymnasium	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Gymnasium Office	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	6 DCC Wipes	n/a	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	
	1	B	Gymnasium Office	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Gymnasium Office	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Gymnasium Office	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Gymnasium Office	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Gymnasium Office	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Gymnasium Storage																			
	1	3	Hallway outside Classrooms 300 - 302	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	25 DCC Wipes	n/a	CJ Karoly-Environmental Scientist	12/15/21

Task ID	Element	Fl oor	On Site Room Name	Warning signs posted at entrance to work area	Work area contained to prevent spread of dust and debris	All objects in the work area removed or covered (interiors)	HVAC ducts in the work area closed and covered (interiors)	Windows in the work area closed (interiors)	Doors in the work area closed and sealed (interiors)	Doors that must be used in the work area covered to allow passage but prevent spread of dust	Floors in the work area covered with taped-down plastic (interiors)	Waste contained on-site and while being transported off-site	Work site properly cleaned after renovation	All chips and debris picked up, protective sheeting misted, folded dirty side inward, and taped for removal	Light lenses inspected (Y/N)	Surfaces above light fixtures inspected (Y/N)	Work area surfaces and objects cleaned using HEPA vacuum and/or wet cloths or mops (interior)	Certified renovator performed post-renovation cleaning verification	Describe the results of post-renovation cleaning verification, including the number of wet and dry cloths used	If dust clearance testing was performed instead, attach a copy of the report	I certify under penalty of law that the previous information is true and complete (name and title)	Date signed
	1	3	Hallway outside Classrooms 300 - 302	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Hallway outside Classrooms 300 - 302	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Hallway outside Classrooms 300 - 302	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Hallway outside Classrooms 307 - 309	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	25 DCC Wipes	n/a	CJ Karoly-Environmental Scientist	12/15/21
	1	3	Hallway outside Classrooms 307 - 309	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Hallway outside Classrooms 307 - 309	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Hallway outside Classrooms 307 - 309	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Hallway outside of Cafeteria B	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	40 DCC Wipes	n/a	CJ Karoly-Environmental Scientist	12/15/21
	1	1	West Hallway																			
	1	B	Hallway outside of Cafeteria B	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	40 DCC Wipes	n/a	CJ Karoly-Environmental Scientist	12/15/21
	1	B	Hallway outside of Cafeteria B	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Hallway outside of Cafeteria B	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Hallway outside of Cafeteria B	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Hallway outside of Classrooms 200 - 202	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	40 DCC Wipes	n/a	CJ Karoly-Environmental Scientist	12/15/21
	1	2	Hallway outside of Classrooms 200 - 202	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Hallway outside of Classrooms 200 - 202	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Center Hallway between Classrooms 103 - 106	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	50 DCC Wipes	n/a	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	2/2/22
	1	2	Hallway outside of Classrooms 200 - 202	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	40 DCC Wipes	n/a	CJ Karoly-Environmental Scientist	12/15/21
	1	2	Hallway outside of Classrooms 207-209	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	40 DCC Wipes	n/a	CJ Karoly-Environmental Scientist	12/15/21
	1	2	Hallway outside of Classrooms 207-209	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Hallway outside of Classrooms 207-209	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Hallway outside of Classrooms 207-209	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Hallway outside of Classrooms 207-209	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Hallway outside of PTA Cafeteria and Girls Restroom	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	40 DCC Wipes	n/a	CJ Karoly-Environmental Scientist	12/15/21
	1	B	Hallway outside of PTA Cafeteria and Girls Restroom	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	40 DCC Wipes	n/a	CJ Karoly-Environmental Scientist	12/15/21
	1	1	Classroom 103 Coat Closet	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	30 DCC Wipes, 3 colorimetric	Floor: < 5 µg/ft2 Windowsill: 4.98 µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	3/10/22
	1	B	Hallway outside of PTA Cafeteria and Girls Restroom	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	40 DCC Wipes	n/a	CJ Karoly-Environmental Scientist	12/15/21
	1	1	Classroom 103 Coat Closet	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	30 DCC Wipes, 3 colorimetric	Floor: < 5 µg/ft2 Windowsill: 4.98 µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	3/10/22
	1	B	Hallway outside of PTA Cafeteria and Girls Restroom	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	40 DCC Wipes	n/a	CJ Karoly-Environmental Scientist	12/15/21
	1	1	Classroom 104 Coat Closet	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	30 DCC Wipes, 3 colorimetric	Floor: < 5 µg/ft2 Windowsill: <3.6 µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	3/10/22
	1	B	Hallway outside of PTA Cafeteria and Girls Restroom	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	40 DCC Wipes	n/a	CJ Karoly-Environmental Scientist	12/15/21
	1	1	Classroom 104 Coat Closet	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	30 DCC Wipes, 3 colorimetric	Floor: < 5 µg/ft2 Windowsill: <3.6 µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	3/10/22
	1	B	Hallway outside of PTA Cafeteria and Girls Restroom	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	40 DCC Wipes	n/a	CJ Karoly-Environmental Scientist	12/15/21
	1	B	Hallway outside Rooms 1-3	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	40 DCC Wipes	n/a	CJ Karoly-Environmental Scientist	12/15/21

Task ID	E l e m e n t	F l o o r	On Site Room Name	Warning signs posted at entrance to work area	Work area contained to prevent spread of dust and debris	All objects in the work area removed or covered (interiors)	HVAC ducts in the work area closed and covered (interiors)	Windows in the work area closed (interiors)	Doors in the work area closed and sealed (interiors)	Doors that must be used in the work area covered to allow passage but prevent spread of dust	Floors in the work area covered with taped-down plastic (interiors)	Waste contained on-site and while being transported off-site	Work site properly cleaned after renovation	All chips and debris picked up, protective sheeting misted, folded dirty side inward, and taped for removal	Light lenses inspected (Y/N)	Surfaces above light fixtures inspected (Y/N)	Work area surfaces and objects cleaned using HEPA vacuum and/or wet cloths or mops (interior)	Certified renovator post-renovation cleaning verification	Describe the results of post-renovation cleaning verification, including the number of wet and dry cloths used	If dust clearance testing was performed instead, attach a copy of the report	I certify under penalty of law that the previous information is true and complete (name and title)	Date signed
	1	3	Large Storage Closet outside of Classroom 309	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Large Storage Closet outside of Classroom 309	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Lunch Room	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	45 DCC Wipes, 5 colorimetric	Floor: $\mu\text{g}/\text{ft}^2$ Windowsill: $\mu\text{g}/\text{ft}^2$	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	
	1	B	Lunch Room	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Lunch Room	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Lunch Room	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Lunch Room	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 204	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	30 DCC Wipes, 2 Colorimetric	Floor: $< 6.86 \mu\text{g}/\text{ft}^2$ Windowsill: $< 3.368 \mu\text{g}/\text{ft}^2$	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	1/28/22
	1	B	Lunch Room	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	45 DCC Wipes, 5 colorimetric	Floor: $\mu\text{g}/\text{ft}^2$ Windowsill: $\mu\text{g}/\text{ft}^2$	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	
	1	2	Classroom 200 Coat Closet	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	30 DCC Wipes, 3 Colorimetric	Floor: $< 5 \mu\text{g}/\text{ft}^2$ Windowsill: $< 4.091 \mu\text{g}/\text{ft}^2$	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	2/1/22
	1	B	Lunch Room	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	45 DCC Wipes, 5 colorimetric	Floor: $\mu\text{g}/\text{ft}^2$ Windowsill: $\mu\text{g}/\text{ft}^2$	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	
	1	2	IMC (Library)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	DCC Wipes, Colorimetric	Floor: $< \mu\text{g}/\text{ft}^2$ Windowsill: $\mu\text{g}/\text{ft}^2$	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	
	1	B	Lunch Room																			
	1	1	Main Office																			
	1	2	IMC (Library)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	DCC Wipes, Colorimetric	Floor: $< \mu\text{g}/\text{ft}^2$ Windowsill: $\mu\text{g}/\text{ft}^2$	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	
	1	1	Main Office																			
	1	2	Hallway/Vestibule to Teacher's Lounge	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	4 DCC Wipes	n/a	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	
	1	1	Main Office																			
	1	2	Hallway/Vestibule to Teacher's Lounge	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	4 DCC Wipes	n/a	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	
	1	2	Hallway/Vestibule to Teacher's Lounge	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Main Office Storage Closet	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	5 DCC Wipes	n/a	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	3/29/22
	1	1	Main Office Storage Closet	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Main Office Storage Closet	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Main Office Storage Closet	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Men's Restroom beside Classroom 109																			
	1	2	Teacher's Lounge 215 Storage Closet	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	10 DCC Wipes	n/a	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	4/14/22
	1	2	Classroom 207	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	30 (2x) DCC Wipes, 3 Colorimetric	Floor: $7.43 \mu\text{g}/\text{ft}^2$ Windowsill: $< 3.789 \mu\text{g}/\text{ft}^2$	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	2/14/22
	1	1	Men's Restroom beside Classroom 109																		CJ Karoly-Environmental Scientist	
	1	2	Teacher's Lounge 215 Storage Closet	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	4 DCC Wipes	n/a	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	
	1	1	Men's Restroom beside Classroom 109																		CJ Karoly-Environmental Scientist	
	1	1	Men's Restroom beside Classroom 109	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 208	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	30 DCC Wipes, 3 Colorimetric	Floor: $< 5 \mu\text{g}/\text{ft}^2$ Windowsill: $13.12 \mu\text{g}/\text{ft}^2$	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	2/11/22
	1	1	Men's Restroom beside Classroom 109																		CJ Karoly-Environmental Scientist	

Task ID	Element	Fl oor	On Site Room Name	Warning signs posted at entrance to work area	Work area contained to prevent spread of dust and debris	All objects in the work area removed or covered (interiors)	HVAC ducts in the work area closed and covered (interiors)	Windows in the work area closed (interiors)	Doors in the work area closed and sealed (interiors)	Doors that must be used in the work area covered to allow passage but prevent spread of dust	Floors in the work area covered with taped-down plastic (interiors)	Waste contained on-site and while being transported off-site	Work site properly cleaned after renovation	All chips and debris picked up, protective sheeting misted, folded dirty side inward, and taped for removal	Light lenses inspected (Y/N)	Surfaces above light fixtures inspected (Y/N)	Work area surfaces and objects cleaned using HEPA vacuum and/or wet cloths or mops (interior)	Certified renovator post-renovation cleaning verification	Describe the results of post-renovation cleaning verification, including the number of wet and dry cloths used	If dust clearance testing was performed instead, attach a copy of the report	I certify under penalty of law that the previous information is true and complete (name and title)	Date signed
	1	B	Stairwell and Foyer beside Boy's Restroom	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	40 DCC Wipes	n/a	CJ Karoly-Environmental Scientist	12/15/21
	1	B	Stairwell and Foyer beside Boy's Restroom	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Stairwell and Foyer beside Boy's Restroom	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Classroom 209 Coat Closet	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	30 DCC Wipes, 3 Colorimetric	Floor: <5 µg/ft2 Windowsill: 15.15 µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	2/19/22
	1	2	Classroom 209 Coat Closet	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Stairwell beside Basement Facilities Storage Room																			
	1	B	Stairwell beside Basement Facilities Storage Room	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Classroom 307	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	30 Wet DCC Wipes, 3 Colorimetric	Floor: < 5 µg/ft2 Windowsill: <3.83 µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	1/12/22
	1	B	Stairwell beside Basement Facilities Storage Room	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	40 DCC Wipes	n/a	CJ Karoly-Environmental Scientist	12/15/21
	1	B	Stairwell beside Basement Facilities Storage Room	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Stairwell beside Cafeteria B	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	40 DCC Wipes	n/a	CJ Karoly-Environmental Scientist	12/15/21
	1	B	Stairwell beside Cafeteria B	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Stairwell beside Cafeteria B	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Stairwell beside Cafeteria B	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Stairwell beside Classroom 102																			
	1	1	Stairwell beside Classroom 102	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Stairwell beside Classroom 102	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Stairwell beside Classroom 102	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Stairwell beside Classroom 107	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Stairwell beside Classroom 107	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Stairwell beside Classroom 107	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Stairwell beside Classroom 107	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Stairwell beside Classroom 107	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Stairwell beside Classroom 302																			
	1	3	Stairwell beside Classroom 302	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Stairwell beside Classroom 302	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Stairwell beside Classroom 302	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Stairwell beside Classroom 302	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Stairwell beside Classroom 302	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Classroom 301																			
	1	3	Stairwell beside Classroom 307																			
	1	3	Stairwell beside Classroom 307	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Stairwell beside Classroom 307	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Stairwell beside Classroom 307	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Classroom 310	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	20 Wet DCC Wipes, 2 Colorimetric	Floor: < 5 µg/ft2 Windowsill: <3.556 µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	1/18/22
	1	3	Classroom 310	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Stairwell beside Classroom 307																			
	1	1	Stairwell outside of Main Office																			
	1	1	Stairwell outside of Main Office	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	1	Stairwell outside of Main Office	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	B	Storage Closet beside Southeast Stairwell	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	40 DCC Wipes	n/a	CJ Karoly-Environmental Scientist	12/15/21
	1	B	Storage Closet beside Southeast Stairwell	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Storage Room across from Classroom 307	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	☑	6 Wet DCC Wipes	n/a	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	1/12/22

Task ID	E l e m e n t	F l o o r	On Site Room Name	Warning signs posted at entrance to work area	Work area contained to prevent spread of dust and debris	All objects in the work area removed or covered (interiors)	HVAC ducts in the work area closed and covered (interiors)	Windows in the work area closed (interiors)	Doors in the work area closed and sealed (interiors)	Doors that must be used in the work area covered to allow passage but prevent spread of dust	Floors in the work area covered with taped-down plastic (interiors)	Waste contained on-site and while being transported off-site	Work site properly cleaned after renovation	All chips and debris picked up, protective sheeting misted, folded dirty side inward, and taped for removal	Light lenses inspected (Y/N)	Surfaces above light fixtures inspected (Y/N)	Work area surfaces cleaned using HEPA vacuum and/or wet cloths or mops (interior)	Certified renovator post-renovation cleaning verification	Describe the results of post-renovation cleaning verification, including the number of wet and dry cloths used	If dust clearance testing was performed instead, attach a copy of the report	I certify under penalty of law that the previous information is true and complete (name and title)	Date signed
	1	3	Storage Room across from Classroom 307	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Storage Room across from Classroom 307	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Storage Room beside Classroom 200	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	10 (2x) DCC Wipes, 2 colorimetric (initial floor colorimetric failed, re-cleaned and retested and passed)	Floor: 9.47 µg/ft2 Windowsill: 13.66 µg/ft2	Max Curran, Industrial Hygienist	3/4/22
	1	2	Storage Room beside Classroom 200	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Storage Room beside Classroom 200	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Storage Room beside Classroom 200	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Storage Room beside Classroom 200	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Teacher's Lounge 215	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	10 DCC Wipes	n/a	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	4/14/22
	1	2	Teacher's Lounge 215	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	10 DCC Wipes	n/a	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	4/14/22
	1	3	Classroom 308	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	23 Wet DCC Wipes, 2 Colorimetric	Floor: 9.81 µg/ft2 Windowsill: 4.75 µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	1/18/22
	1	2	Teacher's Lounge 215	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	10 DCC Wipes	n/a	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	4/14/22
	1	2	Teacher's Lounge 215	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	10 DCC Wipes	n/a	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	4/14/22
	1	3	Classroom 308	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	23 Wet DCC Wipes, 2 Colorimetric	Floor: 9.81 µg/ft2 Windowsill: 4.75 µg/ft2	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	1/18/22
	1	2	Teacher's Lounge 215	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	10 DCC Wipes	n/a	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	4/14/22
	1	2	Teacher's Lounge 215	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Teacher's Lounge 215	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Teacher's Lounge 215	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Teacher's Lounge 215	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Teacher's Lounge 215	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Teacher's Lounge 215	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Teacher's Lounge 215	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Teacher's Lounge 215 Storage Closet	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	10 DCC Wipes	n/a	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	4/14/22
	1	2	Teacher's Lounge 215 Storage Closet	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Teacher's Lounge 215 Storage Closet	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Storage Room across from Classroom 307	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	6 Wet DCC Wipes	n/a	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	1/12/22
	1	2	Teacher's Lounge 215 Storage Closet	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Storage Room across from Classroom 307	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Storage Room across from Classroom 307	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Storage Room across from Classroom 307	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	3	Storage Room across from Classroom 307	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
	1	2	Teacher's Lounge 215 Storage Closet	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	10 DCC Wipes	n/a	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	4/14/22
	1	2	Teacher's Lounge 215 Storage Closet	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	10 DCC Wipes	n/a	Jonathan McKinnon, Industrial Hygienist/Environmental Scientist	4/14/22

ULCS#	Element	Floor	On Site Room Name	Student/Teacher Occupied	Component	Description of Paint and Plaster Damage	XRF (positive/negative)	Pre-Cleaning Completed (date)	Contents Moved (date)	Work Area Prepped (date)	Surfaces Stabilized (date)	Contents Back in Place (date)	Final Inspection Approval and Photos (date)	Square Footage of Work Area	Number of Required RRP Wipes	Number of Colorimetric Wipes Used to Pass	Final Colorimetric Wipe Submitted for AAS Analysis (yes/no)	AAS Analysis Results
2190	1	B	Girl's Restroom	Yes	W1	None	Positive	1/24/22	1/24/22	1/24/22	1/25/22	n/a	1/27/22	600	15	2	yes	Floor: < 5 µg/ft2 Windowsill: 69.17 µg/ft2
2190	1	B	Girl's Restroom	Yes	W2	None	Positive	1/24/22	1/24/22	1/24/22	1/25/22	n/a	1/27/22	600	15	2	yes	Floor: < 5 µg/ft2 Windowsill: 69.17 µg/ft2
2190	1	1	Auditorium	Yes	W1	Cracking	Positive	4/8/2022	4/8/2022	4/8/2022								
2190	1	B	Girl's Restroom	Yes	W4	None	Positive	1/24/22	1/24/22	1/24/22	1/25/22	n/a	1/27/22	600	15	2	yes	Floor: < 5 µg/ft2 Windowsill: 69.17 µg/ft2
2190	1	1	Auditorium	Yes	W2	Cracking	Positive	4/8/2022	4/8/2022	4/11/2022								
2190	1	B	Storage Closet beside Southeast Stairwell	Yes	W1	None	Positive	12/13/2021	12/13/2021	12/13/2021								
2190	1	B	Storage Closet beside Southeast Stairwell	Yes	W2	None	Positive	12/13/2021	12/13/2021	12/13/2021								
2190	1	B	Storage Closet beside Southeast Stairwell	Yes	W3	None	Positive	12/13/2021	12/13/2021	12/13/2021								
2190	1	B	Storage Closet beside Southeast Stairwell	Yes	W4	None	Positive	12/13/2021	12/13/2021	12/13/2021								
2190	1	1	Auditorium	Yes	W3	Cracking	Positive	4/8/2022	4/8/2022	4/11/2022								
2190	1	1	Auditorium	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Auditorium	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Auditorium	Yes	W2	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	East Hallway, South End	Yes	Ceiling	None	Positive	12/13/2021	12/13/2021	12/13/2021								
2190	1	1	Auditorium Entrance Stairwell across from Classroom 104	Yes	W1	Cracking	Positive	1/13/22	n/a	1/13/22	1/13/22	n/a	1/13/22	64	2	n/a	no	n/a
2190	1	1	Auditorium Entrance Stairwell across from Classroom 105	Yes	W1	Cracking	Positive	1/13/22	n/a	1/13/22	1/13/22	n/a	1/13/22	64	2	n/a	no	n/a
2190	1	1	Auditorium Entrance Stairwell across from Classroom 105	Yes	W1	Cracking	Positive	1/13/22	n/a	1/13/22	1/13/22	n/a	1/13/22	64	2	n/a	no	n/a
2190	1	1	Auditorium Stage	Yes	W2	Cracking	Positive	4/8/2022	4/8/2022	4/11/2022								
2190	1	1	Auditorium Stage	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Auditorium Stage	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Auditorium Stage Dressing Room - Classroom 100 Side	Yes	Floor	Friction	Positive	4/8/2022	4/8/2022	4/11/2022								
2190	1	B	PTA Lunchroom Storage Closet 3	Yes	W2	None	Positive	3/21/22	3/21/22	3/21/22	3/22/22	3/24/22	3/23/22	80	2	n/a	no	n/a
2190	1	1	Auditorium Stage Dressing Room - Classroom 100 Side	Yes	W1	Friction	Positive	4/8/2022	4/8/2022	4/11/2022	4/11/2022		4/14/22					
2190	1	1	Auditorium Stage Dressing Room - Classroom 100 Side	Yes	W4	Friction	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Auditorium Stage Dressing Room - Classroom 100 Side	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Auditorium Stage Dressing Room - Classroom 100 Side	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Auditorium Stage Dressing Room - Classroom 100 Side	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Auditorium Stage Dressing Room - Classroom 100 Side	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Auditorium Stage Dressing Room - Classroom 100 Side	Yes	Ceiling	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Auditorium Stage Dressing Room - Classroom 109 Side	Yes	Floor	Friction	Positive	4/8/2022	4/8/2022	4/11/2022	4/11/2022							
2190	1	1	Auditorium Stage Dressing Room - Classroom 109 Side	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Auditorium Stage Dressing Room - Classroom 109 Side	Yes	W1	Friction	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Auditorium Stage Dressing Room - Classroom 109 Side	Yes	W2	Friction	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Auditorium Stage Dressing Room - Classroom 109 Side	Yes	Ceiling	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Auditorium Stage Dressing Room - Classroom 109 Side	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Auditorium Stage Dressing Room - Classroom 109 Side	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Auditorium Stage Dressing Room - Classroom 109 Side	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Auditorium Stage Dressing Room - Classroom 109 Side	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Auditorium Stage Dressing Room - Classroom 109 Side	Yes	Ceiling	Flaking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Boy's Restroom	Yes	W4	Chipping	Positive	2/23/22	2/23/22	2/23/22	2/25/22	3/2/22	3/1/22	300	8	2	yes	Floor: <5 µg/ft2 Windowsill: <6 µg/ft2
2190	1	1	Boy's Restroom	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Boy's Restroom	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Boy's Restroom	Yes	W3	Moisture Damage	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Boy's Restroom	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Boy's Restroom	Yes	Ceiling	Moisture Damage/Flaking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Boy's Restroom beside Speech Classroom	Yes	Ceiling	Moisture Damage	Positive	1/13/22	1/13/22	1/13/22	1/18/22	1/24/22	1/19/22	600	15	2	Yes	Floor: < 5 µg/ft2 Windowsill: 12.08 µg/ft2

ULCS#	E l e m e n t	F l o o r	On Site Room Name	Student/ Teacher Occupied	Component	Description of Paint and Plaster Damage	XRF (positive/ negative)	Pre-Cleaning Completed (date)	Contents Moved (date)	Work Area Prepped (date)	Surfaces Stabilized (date)	Contents Back in Place (date)	Final Inspection Approval and Photos (date)	Square Footage of Work Area	Number of Required RRP Wipes	Number of Colorimetric Wipes Used to Pass	Final Colorimetric Wipe Submitted for AAS Analysis (yes/no)	AAS Analysis Results
2190	1	B	Boy's Restroom beside Speech Classroom	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Boy's Restroom beside Speech Classroom	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Boy's Restroom beside Speech Classroom	Yes	W3	Moisture Damage	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Building Engineer's Restroom beside Boy's Restroom	Yes	W2	Moisture Damage/Chipping	Positive	3/18/22	3/18/22	3/18/22	3/18/22	3/24/22	3/22/22	100	3	n/a	no	n/a
2190	1	B	Building Engineer's Restroom beside Boy's Restroom	Yes	Ceiling	Flaking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Building Engineer's Restroom beside Boy's Restroom	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Building Engineer's Restroom beside Boy's Restroom	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Building Engineer's Restroom beside Boy's Restroom	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Building Engineers Office (accessed from Gymnasium)	Yes	Ceiling	Chipping	Positive	3/8/22	3/8/22	3/8/22	3/8/22	3/8/22	3/8/22	100	3	n/a	no	n/a
	1	2	Center Hallway	Yes	Floor	Friction	Positive	12/13/21-12/15/21	12/13/21-12/15/21	12/13/21-12/15/21	12/13/21-12/15/21	12/13/21-12/15/21	12/13/21-12/15/21	2000	50	n/a	no	n/a
2190	1	2	Center Hallway	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Center Hallway	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Center Hallway between Classrooms 103 - 106	Yes	Floor	Friction	Positive	2/2/22	2/2/22	2/2/22	2/2/22	2/3/22	2/2/22	2000	50	n/a	no	n/a
2190	1	1	Center Hallway between Classrooms 103 - 106	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Center Hallway between Classrooms 103 - 106	Yes	Ceiling	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Center Hallway between Classrooms 103 - 106	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Kitchen Storage Room 3	Yes	W1	None	Positive											
2190	1	B	Kitchen Storage Room 3	Yes	W2	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Kitchen Storage Room 3	Yes	W3	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Kitchen Storage Room 3	Yes	W4	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Center Hallway between Classrooms 103 - 106	Yes	W1	Flaking	Positive	2/2/22	2/2/22	2/2/22	2/2/22	2/3/22	2/2/22	2000	50	n/a	no	n/a
2190	1	1	Center Hallway between Classrooms 103 - 106	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 100	Yes	W3	Chipping	Positive	3/14/2022	3/14/2022	3/14/2022	3/16/22	3/22/22	3/17/22	1200	30		yes	Floor: <5 µg/ft Windowsill: 24.45 µg/ft
2190	1	1	Classroom 101	Yes	W3	Chipping	Positive	12/13/2021	12/13/2021	12/13/2021								
2190	1	1	Classroom 102	Yes	W2	Cracking	Positive	3/7/2022	3/7/2022	3/7/2022	3/8/22	3/11/22	3/9/22	1200	30	3	yes	Floor: < 5 µg/ft2 Windowsill: 10.61 µg/ft2
2190	1	1	Classroom 102	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 102	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 103	Yes	W3	Chipping	Positive	3/7/2022	3/7/2022	3/7/2022	3/8/22	3/10/22	3/9/22	1200	30	3	yes	Floor: < 5 µg/ft2 Windowsill: 4.98 µg/ft2
2190	1	B	Gymnasium Storage	Yes	W1	Partially Inaccessible	Positive											
2190	1	B	Gymnasium Storage	Yes	W3	Partially Inaccessible	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Gymnasium Storage	Yes	W4	Partially Inaccessible	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Gymnasium Storage	Yes	Ceiling	Partially Inaccessible	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Fire Stair Tower	Yes	W1	None	Positive											
2190	1	1	Classroom 103 Coat Closet	Yes	W2	Cracking	Positive	3/7/2022	3/7/2022	3/7/2022	3/8/22	3/10/22	3/9/22	1200	30	3	yes	Floor: < 5 µg/ft2 Windowsill: 4.98 µg/ft2
2190	1	B	Fire Stair Tower	Yes	W3	None	Positive											
2190	1	B	Fire Stair Tower	Yes	W4	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 103 Coat Closet	Yes	W4	Chipping	Positive	3/7/2022	3/7/2022	3/7/2022	3/8/22	3/10/22	3/9/22	1200	30	3	yes	Floor: < 5 µg/ft2 Windowsill: 4.98 µg/ft2
2190	1	1	Classroom 104	Yes	W3	Chipping	Positive	3/7/2022	3/7/2022	3/7/2022	3/8/22	3/10/22	3/9/22	1200	30	3	yes	Floor: < 5 µg/ft2 Windowsill: <3.6 µg/ft2
2190	1	1	Classroom 104	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 104 Coat Closet	Yes	W3	Chipping	Positive	3/7/2022	3/7/2022	3/7/2022	3/8/22	3/10/22	3/9/22	1200	30	3	yes	Floor: < 5 µg/ft2 Windowsill: <3.6 µg/ft2
2190	1	1	Classroom 104 Coat Closet	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 104 Coat Closet	Yes	W4	Alligatoring/Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 105	Yes	W3	Chipping	Positive	2/28/22	2/28/22	2/28/22	3/1/22		3/4/22	1200	30	3	yes	Floor: <5 µg/ft2 Windowsill: <3.556 µg/ft2
2190	1	1	Classroom 105	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 105	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Stairwell and Foyer beside Boy's Restroom	Yes	Floor	None	Positive											
2190	1	1	Classroom 106	Yes	W3	Chipping	Positive	2/28/22	2/28/22	2/28/22	3/1/22	3/7/22	3/4/22	1200	30	3	yes	Floor: 9.28 µg/ft2 Windowsill: 9.38 µg/ft2
2190	1	1	Classroom 106	Yes	W1	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above

ULCS#	E l e m e n t	F l o o r	On Site Room Name	Student/ Teacher Occupied	Component	Description of Paint and Plaster Damage	XRF (positive/ negative)	Pre-Cleaning Completed (date)	Contents Moved (date)	Work Area Prepped (date)	Surfaces Stabilized (date)	Contents Back in Place (date)	Final Inspection Approval and Photos (date)	Square Footage of Work Area	Number of Required RRP Wipes	Number of Colorimetric Wipes Used to Pass	Final Colorimetric Wipe Submitted for AAS Analysis (yes/no)	AAS Analysis Results
2190	1	1	Classroom 106	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Boy's Restroom beside Speech Classroom	Yes	W4	None	Positive	1/13/22	1/13/22	1/13/22	1/18/22	1/24/22	1/19/22	600	15	2	Yes	Floor: < 5 µg/ft2 Windowsill: 12.08 µg/ft2
2190	1	1	Classroom 106	Yes	W3	Cracking	Positive	2/28/22	2/28/22	2/28/22	3/1/22	3/7/22	3/4/22	1200	30	3	yes	Floor: 9.28 µg/ft2 Windowsill: 9.38 µg/ft2
2190	1	1	Classroom 106 Coat Closet	Yes	W1	Cracking	Positive	2/28/22	2/28/22	2/28/22	3/1/22	3/7/22	3/4/22	1200	30	3	yes	Floor: 9.28 µg/ft2 Windowsill: 9.38 µg/ft2
2190	1	1	Classroom 106 Coat Closet	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 106 Coat Closet	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 107	Yes	W1	Cracking	Positive	2/18/22	2/18/22	2/18/22	2/22/22	2/25/22	2/24/22	1200	30	3	yes	Floor: <5 µg/ft2 Windowsill: 14.46 µg/ft2
2190	1	1	Classroom 107	Yes	W3	Flaking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 107	Yes	W4	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 107 Coat Closet	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 107 Coat Closet	Yes	W4	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 107 Restroom	Yes	W1	Cracking	Positive	2/18/22	2/18/22	2/18/22	2/22/22	2/25/22	2/24/22	1250	32	4	yes	Floor: <5 µg/ft2 Windowsill: 14.46 µg/ft2
2190	1	1	Classroom 107 Restroom	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 107 Restroom	Yes	W4	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 108	Yes	W3	Moisture Damage	Positive	2/18/22	2/18/22	2/18/22	2/22/22	2/25/22	2/24/22	1200	30	3	yes	Floor: <5 µg/ft2 Windowsill: 9.87 µg/ft2
2190	1	1	Classroom 108 Coat Closet	Yes	W2	Cracking	Positive	2/18/22	2/18/22	2/18/22	2/22/22	2/25/22	2/24/22	1200	30	3	yes	Floor: <5 µg/ft2 Windowsill: 9.87 µg/ft2
2190	1	1	Classroom 108 Coat Closet	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 109	Yes	W1	Chipping	Positive	2/28/22	2/28/22	2/28/22	3/1/22	3/7/22	3/4/22	1200	30	3	yes	Floor: <5 µg/ft2 Windowsill: <3.368 µg/ft2
2190	1	1	Classroom 109	Yes	W2	Partially Inaccessible/Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 109	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 109	Yes	W4	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 109 Coat Closet	Yes	W2	Flaking	Positive	2/28/22	2/28/22	2/28/22	3/1/22	3/7/22	3/4/22	1200	30	3	yes	Floor: <5 µg/ft2 Windowsill: <3.368 µg/ft2
2190	1	1	Classroom 109 Coat Closet	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 109 Coat Closet	Yes	W3	Cracking/Flaking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 109 Coat Closet	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Music Room	Yes	W2	None	Positive	3/31/22	3/31/22	3/31/22	4/4/22	4/8/22	4/5/22	440	11	3	yes	Floor: < 5 µg/ft2 Windowsill: 99.22 µg/ft2
2190	1	2	Classroom 200	Yes	W1	Cracking/Flaking	Positive	1/21/22	1/21/22	1/21/22	1/26/22	2/3/22	1/31/22	1200	30	3	yes	Floor: <5 µg/ft2 Windowsill: <4.091 µg/ft2
2190	1	2	Classroom 200	Yes	W2	Cracking/Flaking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 200	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 200	Yes	W3	Flaking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	RM2 Storage Closet A	Yes	W1	None	Positive	3/31/22	3/31/22	3/31/22	4/4/22	4/8/22	4/5/22	440	11	3	yes	Floor: < 5 µg/ft2 Windowsill: 99.22 µg/ft2
2190	1	B	RM2 Storage Closet A	Yes	W2	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	RM2 Storage Closet A	Yes	W3	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	RM2 Storage Closet A	Yes	W4	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	RM2 Storage Closet A	Yes	Ceiling	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 200	Yes	W4	Cracking/flaking	Positive	1/21/22	1/21/22	1/21/22	1/26/22	2/3/22	1/31/22	1200	30	3	yes	Floor: <5 µg/ft2 Windowsill: <4.091 µg/ft2
2190	1	2	Classroom 200	Yes	W4	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 200	Yes	W4	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 200 Coat Closet	Yes	W3	Chipping	Positive	1/21/22	1/21/22	1/21/22	1/26/22	2/3/22	1/31/22	1200	30	3	yes	Floor: <5 µg/ft2 Windowsill: <4.091 µg/ft2
2190	1	2	Classroom 200 Coat Closet	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 200 Coat Closet	Yes	W2	Cracking/Partially Inaccessible	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 200 Coat Closet	Yes	W3	Flaking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 200 Coat Closet	Yes	W4	Cracking/Partially Inaccessible	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 201	Yes	W3	Chipping	Positive	1/21/22	1/21/22	1/21/22	1/24/22	2/3/22	1/26/22	1200	30	3	yes	Floor: <5 µg/ft2 Windowsill: <3.556 µg/ft2
2190	1	2	Classroom 201	Yes	W1	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 201	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 201	Yes	W4	Flaking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 201 Coat Closet	Yes	W1	Cracking/Alligatoring	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 201 Coat Closet	Yes	W2	Flaking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 201 Coat Closet	Yes	W4	Cracking/Alligatoring	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above

ULCS#	Element	Floor	On Site Room Name	Student/Teacher Occupied	Component	Description of Paint and Plaster Damage	XRF (positive/negative)	Pre-Cleaning Completed (date)	Contents Moved (date)	Work Area Prepped (date)	Surfaces Stabilized (date)	Contents Back in Place (date)	Final Inspection Approval and Photos (date)	Square Footage of Work Area	Number of Required RRP Wipes	Number of Colorimetric Wipes Used to Pass	Final Colorimetric Wipe Submitted for AAS Analysis (yes/no)	AAS Analysis Results
2190	1	2	Classroom 202	Yes	W1	Cracking	Positive	1/18/22	1/18/22	1/18/22	1/18/22	1/24/22	1/21/22	1200	30	3	yes	Floor: < 5 µg/ft2 Windowsill: <3.445 µg/ft2
2190	1	2	Classroom 202	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 202	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 202	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 202	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 203	Yes	W3	Chipping	Positive	1/25/22	1/25/22	1/25/22	1/26/22	2/3/22	2/2/22	1200	30	3	yes	Floor: <5 µg/ft2 Windowsill: 52.73 µg/ft2
2190	1	2	Classroom 203	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 203	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 203	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 100	Yes	W1	None	Positive	3/14/2022	3/14/2022	3/14/2022	3/16/22	3/22/22	3/17/22	1200	30		yes	Floor: <5 µg/ft Windowsill: 24.45 µg/ft
2190	1	1	Classroom 100	Yes	W2	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 203	Yes	W4	Cracking	Positive	1/25/22	1/25/22	1/25/22	1/26/22	2/3/22	2/2/22	1200	30	3	yes	Floor: <5 µg/ft2 Windowsill: 52.73 µg/ft2
2190	1	2	Classroom 203	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 100	Yes	W4	None	Positive	3/14/2022	3/14/2022	3/14/2022	3/16/22	3/22/22	3/17/22	1200	30		yes	Floor: <5 µg/ft Windowsill: 24.45 µg/ft
2190	1	2	Classroom 204	Yes	W3	Chipping	Positive	1/26/22	1/26/22	1/26/22	1/26/22	2/1/22	1/26/22	1200	30	3	Yes	Floor: < 6.86 µg/ft2 Windowsill: <3.368 µg/ft2
2190	1	1	Women's Restroom	Yes	W2	None	Positive											
2190	1	2	Classroom 204	Yes	W3	Chipping	Positive	1/26/22	1/26/22	1/26/22	1/26/22	2/1/22	1/26/22	1200	30	3	Yes	Floor: < 6.86 µg/ft2 Windowsill: <3.368 µg/ft2
2190	1	2	Classroom 206 Closet B	Yes	W4	Cracking	Positive											
2190	1	2	Classroom 207	Yes	W1	Flaking	Positive	2/4/22	2/4/22	2/4/22	2/8/22	2/14/22	2/11/22	1200	30	3	Yes	Floor: 7.43 µg/ft2 Windowsill: <3.789 µg/ft2
2190	1	2	Classroom 207	Yes	W2	Cracking	Positive	2/4/22	2/4/22	2/4/22	2/8/22	2/14/22	2/11/22	1200	30	3	Yes	Floor: 7.43 µg/ft2 Windowsill: <3.789 µg/ft2
2190	1	2	Classroom 207	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 207	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 207	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 207 Coat Closet	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	East Hallway	Yes	W3	None	Positive	1/20/22	1/20/22	1/20/22	1/20/22	1/20/22	1/20/22	1000	25	n/a	no	n/a
2190	1	1	East Hallway	Yes	W3	None	Positive	1/20/22	1/20/22	1/20/22	1/20/22	1/20/22	1/20/22	1000	25	n/a	no	n/a
2190	1	2	Classroom 207 Coat Closet	Yes	W2	Cracking	Positive	2/4/22	2/4/22	2/4/22	2/8/22	2/14/22	2/11/22	1200	30	3	Yes	Floor: 7.43 µg/ft2 Windowsill: <3.789 µg/ft2
2190	1	1	East Hallway	Yes	W4	None	Positive	1/20/22	1/20/22	1/20/22	1/20/22	1/20/22	1/20/22	1000	25	n/a	no	n/a
2190	1	2	Classroom 207 Coat Closet	Yes	W3	Partially Inaccessible/Cracking	Positive	2/4/22	2/4/22	2/4/22	2/8/22	2/14/22	2/11/22	1200	30	3	Yes	Floor: 7.43 µg/ft2 Windowsill: <3.789 µg/ft2
2190	1	1	Classroom 101	Yes	W1	None	Positive	3/14/2022	3/14/2022	3/14/2022	3/16/22	3/22/22	3/17/22	1200	30		yes	Floor: <5 µg/ft Windowsill: <3.6 µg/ft
2190	1	1	Classroom 101	Yes	W2	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 101	Yes	W3	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 207 Coat Closet	Yes	W4	Cracking/Chipping	Positive	2/4/22	2/4/22	2/4/22	2/8/22	2/14/22	2/11/22	1200	30	3	Yes	Floor: 7.43 µg/ft2 Windowsill: <3.789 µg/ft2
2190	1	1	Classroom 101	Yes	W4	None	Positive	3/14/2022	3/14/2022	3/14/2022	3/16/22	3/22/22	3/17/22	1200	30		yes	Floor: <5 µg/ft Windowsill: <3.6 µg/ft
2190	1	2	Classroom 208	Yes	W3	Chipping	Positive	2/4/22	2/4/22	2/4/22	2/9/22	2/11/22	2/10/22	1200	30	3	yes	Floor: < 5 µg/ft2 Windowsill: 13.12 µg/ft2
2190	1	1	Counselor	Yes	W1	None	Positive	03/15/22	03/15/22	03/16/22								
2190	1	2	Classroom 208	Yes	W2	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 208	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 208	Yes	W4	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 208 Coat Closet	Yes	W1	Flaking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Counselor	yes	W4	None	Positive	03/15/22	03/15/22	03/16/22								
2190	1	2	Classroom 208 Coat Closet	Yes	W2	Flaking	Positive	2/4/22	2/4/22	2/4/22	2/9/22	2/11/22	2/10/22	1200	30	3	yes	Floor: < 5 µg/ft2 Windowsill: 13.12 µg/ft2
2190	1	1	Classroom 102	Yes	W1	None	Positive	3/7/2022	3/7/2022	3/7/2022	3/8/22	3/11/22	3/9/22	1200	30	3	yes	Floor: < 5 µg/ft2 Windowsill: 10.61 µg/ft2
2190	1	2	Classroom 208 Coat Closet	Yes	W3	Chipping	Positive	2/4/22	2/4/22	2/4/22	2/9/22	2/11/22	2/10/22	1200	30	3	yes	Floor: < 5 µg/ft2 Windowsill: 13.12 µg/ft2
2190	1	2	Classroom 208 Coat Closet	Yes	W4	Flaking	Positive	2/4/22	2/4/22	2/4/22	2/9/22	2/11/22	2/10/22	1200	30	3	yes	Floor: < 5 µg/ft2 Windowsill: 13.12 µg/ft2

ULCS#	Element	Floor	On Site Room Name	Student/Teacher Occupied	Component	Description of Paint and Plaster Damage	XRF (positive/negative)	Pre-Cleaning Completed (date)	Contents Moved (date)	Work Area Prepped (date)	Surfaces Stabilized (date)	Contents Back in Place (date)	Final Inspection Approval and Photos (date)	Square Footage of Work Area	Number of Required RRP Wipes	Number of Colorimetric Wipes Used to Pass	Final Colorimetric Wipe Submitted for AAS Analysis (yes/no)	AAS Analysis Results
2190	1	2	Classroom 209	Yes	W1	Cracking	Positive	2/11/22	2/11/22	2/11/22	2/14/22	2/21/22	2/16/22	1200	30	3	yes	Floor: <5 µg/ft2 Windowsill: 15.15 µg/ft2
2190	1	2	Classroom 209	Yes	W2	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Auditorium Stage Dressing Room - Classroom 100 Side	Yes	W3	None	Positive											
2190	1	1	Classroom 102 Restroom	Yes	W1	None	Positive	3/7/2022	3/7/2022	3/7/2022	3/8/22	3/11/22	3/9/22	100	3	2	yes	Floor: < 5 µg/ft2 Window sill: 19.23 µg/ft2
2190	1	1	Classroom 102 Restroom	Yes	W2	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 102 Restroom	Yes	W3	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 102 Restroom	Yes	W4	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 209	Yes	W3	Cracking/Chipping	Positive	2/11/22	2/11/22	2/11/22	2/14/22	2/21/22	2/16/22	1200	30	3	yes	Floor: <5 µg/ft2 Windowsill: 15.15 µg/ft2
2190	1	2	Classroom 209	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 209	Yes	W2	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 209	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 209 Coat Closet	Yes	W3	Flaking	Positive	2/11/22	2/11/22	2/11/22	2/14/22	2/21/22	2/16/22	1200	30	3	yes	Floor: <5 µg/ft2 Windowsill: 15.15 µg/ft2
2190	1	1	Auditorium Entrance Stairwell across from Classroom 104	Yes	W1	None	Positive	1/13/22	n/a	1/13/22	1/13/22	n/a	1/13/22	64	2	n/a	no	n/a
2190	1	1	Auditorium Entrance Stairwell across from Classroom 104	Yes	W2	None	Positive	1/13/22	n/a	1/13/22	1/13/22	n/a	1/13/22	64	2	n/a	no	n/a
2190	1	1	Auditorium Entrance Stairwell across from Classroom 104	Yes	W3	None	Positive	1/13/22	n/a	1/13/22	1/13/22	n/a	1/13/22	64	2	n/a	no	n/a
2190	1	1	Auditorium Entrance Stairwell across from Classroom 104	Yes	W4	None	Positive	1/13/22	n/a	1/13/22	1/13/22	n/a	1/13/22	64	2	n/a	no	n/a
2190	1	2	Classroom 209 Coat Closet	Yes	W4	Chipping	Positive	2/11/22	2/11/22	2/11/22	2/14/22							
2190	1	1	Auditorium Entrance Stairwell across from Classroom 105	Yes	W2	None	Positive	1/13/22	n/a	1/13/22	1/13/22	n/a	1/13/22	64	2	n/a	no	n/a
2190	1	1	Auditorium Entrance Stairwell across from Classroom 105	Yes	W3	None	Positive	1/13/22	n/a	1/13/22	1/13/22	n/a	1/13/22	64	2	n/a	no	n/a
2190	1	1	Auditorium Entrance Stairwell across from Classroom 105	Yes	W4	None	Positive	1/13/22	n/a	1/13/22	1/13/22	n/a	1/13/22	64	2	n/a	no	n/a
2190	1	3	Classroom 300	Yes	W3	Chipping	Positive	12/15/21	12/15/21	12/15/21	12/15/21	12/22/21	12/21/21	772	20	4	yes	Floor: < 5 µg/ft2 Windowsill: 56.37 µg/ft2
2190	1	3	Classroom 300	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Classroom 300	Yes	W4	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Classroom 300	Yes	W2	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Classroom 300	Yes	W3	Moisture Damage/Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 103	Yes	W1	None	Positive	3/7/2022	3/7/2022	3/7/2022	3/8/22	3/10/22	3/9/22	1200	30	3	yes	Floor: < 5 µg/ft2 Windowsill: 4.98 µg/ft2
2190	1	1	Classroom 103	Yes	W3	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 103	Yes	W4	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 104	Yes	W1	None	Positive	3/7/2022	3/7/2022	3/7/2022	3/8/22	3/10/22	3/9/22	1200	30	3	yes	Floor: < 5 µg/ft2 Windowsill: <3.6 µg/ft2
2190	1	3	Classroom 300	Yes	W4	Chipping	Positive	12/15/21	12/15/21	12/15/21	12/15/21	12/22/21	12/21/21	772	20	4	Yes	Floor: < 5 µg/ft2 Windowsill: 56.37 µg/ft2
2190	1	3	Classroom 301	Yes	W1	Cracking	Positive	12/15/21	12/15/21	12/15/21	12/15/21	12/29/21	12/21/21	772	20	3	yes	Floor: < 5 µg/ft2 Windowsill: 6.12 µg/ft2
2190	1	3	Classroom 301	Yes	W2	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Classroom 301	Yes	W3	Flaking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Classroom 302	Yes	W2	Chipping	Positive	12/22/21	12/22/21	12/23/21	12/28/21	12/29/21	12/28/21	928	24	3	Yes	Floor: < 5 µg/ft2 Windowsill: <3.83 µg/ft2
2190	1	3	Classroom 302	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Classroom 302	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Classroom 302	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Classroom 302	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Classroom 302	Yes	W4	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Classroom 303	Yes	W1	Cracking	Positive	12/23/21	12/23/21	12/27/21	12/28/21	1/3/21	12/28/21	746	19	3	Yes	Floor: < 5 µg/ft2 Windowsill: <3.83 µg/ft2
2190	1	3	Classroom 303	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above

ULCS#	Element	Floor	On Site Room Name	Student/Teacher Occupied	Component	Description of Paint and Plaster Damage	XRF (positive/negative)	Pre-Cleaning Completed (date)	Contents Moved (date)	Work Area Prepped (date)	Surfaces Stabilized (date)	Contents Back in Place (date)	Final Inspection Approval and Photos (date)	Square Footage of Work Area	Number of Required RRP Wipes	Number of Colorimetric Wipes Used to Pass	Final Colorimetric Wipe Submitted for AAS Analysis (yes/no)	AAS Analysis Results
2190	1	3	Classroom 303	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Classroom 304	Yes	W3	Chipping	Positive	12/28/21	12/28/21	12/29/21	12/30/21	1/4/21	12/30/21	900	23	3	Yes	Floor: 5.59 µg/ft2 Windowsill: 3.98 µg/ft2
2190	1	3	Classroom 304	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Classroom 304	Yes	W3	Moisture Damage/Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Classroom 304 Coat Closet	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Classroom 304 Coat Closet	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Classroom 304 Coat Closet	Yes	W3	Partially Inaccessible/Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Classroom 304 Coat Closet	Yes	W4	Cracking/Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 107	Yes	W2	None	Positive	2/18/22	2/18/22	2/18/22	2/22/22	2/25/22	2/24/22	1200	30	3	yes	Floor: <5 µg/ft2 Windowsill: 14.46 µg/ft2
2190	1	3	Classroom 305	Yes	W1	Chipping	Positive	1/3/22	1/3/22	1/4/22	1/4/22	1/11/22	1/10/22	900	23	3	Yes	Floor: 6.2 µg/ft2 Windowsill: 39.89 µg/ft2
2190	1	3	Classroom 305	Yes	W3	Moisture Damage/Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Classroom 306	Yes	W1	Cracking/Chipping	Positive	12/28/21	12/28/21	12/29/21	12/29/21	1/4/21	12/30/21	700	18	2	Yes	Floor: < 5 µg/ft2 Windowsill: <3.333 µg/ft2
2190	1	3	Classroom 306	Yes	W2	Cracking/Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Classroom 306	Yes	W3	Cracking/Chipping/Moisture Damage	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 108	Yes	W1	None	Positive	2/18/22	2/18/22	2/18/22	2/22/22	2/25/22	2/24/22	1200	30	3	yes	Floor: <5 µg/ft2 Windowsill: 9.87 µg/ft2
2190	1	1	Classroom 108	Yes	W2	None	Positive	2/18/22	2/18/22	2/18/22	2/22/22	2/25/22	2/24/22	1200	30	3	yes	Floor: <5 µg/ft2 Windowsill: 9.87 µg/ft2
2190	1	3	Classroom 307	Yes	W1	Cracking	Positive	1/3/22	1/3/22	1/4/22	1/10/2022		1/11/22	1200	30	3	Yes	Floor: < 5 µg/ft2 Windowsill: <3.83 µg/ft2
2190	1	3	Classroom 307	Yes	W2	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 108	Yes	W4	None	Positive	2/18/22	2/18/22	2/18/22								
2190	1	3	Classroom 307	Yes	W3	Chipping/Cracking	Positive	1/3/22	1/3/22	1/4/22	1/10/2022		1/11/22	1200	30	3	Yes	Floor: < 5 µg/ft2 Windowsill: <3.83 µg/ft2
2190	1	3	Classroom 307	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Classroom 307	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Classroom 308	Yes	W3	Flaking	Positive	1/11/22	1/11/22	1/11/22	1/12/2022	1/18/22	1/14/22	900	23	2	Yes	Floor: 9.81 µg/ft2 Windowsill: 4.75 µg/ft2
2190	1	3	Classroom 308	Yes	W2	Chipping/Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Classroom 308	Yes	W3	Chipping/Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Classroom 309	Yes	W2	Chipping	Positive	1/18/22	1/18/22	1/18/22	1/19/22	1/24/22	1/21/22	1200	30	3	yes	Floor: < 5 µg/ft2 Windowsill: <3.445 µg/ft2
2190	1	3	Classroom 309	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Men's Restroom beside Classroom 109	Yes	W1	None	Positive	12/13/2021	12/13/2021	12/13/2021	12/13/2021	12/14/21	12/13/21	150	4	1	yes	Floor: < 5 µg/ft2 Floor: < 5 µg/ft2 Windowsill: <3.445 µg/ft2
2190	1	3	Classroom 309	Yes	W1	Cracking	Positive	1/18/22	1/18/22	1/18/22	1/19/22	1/24/22	1/21/22	1200	30	3	yes	Floor: < 5 µg/ft2 Windowsill: <3.445 µg/ft2
2190	1	1	Men's Restroom beside Classroom 109	Yes	W1	None	Positive	12/13/2021	12/13/2021	12/13/2021	12/13/2021							
2190	1	3	Classroom 309	Yes	W2	Cracking	Positive	1/18/22	1/18/22	1/18/22	1/19/22	1/24/22	1/21/22	1200	30	3	yes	Floor: < 5 µg/ft2 Windowsill: <3.445 µg/ft2
2190	1	1	Men's Restroom beside Classroom 109	Yes	W2	None	Positive	12/13/2021	12/13/2021	12/13/2021	12/13/2021							
2190	1	3	Classroom 309	Yes	W3	Chipping	Positive	1/18/22	1/18/22	1/18/22	1/19/22	1/24/22	1/21/22	1200	30	3	yes	Floor: < 5 µg/ft2 Windowsill: <3.445 µg/ft2
2190	1	1	Men's Restroom beside Classroom 109	Yes	W3	None	Positive	12/13/2021	12/13/2021	12/13/2021	12/13/2021	12/14/21	12/13/21	150	4	1	yes	Floor: < 5 µg/ft2 Floor: < 5 µg/ft2 Windowsill: <3.445 µg/ft2
2190	1	3	Classroom 309	Yes	W4	Moisture Damage	Positive	1/18/22	1/18/22	1/18/22	1/19/22	1/24/22	1/21/22	1200	30	3	yes	Floor: < 5 µg/ft2 Floor: < 5 µg/ft2 Windowsill: <3.445 µg/ft2
2190	1	3	Classroom 310	Yes	W3	Cracking	Positive	1/11/22	1/11/22	1/11/22	1/12/22	1/18/22	1/14/22	660	17	2	Yes	Floor: < 5 µg/ft2 Windowsill: <3.556 µg/ft2
2190	1	1	Men's Restroom beside Classroom 109	Yes	W4	None	Positive	12/13/2021	12/13/2021	12/13/2021	12/13/2021	12/14/21	12/13/21	150	4	1	yes	Floor: < 5 µg/ft2
2190	1	1	Men's Restroom beside Classroom 109	Yes	Ceiling	None	Positive	12/13/2021	12/13/2021	12/13/2021	12/13/2021	12/14/21	12/13/21	150	4	1	yes	Floor: < 5 µg/ft2 Floor: < 5 µg/ft2 Windowsill: <3.556 µg/ft2
2190	1	3	Classroom 310	Yes	W4	Cracking	Positive	1/11/22	1/11/22	1/11/22	1/12/22	1/18/22	1/14/22	660	17	2	Yes	Floor: < 5 µg/ft2 Windowsill: <3.556 µg/ft2
2190	1	1	Closet across from Classroom 104	Yes	W1	Moisture Damage	Positive	03/11/22	03/11/22	03/11/22								

ULCS#	E l e m e n t	F l o o r	On Site Room Name	Student/ Teacher Occupied	Component	Description of Paint and Plaster Damage	XRF (positive/ negative)	Pre-Cleaning Completed (date)	Contents Moved (date)	Work Area Prepped (date)	Surfaces Stabilized (date)	Contents Back in Place (date)	Final Inspection Approval and Photos (date)	Square Footage of Work Area	Number of Required RRP Wipes	Number of Colorimetric Wipes Used to Pass	Final Colorimetric Wipe Submitted for AAS Analysis (yes/no)	AAS Analysis Results
2190	1	1	Closet across from Classroom 104	Yes	W2	Chipping	Positive	03/11/22	03/11/22	03/11/22								
2190	1	1	Auditorium Stage Dressing Room - Classroom 109 Side	Yes	W3	None	Positive	4/8/2022	4/8/2022	4/11/2022								
2190	1	1	Closet across from Classroom 104	Yes	W3	Chipping	Positive	03/11/22	03/11/22	03/11/22								
2190	1	1	Auditorium Stage Dressing Room - Classroom 100 Side	Yes	W3	None	Positive	4/8/2022	4/8/2022	4/11/2022								
2190	1	1	Closet across from Classroom 104	Yes	W4	Moisture Damage	Positive	03/11/22	03/11/22	03/11/22								
2190	1	1	Closet across from Classroom 104	Yes	Ceiling	Moisture Damage	Positive	03/11/22	03/11/22	03/11/22								
2190	1	1	Counselor	Yes	W3	Chipping	Positive	03/15/22	03/15/22	03/16/22								
2190	1	1	Counselor	Yes	W2	Chipping	Positive	03/15/22	03/15/22	03/16/22								
2190	1	1	Counselor	Yes	W3	Cracking	Positive	03/15/22	03/15/22	03/16/22								
2190	1	3	Dean	Yes	Floor	Friction	Positive	1/18/22	1/18/22	1/18/22	1/19/22	1/26/22	1/24/22	300	8	2	Yes	Floor: < 5 µg/ft2 Windowsill: 19.81 µg/ft2
2190	1	1	Auditorium	Yes	W3	None	Positive	4/8/2022	4/8/2022	4/11/2022								
2190	1	3	Dean	Yes	W3	Chipping	Positive	1/18/22	1/18/22	1/18/22	1/19/22	1/26/22	1/24/22	300	8	2	Yes	Floor: < 5 µg/ft2 Windowsill: 19.81 µg/ft2
2190	1	1	Principal's Office Hallway/Storage	yes	W1	None	Positive	3/25/22	3/25/22	3/25/22	3/25/22	3/29/22	3/25/22	32	1	n/a	no	n/a
2190	1	3	Dean	Yes	W1	Cracking	Positive	1/18/22	1/18/22	1/18/22	1/19/22	1/26/22	1/24/22	300	8	2	Yes	Floor: < 5 µg/ft2 Windowsill: 19.81 µg/ft2
2190	1	1	Principal's Office Hallway/Storage	yes	W3	None	Positive	3/25/22	3/25/22	3/25/22	3/25/22	3/29/22	3/25/22	32	1	n/a	no	
2190	1	1	Principal's Office Hallway/Storage	yes	W4	Partially Inaccessible	Positive	3/25/22	3/25/22	3/25/22	3/25/22	3/29/22	3/25/22	32	1	n/a	no	
2190	1	3	Dean	Yes	W2	Cracking	Positive	1/18/22	1/18/22	1/18/22	1/19/22	1/26/22	1/24/22	300	8	2	Yes	Floor: < 5 µg/ft2 Windowsill: 19.81 µg/ft2
2190	1	3	Dean	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Dean	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Dean	Yes	Ceiling	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	East Hallway	Yes	Floor	Friction	Positive	1/20/22	1/20/22	1/20/22	1/20/22	1/20/22	1/20/22	1000	25	n/a	no	n/a
2190	1	1	East Hallway	Yes	W2	Cracking	Positive	1/20/22	1/20/22	1/20/22	1/20/22	1/20/22	1/20/22	1000	25	n/a	no	n/a
2190	1	1	East Hallway	Yes	W4	Chipping/Moisture Damage	Positive	1/20/22	1/20/22	1/20/22	1/20/22	1/20/22	1/20/22	1000	25	n/a	no	n/a
2190	1	1	Main Office	Yes	W1	None	Positive											
2190	1	B	East Hallway; South End	Yes	Floor	Friction	Positive											
2190	1	B	East Hallway; South End	Yes	W2	Alligating	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Girl's Restroom	Yes	W2	None	Positive											
2190	1	B	East Hallway; South End	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Main Office Storage Closet	Yes	W1	Partially Inaccessible	Positive	3/24/22	3/24/22	3/24/22	3/25/22	3/30/22	3/29/22	100	3	n/a	no	n/a
2190	1	B	East Hallway; South End	Yes	W4	Cracking	Positive											
2190	1	B	Facilities Storage (former classroom)	Yes	W1	Cracking	Positive	3/18/22	3/18/22	3/18/22	3/22/22	3/24/22	3/22/22	400	10	n/a	no	n/a
2190	1	B	Facilities Storage (former classroom)	Yes	W2	Moisture Damage	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Facilities Storage (former classroom)	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Facilities Storage (former classroom)	Yes	W4	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Auditorium Stage Dressing Room - Classroom 100 Side	Yes	Ceiling	None	Positive	4/8/2022	4/8/2022	4/11/2022								
2190	1	B	Facilities Storage (former classroom)	Yes	Ceiling	Moisture Damage	Positive	3/18/22	3/18/22	3/18/22	3/22/22	3/24/22	3/22/22	400	10	n/a	no	n/a
2190	1	B	Fire Stair Tower	Yes	Ceiling	Moisture Damage	Positive	3/7/22	3/7/22	3/7/22	3/8/22							
2190	1	B	Fire Stair Tower	Yes	W2	Moisture Damage	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Fire Tower Stairwell	Yes	Ceiling	Moisture Damage	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Girl's Restroom	yes	W2	Cracking	Positive	1/3/22	n/a	1/3/22	1/5/22	1/19/22	1/18/22	300	8	2	yes	Floor: <5 µg/ft2 Windowsill: 14.67 µg/ft2
2190	1	1	Girl's Restroom	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Teacher's Lounge 216	Yes	W3	None	Positive	2/11/22	2/11/22	2/11/22	2/14/22	2/18/22	2/16/22	200	5	2	Yes	Floor: 8.24 µg/ft2 Windowsill: <3.765 µg/ft2
2190	1	1	Girl's Restroom	Yes	W2	Cracking/Moisture Damage	Positive	1/3/22	n/a	1/3/22	1/5/22	1/19/22	1/18/22	300	8	2	yes	Floor: <5 µg/ft2 Windowsill: 14.67 µg/ft2
2190	1	1	Girl's Restroom	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Girl's Restroom	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Girl's Restroom	Yes	Ceiling	Moisture Damage	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Girl's Restroom	yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above

ULCS#	Element	Floor	On Site Room Name	Student/Teacher Occupied	Component	Description of Paint and Plaster Damage	XRF (positive/negative)	Pre-Cleaning Completed (date)	Contents Moved (date)	Work Area Prepped (date)	Surfaces Stabilized (date)	Contents Back in Place (date)	Final Inspection Approval and Photos (date)	Square Footage of Work Area	Number of Required RRP Wipes	Number of Colorimetric Wipes Used to Pass	Final Colorimetric Wipe Submitted for AAS Analysis (yes/no)	AAS Analysis Results
2190	1	B	Girl's Restroom	Yes	Ceiling	Moisture Damage	Positive	1/24/22	1/24/22	1/24/22	1/25/22	n/a	1/27/22	600	15	2	yes	Floor: < 5 µg/ft2 Windowsill: 69.17 µg/ft2
2190	1	B	Girl's Restroom	Yes	W3	Moisture Damage	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Gymnasium	Yes	Ceiling	Moisture Damage	Positive	3/31/22	3/31/22	3/31/22	3/31/22	4/1/22	3/31/22	600	15	3	yes	Floor @ B.E. office work area: < 5 µg/ft2, Floor @ Boiler Room work area: <5 µg/ft2 Windowsill: 10.25 µg/ft2
2190	1	B	Gymnasium	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Gymnasium	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Gymnasium	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Gymnasium	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Gymnasium	Yes	Ceiling	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Gymnasium Office	Yes	Ceiling	Moisture Damage	Positive	3/10/22	3/10/22	3/10/22	3/10/22		3/10/22	100	3	n/a	no	n/a
2190	1	B	Gymnasium Office	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Gymnasium Office	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Gymnasium Office	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Gymnasium Office	Yes	W4	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Gymnasium Office	Yes	Ceiling	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Gymnasium Storage	Yes	Ceiling	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Hallway outside Classrooms 300 - 302	Yes	Floor	Friction	Positive	12/13/21	12/13/21	12/13/21	12/13/21	12/15/21	12/15/21	1000	25	n/a	no	n/a
2190	1	3	Hallway outside Classrooms 300 - 302	Yes	W2	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Hallway outside Classrooms 300 - 302	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Hallway outside Classrooms 300 - 302	Yes	W4	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Hallway outside Classrooms 307 - 309	Yes	Floor	Friction	Positive	12/13/21	12/13/21	12/13/21	12/13/21	12/15/21	12/15/21	1000	25	n/a	no	n/a
2190	1	3	Hallway outside Classrooms 307 - 309	Yes	W2	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Hallway outside Classrooms 307 - 309	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Hallway outside Classrooms 307 - 309	Yes	W4	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Hallway outside of Cafeteria B West Hallway	Yes	Ceiling	Flaking	Positive	12/13/21	12/13/21	12/13/21	12/13/21	12/15/21	12/15/21	1000	25	n/a	no	n/a
2190	1	1	West Hallway	Yes	W3	None	Positive	2/9/2022	2/9/2022	2/9/2022	2/9/2022	2/9/2022	2/9/2022	1000	25	n/a	no	n/a
2190	1	B	Hallway outside of Cafeteria B	Yes	W1	Cracking	Positive	12/13/21	12/13/21	12/13/21	12/13/21	12/15/21	12/15/21	1000	25	n/a	no	n/a
2190	1	B	Hallway outside of Cafeteria B	Yes	W3	Cracking	Positive	12/13/21	12/13/21	12/13/21	12/13/21	12/15/21	12/15/21	1000	25	n/a	no	n/a
2190	1	B	Hallway outside of Cafeteria B	Yes	W4	Cracking	Positive	12/13/21	12/13/21	12/13/21	12/13/21	12/15/21	12/15/21	1000	25	n/a	no	n/a
2190	1	B	Hallway outside of Cafeteria B	Yes	Ceiling	Chipping	Positive	12/13/21	12/13/21	12/13/21	12/13/21	12/15/21	12/15/21	1000	25	n/a	no	n/a
2190	1	2	Hallway outside of Classrooms 200 - 202	Yes	Floor	Friction	Positive	12/13/21	12/13/21	12/13/21	12/13/21	12/15/21	12/15/21	1000	25	n/a	no	n/a
2190	1	2	Hallway outside of Classrooms 200 - 202	Yes	W2	Cracking	Positive	12/13/21	12/13/21	12/13/21	12/13/21	12/15/21	12/15/21	1000	25	n/a	no	n/a
2190	1	2	Hallway outside of Classrooms 200 - 202	Yes	W3	Chipping	Positive	12/13/21	12/13/21	12/13/21	12/13/21	12/15/21	12/15/21	1000	25	n/a	no	n/a
2190	1	1	Center Hallway between Classrooms 103 - 106	Yes	W3	None	Positive	2/2/22	2/2/22	2/2/22	2/2/22	2/3/22	2/2/22	2000	50	n/a	no	n/a
2190	1	2	Hallway outside of Classrooms 200 - 202	Yes	W4	Chipping	Positive	12/13/2021	12/13/2021	12/13/2021	12/13/2021	12/13/2021	12/13/2021	1000	25	n/a	no	n/a
2190	1	2	Hallway outside of Classrooms 207-209	yes	Floor	Friction	Positive	12/13/2021	12/13/2021	12/13/2021	12/13/2021	12/13/2021	12/13/2021	1000	25	n/a	no	n/a
2190	1	2	Hallway outside of Classrooms 207-209	yes	W2	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Hallway outside of Classrooms 207-209	yes	W1	Friction	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Hallway outside of Classrooms 207-209	yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Hallway outside of Classrooms 207-209	yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Hallway outside of Classrooms 207-209	yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Hallway outside of PTA Cafeteria and Girls Restroom	Yes	Ceiling	Chipping	Positive	12/13/21	12/13/21	12/13/21	12/13/21	12/15/21	12/15/21	1000	25	n/a	no	n/a
2190	1	B	Hallway outside of PTA Cafeteria and Girls Restroom	Yes	W1	Cracking	Positive	12/13/21	12/13/21	12/13/21	12/13/21	12/15/21	12/15/21	1000	25	n/a	no	n/a
2190	1	1	Classroom 103 Coat Closet	Yes	W1	None	Positive	3/7/2022	3/7/2022	3/7/2022	3/8/22	3/10/22	3/9/22	1200	30	3	yes	Floor: < 5 µg/ft2 Windowsill: 4.98 µg/ft2
2190	1	B	Hallway outside of PTA Cafeteria and Girls Restroom	Yes	W2	Cracking	Positive	12/13/21	12/13/21	12/13/21	12/13/21	12/15/21	12/15/21	1000	25	n/a	no	n/a
2190	1	1	Classroom 103 Coat Closet	Yes	W3	Partially Inaccessible	Positive	3/7/2022	3/7/2022	3/7/2022	3/8/22	3/10/22	3/9/22	1200	30	3	yes	Floor: < 5 µg/ft2 Windowsill: 4.98 µg/ft2
2190	1	B	Hallway outside of PTA Cafeteria and Girls Restroom	Yes	W3	Cracking	Positive	12/13/21	12/13/21	12/13/21	12/13/21	12/15/21	12/15/21	1000	25	n/a	no	n/a
2190	1	1	Classroom 104 Coat Closet	Yes	W1	None	Positive	3/7/2022	3/7/2022	3/7/2022	3/8/22	3/10/22	3/9/22	1200	30	3	yes	Floor: < 5 µg/ft2 Windowsill: <3.6 µg/ft2

ULCS#	Element	Floor	On Site Room Name	Student/Teacher Occupied	Component	Description of Paint and Plaster Damage	XRF (positive/negative)	Pre-Cleaning Completed (date)	Contents Moved (date)	Work Area Prepped (date)	Surfaces Stabilized (date)	Contents Back in Place (date)	Final Inspection Approval and Photos (date)	Square Footage of Work Area	Number of Required RRP Wipes	Number of Colorimetric Wipes Used to Pass	Final Colorimetric Wipe Submitted for AAS Analysis (yes/no)	AAS Analysis Results
2190	1	B	Hallway outside of PTA Cafeteria and Girls Restroom	Yes	W4	Cracking	Positive	12/13/21	12/13/21	12/13/21	12/13/21	12/15/21	12/15/21	1000	25	n/a	no	n/a
2190	1	1	Classroom 104 Coat Closet	Yes	W3	Partially Inaccessible	Positive	3/7/2022	3/7/2022	3/7/2022	3/8/22	3/10/22	3/9/22	1200	30	3	yes	Floor: < 5 µg/ft2 Windowsill: <3.6 µg/ft2
2190	1	B	Hallway outside of PTA Cafeteria and Girls Restroom	Yes	Ceiling	Chipping	Positive	12/13/21	12/13/21	12/13/21	12/13/21	12/15/21	12/15/21	1000	25	n/a	no	n/a
2190	1	B	Hallway outside Rooms 1-3	Yes	Ceiling	Flaking	Positive	12/13/21	12/13/21	12/13/21	12/13/21	12/15/21	12/15/21	1000	25	n/a	no	n/a
2190	1	B	Hallway outside Rooms 1-3	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Hallway outside Rooms 1-3	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 107 Coat Closet	Yes	W1	None	Positive	2/18/22	2/18/22	2/18/22	2/22/22	2/25/22	2/24/22	1200	30	3	yes	Floor: <5 µg/ft2 Windowsill: 14.46 µg/ft2
2190	1	1	Classroom 107 Coat Closet	Yes	W1	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 107 Coat Closet	Yes	W2	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 107 Coat Closet	Yes	W3	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Classroom 107 Coat Closet	Yes	W3	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Hallway outside Rooms 1-3	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Hallway outside Rooms 1-3	Yes	W4	Cracking	Positive											
2190	1	1	Classroom 108 Coat Closet	Yes	W1	None	Positive	2/18/22	2/18/22	2/18/22	2/22/22	2/25/22	2/24/22	1200	30	3	yes	Floor: <5 µg/ft2 Windowsill: 9.87 µg/ft2
2190	1	B	Hallway outside Rooms 1-3	Yes	Ceiling	Flaking	Positive											
2190	1	1	Classroom 108 Coat Closet	Yes	W3	Partially Inaccessible	Positive	2/18/22	2/18/22	2/18/22	2/22/22	2/25/22	2/24/22	1200	30	3	yes	Floor: <5 µg/ft2 Windowsill: 9.87 µg/ft2
2190	1	2	Hallway/Vestibule to Teacher's Lounge	Yes	W2	Flaking	Positive	4/12/22	4/12/22	4/13/22	4/13/22	n/a	4/14/22	100	3	n/a	no	n/a
2190	1	2	Hallway/Vestibule to Teacher's Lounge	Yes	W4	Friction	Positive	4/12/22	4/12/22	4/13/22	4/13/22	n/a	4/14/22	100	3	n/a	no	n/a
2190	1	1	Classroom 109 Coat Closet	Yes	W2	Partially Inaccessible	Positive	2/28/22	2/28/22	2/28/22	3/1/22	3/7/22	3/4/22	1200	30	3	yes	Floor: <5 µg/ft2 Windowsill: <3.368 µg/ft2
2190	1	1	Handicap Access to Auditorium/Auditorium Storage Closet	Yes	W1	Cracking	Positive	2/15/22	2/15/22	2/15/22, 2/16/22	2/15/22	2/18/22	2/17/22	500	13	n/a	no	n/a
2190	1	1	Handicap Access to Auditorium/Auditorium Storage Closet	Yes	W2	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Handicap Access to Auditorium/Auditorium Storage Closet	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Handicap Access to Auditorium/Auditorium Storage Closet	Yes	W4	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Handicap Access to Auditorium/Auditorium Storage Closet	Yes	Ceiling	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 202	Yes	W4	None	Positive	1/18/22	1/18/22	1/18/22	1/18/22	1/24/22	1/21/22	1200	30	3	yes	Floor: < 5 µg/ft2 Windowsill: <3.445 µg/ft2
2190	1	2	IMC (Library)	Yes	W1	Chipping	Positive	03/10/22	03/10/22	03/10/22	03/15/22			1200	30	2	yes	Floor: 9.22 µg/ft2 Windowsill: 6.46 µg/ft2
2190	1	2	IMC (Library)	Yes	W3	Flaking/Moisture Damage/Cracking	Positive	03/10/22	03/10/22	03/10/22	03/15/22			1200	30	2	yes	Floor: 9.22 µg/ft2 Windowsill: 6.46 µg/ft2
2190	1	B	Kitchen Serving Line	yes	W1	Cracking	Positive	4/8/2022	4/8/2022	4/8/2022	4/11/22		4/12/22	1200	30	3	yes	Floor: µg/ft2 Windowsill: µg/ft2
2190	1	B	Kitchen Serving Line	yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Kitchen Serving Line	yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Large Storage Closet outside of Classroom 309	Yes	W3	Chipping	Positive	1/11/22	1/11/22	1/11/22	1/11/22	1/18/22	1/14/22	300	8	2	Yes	Floor: < 5 µg/ft2 Windowsill: 5.22 µg/ft2
2190	1	3	Large Storage Closet outside of Classroom 309	Yes	W1	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 201	Yes	W2	Partially Inaccessible	Positive	1/21/22	1/21/22	1/21/22	1/24/22	2/3/22	1/26/22	1200	30	3	yes	Floor: <5 µg/ft2 Windowsill: <3.556 µg/ft2
2190	1	3	Large Storage Closet outside of Classroom 309	Yes	W2	Flaking	Positive	1/11/22	1/11/22	1/11/22	1/11/22	1/18/22	1/14/22	300	8	2	Yes	Floor: < 5 µg/ft2 Windowsill: 5.22 µg/ft2
2190	1	3	Large Storage Closet outside of Classroom 309	Yes	W3	Flaking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Large Storage Closet outside of Classroom 309	Yes	W4	Flaking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Large Storage Closet outside of Classroom 309	Yes	Ceiling	Flaking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above

ULCS#	E l e m e n t	F l o o r	On Site Room Name	Student/ Teacher Occupied	Component	Description of Paint and Plaster Damage	XRF (positive/ negative)	Pre-Cleaning Completed (date)	Contents Moved (date)	Work Area Prepped (date)	Surfaces Stabilized (date)	Contents Back in Place (date)	Final Inspection Approval and Photos (date)	Square Footage of Work Area	Number of Required RRP Wipes	Number of Colorimetric Wipes Used to Pass	Final Colorimetric Wipe Submitted for AAS Analysis (yes/no)	AAS Analysis Results
2190	1	B	Lunch Room	Yes	W1	Cracking	Positive	4/8/2022	4/8/2022	4/8/2022	4/11/22		4/12/22	1200	30	3	yes	Floor: µg/ft2 Windowsill: µg/ft2
2190	1	B	Lunch Room	Yes	W1	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Lunch Room	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Lunch Room	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Lunch Room	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Lunch Room	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 204	Yes	W1	None	Positive	1/26/22	1/26/22	1/26/22	1/26/22	2/1/22	1/26/22	1200	30	3	Yes	Floor: < 6.86 µg/ft2 Windowsill: < 3.368 µg/ft2
2190	1	B	Lunch Room	Yes	W4	Cracking	Positive	4/8/2022	4/8/2022	4/8/2022	4/11/22		4/12/22	1200	30	3	yes	Floor: µg/ft2 Windowsill: µg/ft2
2190	1	2	Classroom 200 Coat Closet	Yes	W2	None	Positive	1/21/22	1/21/22	1/21/22	1/26/22	2/3/22	1/31/22	1200	30	3	yes	Floor: <5 µg/ft2 Windowsill: <4.091 µg/ft2
2190	1	B	Lunch Room	Yes	W4	Chipping	Positive	4/8/2022	4/8/2022	4/8/2022	4/11/22		4/12/22	1200	30	3	yes	Floor: µg/ft2 Windowsill: µg/ft2
2190	1	2	IMC (Library)	Yes	W2	None	Positive	03/10/22	03/10/22	03/10/22	03/15/22					2	yes	Floor: 9.22 µg/ft2 Windowsill: 6.46 µg/ft2
2190	1	B	Lunch Room	Yes	Ceiling	Cracking	Positive	4/8/2022	4/8/2022	4/8/2022	4/11/22		4/12/22	1200	30	3	yes	Floor: µg/ft2 Windowsill: µg/ft2
2190	1	1	Main Office	Yes	W2	Cracking	Positive											
2190	1	2	IMC (Library)	Yes	W4	Partially Inaccessible	Positive	03/10/22	03/10/22	03/10/22	03/15/22					2	yes	Floor: 9.22 µg/ft2 Windowsill: 6.46 µg/ft2
2190	1	1	Main Office	Yes	W3	Chipping/Moisture Damage	Positive											
2190	1	2	Hallway/Vestibule to Teacher's Lounge	Yes	W1	None	Positive	4/12/22	4/12/22	4/13/22	4/13/22	4/15/22	4/14/22	400	10	n/a	no	n/a
2190	1	1	Main Office	Yes	W4	Cracking	Positive											
2190	1	2	Hallway/Vestibule to Teacher's Lounge	Yes	W3	None	Positive	4/12/22	4/12/22	4/13/22	4/13/22	4/15/22	4/14/22	400	10	n/a	no	n/a
2190	1	2	Hallway/Vestibule to Teacher's Lounge	Yes	W4	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Main Office Storage Closet	Yes	W2	Chipping	Positive	3/24/22	3/24/22	3/24/22	3/25/22	3/30/22	3/29/22	100	3	n/a	no	n/a
2190	1	1	Main Office Storage Closet	Yes	W3	Flaking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Main Office Storage Closet	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Main Office Storage Closet	Yes	Ceiling	Flaking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Men's Restroom beside Classroom 109	Yes	W3	Chipping	Positive	12/13/2021	12/13/2021	12/13/2021	12/13/2021	12/14/21	12/13/21	150	4	1	yes	Floor: < 5 µg/ft2
2190	1	2	Teacher's Lounge 215 Storage Closet	Yes	W1	None	Positive											
2190	1	2	Classroom 207	Yes	W4	None	Positive	2/4/22	2/4/22	2/4/22	2/8/22	2/14/22	2/11/22	1200	30	3	Yes	Floor: 7.43 µg/ft2 Windowsill: <3.789 µg/ft2
2190	1	1	Men's Restroom beside Classroom 109	Yes	W1	Chipping	Positive	12/13/2021	12/13/2021	12/13/2021	12/13/2021	12/14/21	12/13/21	150	4	1	yes	Floor: < 5 µg/ft2
2190	1	2	Teacher's Lounge 215 Storage Closet	Yes	W2	None	Positive											
2190	1	1	Men's Restroom beside Classroom 109	Yes	W2	Cracking	Positive	12/13/2021	12/13/2021	12/13/2021	12/13/2021	12/14/21	12/13/21	150	4	1	yes	Floor: < 5 µg/ft2
2190	1	1	Men's Restroom beside Classroom 109	Yes	W3	Chipping	Positive	12/13/2021	12/13/2021	12/13/2021	12/13/2021	12/14/21	12/13/21	150	4	1	yes	Floor: < 5 µg/ft2 Windowsill: 13.12 µg/ft2
2190	1	2	Classroom 208	Yes	W1	None	Positive	2/4/22	2/4/22	2/4/22	2/9/22	2/11/22	2/10/22	1200	30	3	yes	Floor: < 5 µg/ft2 Windowsill: 13.12 µg/ft2
2190	1	1	Men's Restroom beside Classroom 109	Yes	W4	Chipping	Positive	12/13/2021	12/13/2021	12/13/2021	12/13/2021	12/14/21	12/13/21	150	4	1	yes	Floor: < 5 µg/ft2 Windowsill: 99.22 µg/ft2
2190	1	B	Music Room	Yes	W1	Flaking	Positive	3/31/22	3/31/22	3/31/22	4/4/22	4/8/22	4/5/22	440	11	3	yes	Floor: < 5 µg/ft2 Windowsill: 99.22 µg/ft2
2190	1	B	Music Room	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Music Room	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Music Room	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Music Room	Yes	Ceiling	Moisture Damage	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Northwest Stairwell Entrance Vestibule beside Room 3	Yes	W1	Cracking	Positive	1/18	1/18/22	1/18/22	1/18/22	n/a	1/18/22	72	2	n/a	no	n/a
2190	1	B	Northwest Stairwell Entrance Vestibule beside Room 3	Yes	W2	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Northwest Stairwell Entrance Vestibule beside Room 3	Yes	W2	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Nurse	Yes	W2	Chipping	Positive	2/11/22	2/11/22	2/11/22	2/16/22	2/18/22	2/16/22	300	8	3	yes	Floor: < 5 µg/ft2 Windowsill: 20.56 µg/ft2
2190	1	2	Nurse	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Nurse	Yes	Floor	Friction	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Classroom 200	Yes	W3	None	Positive	1/21/22	1/21/22	1/21/22	1/26/22	2/3/22	1/31/22	1200	30	3	yes	Floor: <5 µg/ft2 Windowsill: <4.091 µg/ft2
2190	1	2	Nurse	Yes	W1	Friction/Cracking	Positive	2/11/22	2/11/22	2/11/22	2/16/22	2/18/22	2/16/22	300	8	3	yes	Floor: < 5 µg/ft2 Windowsill: 20.56 µg/ft2
2190	1	2	Nurse	Yes	W1	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Nurse	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above

ULCS#	Element	Floor	On Site Room Name	Student/Teacher Occupied	Component	Description of Paint and Plaster Damage	XRF (positive/negative)	Pre-Cleaning Completed (date)	Contents Moved (date)	Work Area Prepped (date)	Surfaces Stabilized (date)	Contents Back in Place (date)	Final Inspection Approval and Photos (date)	Square Footage of Work Area	Number of Required RRP Wipes	Number of Colorimetric Wipes Used to Pass	Final Colorimetric Wipe Submitted for AAS Analysis (yes/no)	AAS Analysis Results
2190	1	2	Nurse's Restroom	Yes	W1	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
2190	1	2	Nurse	Yes	W3	Friction/Alligatoring	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
2190	1	2	Nurse's Restroom	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
2190	1	2	Nurse's Restroom	Yes	W3	Alligatoring	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
2190	1	2	Nurse's Restroom	Yes	Floor	Friction	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
2190	1	2	Nurse's Restroom	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
2190	1	2	Nurse's Restroom	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
2190	1	2	Nurse's Restroom	Yes	W4	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
2190	1	2	Nurse's Restroom	Yes	Ceiling	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
2190	1	2	Nurse's Restroom	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
2190	1	2	Nurse's Restroom	Yes	W4	Alligatoring	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
2190	1	2	Nurse	Yes	W1	Partially Inaccessible	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	
2190	1	1	Principal's Office	Yes	W4	Chipping	non-RRP	non-RRP	non-RRP	non-RRP	non-RRP	non-RRP	non-RRP	non-RRP	non-RRP	non-RRP	non-RRP	non-RRP
2190	1	1	Principal's Office	Yes	W1	Cracking	Positive	non-RRP	non-RRP	non-RRP	non-RRP	non-RRP	non-RRP	non-RRP	non-RRP	non-RRP	non-RRP	non-RRP
2190	1	1	Principal's Office	Yes	W2	Cracking	Positive	non-RRP	non-RRP	non-RRP	non-RRP	non-RRP	non-RRP	non-RRP	non-RRP	non-RRP	non-RRP	non-RRP
2190	1	2	Nurse	Yes	W2	None	Positive	2/11/22	2/11/22	2/11/22	2/16/22	2/18/22	2/16/22	300	8	3	yes	Floor: < 5 µg/ft2 Windowsill: 20.56 µg/ft2
2190	1	1	Principal's Office Hallway/Storage	yes	W2	Cracking	Positive	3/25/22	3/25/22	3/25/22	3/25/22	3/29/22	3/25/22	32	1	n/a	no	n/a
2190	1	1	Principal's Office Restroom	Yes	W1	Cracking/Chipping	Positive	3/30//22	3/30//22	3/30//22	3/30//22	3/31/22	3/30/22	32	1	n/a	no	n/a
2190	1	2	Nurse	Yes	W3	None	Positive	2/11/22	2/11/22	2/11/22	2/16/22	2/18/22	2/16/22	300	8	3	yes	Floor: < 5 µg/ft2 Windowsill: 20.56 µg/ft2
2190	1	1	Principal's Office Restroom	Yes	W2	Cracking	Positive	3/30//22	3/30//22	3/30//22	3/30/22	3/31/22	3/30/22	32	1	n/a	no	n/a
2190	1	2	Nurse	Yes	W4	None	Positive	2/11/22	2/11/22	2/11/22	2/16/22	2/18/22	2/16/22	300	8	3	yes	Floor: < 5 µg/ft2 Windowsill: 20.56 µg/ft2
2190	1	1	Principal's Office Restroom	Yes	W4	Cracking/Chipping	Positive	3/30//22	3/30//22	3/30//22	3/30/22	3/31/22	3/30/22	50	2	n/a	no	n/a
2190	1	1	Principal's Office Restroom	Yes	Ceiling	Moisture Damage/Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Principals Office Closet	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Principals Office Closet	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Principals Office Closet	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Principals Office Closet	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Principals Office Closet	Yes	Ceiling	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Principals Office Closet	yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Principals Office Closet	yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Teacher's Lounge 215	Yes	W2	None	Positive	4/12/22	4/12/22	4/13/22	4/13/22	4/15/22	4/14/22	400	10	n/a	no	n/a
2190	1	B	PTA Lunchroom Storage Closet 1	Yes	W2	Cracking	Positive	3/30/22	3/30/22	3/30/22	4/4/22							
2190	1	2	Teacher's Lounge 215	Yes	W2	None	Positive	4/12/22	4/12/22	4/13/22	4/13/22	4/15/22	4/14/22	400	10	n/a	no	n/a
2190	1	B	PTA Lunchroom Storage Closet 1	Yes	W3	Cracking	Positive	3/30/22	3/30/22	3/30/22	4/4/22							
2190	1	B	PTA Lunchroom Storage Closet 1	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	PTA Lunchroom Storage Closet 1	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	PTA Lunchroom Storage Closet 1	Yes	Ceiling	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	PTA Lunchroom Storage Closet 2	Yes	W1	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	PTA Lunchroom Storage Closet 2	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Teacher's Lounge 215	Yes	W4	None	Positive	4/12/22	4/12/22	4/13/22	4/13/22	4/15/22	4/14/22	400	10	n/a	no	n/a
2190	1	2	Teacher's Lounge 215 Storage Closet	Yes	W2	None	Positive											
2190	1	B	PTA Lunchroom Storage Closet 2	Yes	W3	Cracking	Positive											
2190	1	2	Teacher's Lounge 215 Storage Closet	Yes	W2	None	Positive											
2190	1	B	PTA Lunchroom Storage Closet 2	Yes	W4	Cracking	Positive											
2190	1	2	Teacher's Lounge 215 Storage Closet	Yes	W4	None	Positive											
2190	1	B	PTA Lunchroom Storage Closet 2	Yes	Ceiling	Moisture Damage	Positive											
2190	1	B	PTA Lunchroom Storage Closet 3	Yes	W1	Cracking	Positive	3/21/22	3/21/22	3/21/22	3/22/22	3/24/22	3/23/22	80	2	n/a	no	n/a
2190	1	B	PTA Lunchroom Storage Closet 3	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	PTA Lunchroom Storage Closet 3	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	PTA Lunchroom Storage Closet 3	Yes	Ceiling	Moisture Damage	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	PTA Lunchroom Storage Closet 4	Yes	W1	Cracking	Positive	3/21/22	3/21/22	3/21/22	3/22/22	3/24/22	3/23/22	120	3	n/a	no	n/a
2190	1	2	Teacher's Lounge 216	Yes	W4	None	Positive	2/11/22	2/11/22	2/11/22	2/14/22	2/18/22	2/16/22	200	5	2	Yes	Floor: 8.24 µg/ft2 Windowsill: <3.765 µg/ft2
2190	1	B	PTA Lunchroom Storage Closet 4	Yes	W2	Cracking	Positive	3/21/22	3/21/22	3/21/22	3/22/22	3/24/22	3/23/22	120	3	n/a	no	n/a
2190	1	2	Teacher's Lounge 216 Staff Restroom	Yes	W1	None	Positive	1/25/22	1/25/22	1/25/22	1/25/22	1/25/22	1/25/22	80	2	n/a	no	n/a
2190	1	2	Teacher's Lounge 216 Staff Restroom	Yes	W1	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Teacher's Lounge 216 Staff Restroom	Yes	W2	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Teacher's Lounge 216 Staff Restroom	Yes	W2	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	PTA Lunchroom Storage Closet 4	Yes	W3	Cracking	Positive	3/21/22	3/21/22	3/21/22	3/22/22	3/24/22	3/23/22	120	3	n/a	no	n/a
2190	1	B	PTA Lunchroom Storage Closet 4	Yes	Ceiling	Moisture Damage	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Teacher's Lounge 216 Staff Restroom	Yes	W3	None	Positive	1/25/22	1/25/22	1/25/22	1/25/22	1/25/22	1/25/22	80	2	n/a	no	n/a
2190	1	B	RM1 Storage Closet	Yes	W1	Cracking	Positive	3/21/22	3/21/22	3/21/22	3/24/22	3/30/22	3/28/22	700	18	3	yes	Floor: <5 µg/ft2 Windowsill: <5 µg/ft2
2190	1	B	RM1 Storage Closet	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Teacher's Lounge 216 Staff Restroom	Yes	W4	None	Positive	1/25/22	1/25/22	1/25/22	1/25/22	1/25/22	1/25/22	80	2	n/a	no	n/a

ULCS#	E l e m e n t	F l o o r	On Site Room Name	Student/ Teacher Occupied	Component	Description of Paint and Plaster Damage	XRF (positive/ negative)	Pre-Cleaning Completed (date)	Contents Moved (date)	Work Area Prepped (date)	Surfaces Stabilized (date)	Contents Back in Place (date)	Final Inspection Approval and Photos (date)	Square Footage of Work Area	Number of Required RRP Wipes	Number of Colorimetric Wipes Used to Pass	Final Colorimetric Wipe Submitted for AAS Analysis (yes/no)	AAS Analysis Results
2190	1	2	Teacher's Lounge 216 Staff Restroom	Yes	W4	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	RM1 Storage Closet	Yes	W3	Cracking	Positive	3/21/22	3/21/22	3/21/22	3/24/22	3/30/22	3/28/22	700	18	3	yes	Floor: <5 µg/ft2 Windowsill: <5 µg/ft2
2190	1	B	RM1 Storage Closet	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	RM1 Storage Closet	Yes	Ceiling	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	RM2 Storage Closet B	Yes	W1	Cracking	Positive	3/31/22	3/31/22	3/31/22	4/4/22	4/8/22	4/5/22	440	11	3	yes	Floor: < 5 µg/ft2 Windowsill: 99.22 µg/ft2
2190	1	B	RM2 Storage Closet B	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	RM2 Storage Closet B	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	RM2 Storage Closet B	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	RM2 Storage Closet B	Yes	Ceiling	Moisture Damage/Flaking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	RM3 Storage Closet A	Yes	W1	Cracking	Positive	3/18/22	3/18/22	3/18/22	3/22/22	3/24/22	3/22/22	400	10	n/a	no	n/a
2190	1	B	RM3 Storage Closet A	Yes	W2	Cracking	Positive	3/18/22	3/18/22	3/18/22	3/22/22	3/24/22	3/22/22	400	10	n/a	no	n/a
2190	1	B	RM3 Storage Closet A	Yes	W3	Cracking	Positive	3/18/22	3/18/22	3/18/22	3/22/22	3/24/22	3/22/22	400	10	n/a	no	n/a
2190	1	B	RM3 Storage Closet A	Yes	W4	Cracking	Positive	3/18/22	3/18/22	3/18/22	3/22/22	3/24/22	3/22/22	400	10	n/a	no	n/a
2190	1	B	RM3 Storage Closet A	Yes	Ceiling	Chipping	Positive	3/18/22	3/18/22	3/18/22	3/22/22	3/24/22	3/22/22	400	10	n/a	no	n/a
2190	1	2	Fire Tower Stairwell	Yes	W1	None	Positive	3/7/22	3/7/22	3/7/22	3/8/22							
2190	1	2	Fire Tower Stairwell	Yes	W2	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Fire Tower Stairwell	Yes	W3	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Fire Tower Stairwell	Yes	W4	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Speech	Yes	W1	Chipping	Positive	3/21/22	3/21/22	3/21/22	3/24/22	3/30/22	3/28/22	700	18	3	yes	Floor: <5 µg/ft2 Windowsill: <5 µg/ft2
2190	1	B	Speech	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Speech	Yes	W3	Moisture Damage	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Speech	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Speech	Yes	Ceiling	Moisture Damage	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Stairwell across from 109	Yes	Floor	Friction	Positive	2/2/22	2/2/22	2/2/22	2/2/22	n/a	2/4/22	300	8	n/a	no	n/a
2190	1	1	Stairwell across from 109	Yes	W2	Cracking	Positive											
2190	1	2	Classroom 201 Coat Closet	Yes	W3	Partially Inaccessible	Positive	1/21/22	1/21/22	1/21/22	1/24/22	2/3/22	1/26/22	1200	30	3	yes	Floor: <5 µg/ft2 Windowsill: <3.556 µg/ft2
2190	1	1	Stairwell across from 109	Yes	W3	Chipping	Positive	2/2/22	2/2/22	2/2/22	2/2/22	n/a	2/4/22	300	8	n/a	no	n/a
2190	1	2	Classroom 206 Closet A	Yes	W1	None	Positive											
2190	1	2	Classroom 206 Closet A	Yes	W2	None	Positive											
2190	1	2	Classroom 206 Closet A	Yes	W3	None	Positive											
2190	1	2	Classroom 206 Closet A	Yes	W4	None	Positive											
2190	1	2	Classroom 206 Closet B	Yes	W1	None	Positive											
2190	1	2	Classroom 206 Closet B	Yes	W2	None	Positive											
2190	1	2	Classroom 206 Closet B	Yes	W3	None	Positive											
2190	1	1	Stairwell across from 109	Yes	W4	Chipping	Positive											
2190	1	B	Stairwell and Entrance Vestibule beside Girl's Restroom	Yes	Ceiling	Moisture Damage	Positive	1/18	1/18/22	1/18/22	1/18/22	n/a	1/18/22	72	2	n/a	no	n/a
2190	1	B	Stairwell and Entrance Vestibule beside Girl's Restroom	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Stairwell and Entrance Vestibule beside Girl's Restroom	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Stairwell and Entrance Vestibule beside Girl's Restroom	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Stairwell and Entrance Vestibule beside Girl's Restroom	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Stairwell and Foyer beside Boy's Restroom	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Stairwell and Foyer beside Boy's Restroom	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Stairwell and Foyer beside Boy's Restroom	Yes	W4	Cracking	Positive											
2190	1	2	Classroom 209 Coat Closet	Yes	W1	None	Positive	2/11/22	2/11/22	2/11/22	2/14/22	2/21/22	2/16/22	1200	30	3	yes	Floor: <5 µg/ft2 Windowsill: 15.15 µg/ft2
2190	1	2	Classroom 209 Coat Closet	Yes	W2	Partially Inaccessible	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Stairwell beside Basement Facilities Storage Room	Yes	Floor	Friction	Positive	2/2/22	2/2/22	2/2/22	2/2/22	n/a	2/4/22	300	8	n/a	no	n/a
2190	1	B	Stairwell beside Basement Facilities Storage Room	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Classroom 307	Yes	W3	None	Positive											

ULCS#	Element	Floor	On Site Room Name	Student/Teacher Occupied	Component	Description of Paint and Plaster Damage	XRF (positive/negative)	Pre-Cleaning Completed (date)	Contents Moved (date)	Work Area Prepped (date)	Surfaces Stabilized (date)	Contents Back in Place (date)	Final Inspection Approval and Photos (date)	Square Footage of Work Area	Number of Required RRP Wipes	Number of Colorimetric Wipes Used to Pass	Final Colorimetric Wipe Submitted for AAS Analysis (yes/no)	AAS Analysis Results
2190	1	B	Stairwell beside Basement Facilities Storage Room	Yes	W3	Chipping	Positive	2/2/22	2/2/22	2/2/22	2/2/22	n/a	2/4/22	300	8	n/a	no	n/a
2190	1	B	Stairwell beside Basement Facilities Storage Room	Yes	W4	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Stairwell beside Cafeteria B	Yes	Floor	Friction	Positive	2/2/22	2/2/22	2/2/22	2/2/22	n/a	2/4/22	300	8	n/a	no	n/a
2190	1	B	Stairwell beside Cafeteria B	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Stairwell beside Cafeteria B	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Stairwell beside Cafeteria B	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Stairwell beside Classroom 102	Yes	Floor	Friction	Positive	12/14/2021	12/14/2021	12/14/2021	12/14/21	n/a	12/14/21	300	8	n/a	no	n/a
2190	1	1	Stairwell beside Classroom 102	Yes	W2	Cracking	Positive	see above	2/2/22	2/2/22	2/2/22	n/a	2/4/22	300	8	n/a	no	n/a
2190	1	1	Stairwell beside Classroom 102	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Stairwell beside Classroom 102	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Stairwell beside Classroom 107	Yes	Floor	Friction	Positive	2/2/22	2/2/22	2/2/22	2/2/22	n/a	2/4/22	300	8	n/a	no	n/a
2190	1	1	Stairwell beside Classroom 107	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Stairwell beside Classroom 107	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Stairwell beside Classroom 107	Yes	W4	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Stairwell beside Classroom 302	Yes	Floor	Friction	Positive	12/14/2021	12/14/2021	12/14/2021	12/14/21	n/a	12/14/21	300	8	n/a	no	n/a
2190	1	3	Stairwell beside Classroom 302	Yes	W3	Friction	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Stairwell beside Classroom 302	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Stairwell beside Classroom 302	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Stairwell beside Classroom 302	Yes	Ceiling	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Classroom 301	Yes	W4	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Stairwell beside Classroom 307	Yes	Floor	Friction	Positive	12/14/2021	12/14/2021	12/14/2021	12/14/21	n/a	12/14/21	300	8	n/a	no	n/a
2190	1	3	Stairwell beside Classroom 307	Yes	W3	Friction	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Stairwell beside Classroom 307	Yes	W1	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Stairwell beside Classroom 307	Yes	W2	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Classroom 310	Yes	W1	None	Positive	1/11/22	1/11/22	1/11/22	1/12/22	1/18/22	1/14/22	660	17	2	Yes	Floor: < 5 µg/ft2 Windowsill: < 3.556 µg/ft2
2190	1	3	Classroom 310	Yes	W2	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Stairwell beside Classroom 307	Yes	W4	Cracking	Positive	12/14/2021	12/14/2021	12/14/2021	12/14/21	n/a	12/14/21	300	8	n/a	no	n/a
2190	1	1	Stairwell outside of Main Office	Yes	Floor	Friction	Positive	1/20/22	1/20/22	1/20/22	1/20/22	1/20/22	1/20/22	1000	25	n/a	no	n/a
2190	1	1	Stairwell outside of Main Office	Yes	W2	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Stairwell outside of Main Office	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Storage Closet beside Southeast Stairwell	Yes	Ceiling	Moisture Damage	Positive											
2190	1	B	Storage Closet beside Southeast Stairwell	Yes	Ceiling	Chipping	Positive											
2190	1	3	Storage Room across from Classroom 307	Yes	W1	Cracking	Positive	1/5/22	1/5/22	1/6/22	1/6/22	n/a	1/12/22	120	3	n/a	no	n/a
2190	1	3	Storage Room across from Classroom 307	Yes	W2	Moisture Damage	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Storage Room across from Classroom 307	Yes	Ceiling	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Storage Room beside Classroom 200	Yes	W1	Cracking	Positive	2/28/22	2/28/22	2/28/22	3/1/22	3/7/22	3/4/22	300	8	yes	2	Floor: 9.47 µg/ft2 Windowsill: 13.66 µg/ft2
2190	1	2	Storage Room beside Classroom 200	Yes	W2	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Storage Room beside Classroom 200	Yes	W3	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Storage Room beside Classroom 200	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Storage Room beside Classroom 200	Yes	Ceiling	Moisture Damage	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Teacher's Lounge 215	Yes	W3	Chipping	Positive	4/12/22	4/12/22	4/13/22	4/13/22	4/15/22	4/14/22	400	10	n/a	no	n/a
2190	1	2	Teacher's Lounge 215	Yes	W1	Friction	Positive	4/12/22	4/12/22	4/13/22	4/13/22	4/15/22	4/14/22	400	10	n/a	no	n/a
2190	1	3	Classroom 308	Yes	W1	None	Positive	1/11/22	1/11/22	1/11/22	1/12/22							
2190	1	2	Teacher's Lounge 215	Yes	W1	Chipping	Positive	4/12/22	4/12/22	4/13/22	4/13/22	4/15/22	4/14/22	400	10	n/a	no	n/a
2190	1	2	Teacher's Lounge 215	Yes	W2	Friction	Positive	4/12/22	4/12/22	4/13/22	4/13/22	4/15/22	4/14/22	400	10	n/a	no	n/a
2190	1	3	Classroom 308	Yes	W4	None	Positive	1/11/22	1/11/22	1/11/22	1/12/2022	1/18/21	1/14/21	900	23	2	Yes	Floor: 9.81 µg/ft2 Windowsill: 4.75 µg/ft2
2190	1	2	Teacher's Lounge 215	Yes	W2	Friction	Positive	4/12/22	4/12/22	4/13/22	4/13/22	4/15/22	4/14/22	400	10	n/a	no	n/a
2190	1	2	Teacher's Lounge 215	Yes	W1	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Teacher's Lounge 215	Yes	W1	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Teacher's Lounge 215	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Teacher's Lounge 215	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Teacher's Lounge 215	Yes	W4	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Teacher's Lounge 215	Yes	W4	Friction	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Teacher's Lounge 215	Yes	W4	Friction	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above

ULCS#	Element	Floor	On Site Room Name	Student/Teacher Occupied	Component	Description of Paint and Plaster Damage	XRF (positive/negative)	Pre-Cleaning Completed (date)	Contents Moved (date)	Work Area Prepped (date)	Surfaces Stabilized (date)	Contents Back in Place (date)	Final Inspection Approval and Photos (date)	Square Footage of Work Area	Number of Required RRP Wipes	Number of Colorimetric Wipes Used to Pass	Final Colorimetric Wipe Submitted for AAS Analysis (yes/no)	AAS Analysis Results
2190	1	2	Teacher's Lounge 215	Yes	W4	Flaking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Teacher's Lounge 215 Storage Closet	Yes	W1	Chipping	Positive											
2190	1	2	Teacher's Lounge 215 Storage Closet	Yes	W1	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Teacher's Lounge 215 Storage Closet	Yes	W4	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Storage Room across from Classroom 307	Yes	W1	None	Positive	1/5/22	1/5/22	1/6/22	1/6/22	n/a	1/12/22	120	3	n/a	no	n/a
2190	1	2	Teacher's Lounge 215 Storage Closet	Yes	W1	Chipping	Positive											
2190	1	3	Storage Room across from Classroom 307	Yes	W2	None	Positive	1/5/22	1/5/22	1/6/22	1/6/22	n/a	1/12/22	120	3	n/a	no	n/a
2190	1	3	Storage Room across from Classroom 307	Yes	W3	Partially Inaccessible	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Storage Room across from Classroom 307	Yes	W3	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Storage Room across from Classroom 307	Yes	W4	Partially Inaccessible	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Storage Room across from Classroom 307	Yes	W4	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Teacher's Lounge 215 Storage Closet	Yes	W1	Chipping	Positive											
2190	1	2	Teacher's Lounge 215 Storage Closet	Yes	W3	Alligating	Positive											
2190	1	3	Large Storage Closet outside of Classroom 309	Yes	W1	None	Positive	1/11/22	1/11/22	1/11/22	1/11/22	1/18/22	1/14/22	300	8	2	Yes	Floor: < 5 µg/ft2 Windowsill: 5.22 µg/ft2
2190	1	2	Teacher's Lounge 215 Storage Closet	Yes	Ceiling	Cracking	Positive											
2190	1	3	Large Storage Closet outside of Classroom 309	Yes	W2	None	Positive	1/11/22	1/11/22	1/11/22	1/11/22	1/18/22	1/14/22	300	8	2	Yes	Floor: < 5 µg/ft2 Windowsill: 5.22 µg/ft2
2190	1	2	Teacher's Lounge 216	Yes	W2	Chipping	Positive	2/11/22	2/11/22	2/11/22	2/14/22	2/18/22	2/16/22	200	5	2	Yes	Floor: 8.24 µg/ft2 Windowsill: <3.765 µg/ft2
2190	1	3	Large Storage Closet outside of Classroom 309	Yes	W3	None	Positive	1/11/22	1/11/22	1/11/22	1/11/22	1/18/22	1/14/22	300	8	2	Yes	Floor: < 5 µg/ft2 Windowsill: 5.22 µg/ft2
2190	1	2	Teacher's Lounge 216	Yes	W3	Chipping	Positive	2/11/22	2/11/22	2/11/22	2/14/22	2/18/22	2/16/22	200	5	2	Yes	Floor: 8.24 µg/ft2 Windowsill: <3.765 µg/ft2
2190	1	2	Teacher's Lounge 216	Yes	W1	Chipping	Positive											
2190	1	3	Large Storage Closet outside of Classroom 309	Yes	W4	None	Positive	1/11/22	1/11/22	1/11/22	1/11/22	1/18/22	1/14/22	300	8	2	Yes	Floor: < 5 µg/ft2 Windowsill: 5.22 µg/ft2
2190	1	2	Teacher's Lounge 216	Yes	W1	Friction	Positive	2/11/22	2/11/22	2/11/22	2/14/22	2/18/22	2/16/22	200	5	2	Yes	Floor: 8.24 µg/ft2 Windowsill: <3.765 µg/ft2
2190	1	3	Large Storage Closet outside of Classroom 309	Yes	Floor	None	Positive	1/11/22	1/11/22	1/11/22	1/11/22	1/18/22	1/14/22	300	8	2	Yes	Floor: < 5 µg/ft2 Windowsill: 5.22 µg/ft2
2190	1	2	Teacher's Lounge 216	Yes	W1	Friction	Positive	2/11/22	2/11/22	2/11/22	2/14/22	2/18/22	2/16/22	200	5	2	Yes	Floor: 8.24 µg/ft2 Windowsill: <3.765 µg/ft2
2190	1	2	Teacher's Lounge 216	Yes	W1	Cracking	Positive	2/11/22	2/11/22	2/11/22	2/14/22	2/18/22	2/16/22	200	5	2	Yes	Floor: 8.24 µg/ft2 Windowsill: <3.765 µg/ft2
2190	1	2	Teacher's Lounge 216	Yes	W2	Cracking	Positive	2/11/22	2/11/22	2/11/22	2/14/22	2/18/22	2/16/22	200	5	2	Yes	Floor: 8.24 µg/ft2 Windowsill: <3.765 µg/ft2
2190	1	2	Teacher's Lounge 216	Yes	W2	Flaking	Positive	2/11/22	2/11/22	2/11/22	2/14/22	2/18/22	2/16/22	200	5	2	Yes	Floor: 8.24 µg/ft2 Windowsill: <3.765 µg/ft2
2190	1	2	Teacher's Lounge 216	Yes	W3	Cracking	Positive	2/11/22	2/11/22	2/11/22	2/14/22	2/18/22	2/16/22	200	5	2	Yes	Floor: 8.24 µg/ft2 Windowsill: <3.765 µg/ft2
2190	1	3	Hallway outside Classrooms 307 - 309	Yes	W3	None	Positive											
2190	1	2	Teacher's Lounge 216	Yes	W1	Cracking	Positive	2/11/22	2/11/22	2/11/22	2/14/22	2/18/22	2/16/22	200	5	2	Yes	Floor: 8.24 µg/ft2 Windowsill: <3.765 µg/ft2
2190	1	2	Teacher's Lounge 216	Yes	W2	Chipping	Positive	2/11/22	2/11/22	2/11/22	2/14/22	2/18/22	2/16/22	200	5	2	Yes	Floor: 8.24 µg/ft2 Windowsill: <3.765 µg/ft2
2190	1	2	Teacher's Lounge 216	Yes	W3	Chipping	Positive	2/11/22	2/11/22	2/11/22	2/14/22	2/18/22	2/16/22	200	5	2	Yes	Floor: 8.24 µg/ft2 Windowsill: <3.765 µg/ft2
2190	1	2	Teacher's Lounge 216 Staff Restroom	Yes	W3	Chipping	Positive	1/25/22	1/25/22	1/25/22	1/25/22	1/25/22	1/25/22	80	2	n/a	no	n/a
2190	1	2	Teacher's Lounge 216 Staff Restroom	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	2	Teacher's Lounge 216 Staff Restroom	Yes	Ceiling	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Visitors Entrance Foyer to Northeast Stairwell beside Cafeteria B	Yes	W1	Cracking	Positive	2/9/2022	2/9/2022	2/9/2022	2/9/2022	2/9/2022	2/9/2022					

ULCS#	E l e m e n t	F l o o r	On Site Room Name	Student/ Teacher Occupied	Component	Description of Paint and Plaster Damage	XRF (positive/ negative)	Pre-Cleaning Completed (date)	Contents Moved (date)	Work Area Prepped (date)	Surfaces Stabilized (date)	Contents Back in Place (date)	Final Inspection Approval and Photos (date)	Square Footage of Work Area	Number of Required RRP Wipes	Number of Colorimetric Wipes Used to Pass	Final Colorimetric Wipe Submitted for AAS Analysis (yes/no)	AAS Analysis Results
2190	1	B	Visitors Entrance Foyer to Northeast Stairwell beside Cafeteria B	Yes	W2	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Visitors Entrance Foyer to Northeast Stairwell beside Cafeteria B	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Visitors Entrance Foyer to Northeast Stairwell beside Cafeteria B	Yes	W4	Moisture Damage	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	B	Visitors Entrance Foyer to Northeast Stairwell beside Cafeteria B	Yes	W2	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	West Hallway	Yes	Floor	Friction	Positive	2/9/2022	2/9/2022	2/9/2022	2/9/2022	2/9/2022	2/9/2022	1000	25	n/a	no	n/a
2190	1	3	Fire Tower Stairwell	Yes	W1	None	Positive	3/7/22	3/7/22	3/7/22	3/8/22							
2190	1	3	Fire Tower Stairwell	Yes	W2	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Fire Tower Stairwell	Yes	W3	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Fire Tower Stairwell	Yes	W4	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	3	Fire Tower Stairwell	Yes	Ceiling	None	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	West Hallway	Yes	W2	Chipping	Positive	2/9/2022	2/9/2022	2/9/2022	2/9/2022	2/9/2022	2/9/2022	1000	25	n/a	no	n/a
2190	1	1	West Hallway	Yes	W2	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	West Hallway	Yes	W2	Chipping	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	West Hallway	Yes	W3	Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	West Hallway	Yes	W4	Chipping/Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	West Hallway	Yes	W4	Chipping/Cracking	Positive	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above	see above
2190	1	1	Women's Restroom	Yes	W1	Cracking	Positive											
2190	1	1	Women's Restroom	Yes	W3	Cracking	Positive											
2190	1	1	Women's Restroom	Yes	W4	Cracking	Positive											
2190	1	B	RM2 Storage Closet A	Yes	Ceiling	None	Positive											

				Inspection Dates: 09/21/20-09/29/20									
				Name of Inspector: Michael Barth			Lead Safe Certification Assessment Report						
				Inspection Company: Criterion Labs			Fell Elementary School						
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)	
2190	1	B	24	Girl's Restroom	Yes	W1	Brick	White	None	0	17.8	Positive	
2190	1	B	24	Girl's Restroom	Yes	W2	Brick	White	None	0	19.2	Positive	
2190	1	1	112	Auditorium	Yes	W1	Wood	Tan	Cracking	2	3.1	Positive	
2190	1	B	24	Girl's Restroom	Yes	W4	Brick	White	None	0	22.3	Positive	
2190	1	1	112	Auditorium	Yes	W2	Wood	Tan	Cracking	3	3.5	Positive	
2190	1	B	24	Girl's Restroom	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	B	23	Storage Closet beside Southeast Stairwell	Yes	W1	Brick	White	None	0	18.9	Positive	
2190	1	B	23	Storage Closet beside Southeast Stairwell	Yes	W2	Brick	White	None	0	19.8	Positive	
2190	1	B	23	Storage Closet beside Southeast Stairwell	Yes	W3	Brick	White	None	0	17.8	Positive	
2190	1	B	23	Storage Closet beside Southeast Stairwell	Yes	W4	Brick	White	None	0	19.2	Positive	
2190	1	1	112	Auditorium	Yes	W3	Wood	Tan	Cracking	3	3.4	Positive	
2190	1	1	103B	Girl's Restroom	Yes	W2	Metal	Black	None	0	0.1	Negative	
2190	1	B	23	Storage Closet beside Southeast Stairwell	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	B	H03A	East Hallway; South End	Yes	W1	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	1	112	Auditorium	Yes	W3	Wood	Tan	Chipping	10	1.9	Positive	
2190	1	1	112	Auditorium	Yes	W4	Wood	Tan	Cracking	6	3.2	Positive	
2190	1	1	103B	Girl's Restroom	Yes	W3	Metal	Black	Chipping	3	0.02	Negative	
2190	1	1	112	Auditorium	Yes	W2	Metal	Tan	Chipping	5	3.1	Positive	
2190	1	B	H03A	East Hallway; South End	Yes	Ceiling	Plaster	White	None	0	22.4	Positive	
2190	1	B	H03A	East Hallway; South End	Yes	Floor	Concrete	Blue	Friction	1	0.21	Negative	
2190	1	1	S18	Auditorium Entrance Stairwell across from Classroom 104	Yes	W1	Wood	White	Cracking	5	3.2	Positive	
2190	1	1	S19	Auditorium Entrance Stairwell across from Classroom 105	Yes	W1	Plaster	Tan	Cracking	2	21.4	Positive	
2190	1	1	S19	Auditorium Entrance Stairwell across from Classroom 105	Yes	W1	Wood	White	Cracking	5	3.4	Positive	
2190	1	1	112B	Auditorium Stage	Yes	W2	Plaster	Tan	Cracking	2	14.1	Positive	
2190	1	1	112B	Auditorium Stage	Yes	W3	Plaster	Tan	Cracking	2	21.3	Positive	
2190	1	1	112B	Auditorium Stage	Yes	W4	Plaster	Tan	Cracking	2	22.1	Positive	
2190	1	B	S06	Stairwell and Entrance Vestibule beside Girl's Restroom	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	1	112D	Auditorium Stage Dressing Room - Classroom 100 Side	Yes	Floor	Wood	Tan	Friction	5	5.4	Positive	
2190	1	B	PTA3	PTA Lunchroom Storage Closet 3	Yes	W2	Plaster	Green	None	0	22.5	Positive	
2190	1	1	112D	Auditorium Stage Dressing Room - Classroom 100 Side	Yes	W1	Wood	Tan	Friction	1	7.8	Positive	
2190	1	1	112D	Auditorium Stage Dressing Room - Classroom 100 Side	Yes	W4	Wood	Tan	Friction	1	6.5	Positive	
2190	1	1	112D	Auditorium Stage Dressing Room - Classroom 100 Side	Yes	W1	Plaster	Tan	Cracking	1	21.3	Positive	

				Inspection Dates: 09/21/20-09/29/20									
				Name of Inspector: Michael Barth			Lead Safe Certification Assessment Report						
				Inspection Company: Criterion Labs			Fell Elementary School						
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)	
2190	1	B	PTA3	PTA Lunchroom Storage Closet 3	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	1	112D	Auditorium Stage Dressing Room - Classroom 100 Side	Yes	W2	Plaster	Tan	Cracking	1	21.4	Positive	
2190	1	1	112D	Auditorium Stage Dressing Room - Classroom 100 Side	Yes	W3	Plaster	Tan	Cracking	2	22.6	Positive	
2190	1	1	112D	Auditorium Stage Dressing Room - Classroom 100 Side	Yes	W4	Plaster	Tan	Cracking	2	23.1	Positive	
2190	1	1	106B	Boy's Restroom	Yes	W3	Metal	Black	Chipping	1	0.21	Negative	
2190	1	B	PTA4	PTA Lunchroom Storage Closet 4	Yes	W4	Plaster	Green	None	0	N/A	N/A	
2190	1	1	110A	Principal's Office Restroom	yes	W1	Wood	Black	Chipping	1	0.1	Negative	
2190	1	1	112D	Auditorium Stage Dressing Room - Classroom 100 Side	Yes	Ceiling	Plaster	Tan	Cracking	1	18.9	Positive	
2190	1	B	PTA4	PTA Lunchroom Storage Closet 4	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	1	112C	Auditorium Stage Dressing Room - Classroom 109 Side	Yes	Floor	Wood	Tan	Friction	5	6.7	Positive	
2190	1	1	112C	Auditorium Stage Dressing Room - Classroom 109 Side	Yes	W3	Metal	Gray	Chipping	3	1.7	Positive	
2190	1	1	110A	Principal's Office Restroom	yes	W2	Wood	Black	Chipping	1	0.03	Negative	
2190	1	1	112C	Auditorium Stage Dressing Room - Classroom 109 Side	Yes	W1	Wood	Tan	Friction	2	14.1	Positive	
2190	1	1	112C	Auditorium Stage Dressing Room - Classroom 109 Side	Yes	W2	Wood	Tan	Friction	2	7.8	Positive	
2190	1	1	110A	Principal's Office Restroom	yes	W3	Wood	Black	Chipping	1	0.1	Negative	
2190	1	1	112C	Auditorium Stage Dressing Room - Classroom 109 Side	Yes	Ceiling	Wood	Tan	Cracking	3	7.4	Positive	
2190	1	1	112C	Auditorium Stage Dressing Room - Classroom 109 Side	Yes	W1	Plaster	Tan	Cracking	1	23.1	Positive	
2190	1	1	110A	Principal's Office Restroom	yes	W4	Wood	Black	Chipping	1	0.02	Negative	
2190	1	1	112C	Auditorium Stage Dressing Room - Classroom 109 Side	Yes	W2	Plaster	Tan	Cracking	3	21.2	Positive	
2190	1	1	112C	Auditorium Stage Dressing Room - Classroom 109 Side	Yes	W3	Plaster	Tan	Cracking	1	17.9	Positive	
2190	1	B	PTA	Lunch Room	Yes	W4	Plaster	Mural	None	0	0.3	Negative	
2190	1	1	110	Principal's Office	Yes	W1	Wood	Black	None	0	N/A	N/A	
2190	1	B	PTA	Lunch Room	Yes	Ceiling	Plaster	White	None	0	N/A	N/A	
2190	1	1	110	Principal's Office	Yes	W2	Wood	Black	None	0	N/A	N/A	
2190	1	B	PTA	Lunch Room	Yes	Floor	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	B	PTA1	PTA Lunchroom Storage Closet 1	Yes	W1	Plaster	Tan	None	0	N/A	N/A	
2190	1	1	112C	Auditorium Stage Dressing Room - Classroom 109 Side	Yes	W4	Plaster	Tan	Cracking	6	18.9	Positive	
2190	1	1	112C	Auditorium Stage Dressing Room - Classroom 109 Side	Yes	Ceiling	Plaster	Tan	Flaking	6	19.2	Positive	
2190	1	1	110	Principal's Office	Yes	W3	Wood	Black	None	0	N/A	N/A	
2190	1	1	106B	Boy's Restroom	Yes	W4	Metal	Grey	Chipping	3	4.5	Positive	

				Inspection Dates: 09/21/20-09/29/20			Lead Safe Certification Assessment Report						
				Name of Inspector: Michael Barth			Fell Elementary School						
				Inspection Company: Criterion Labs									
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)	
2190	1	B	PTA1	PTA Lunchroom Storage Closet 1	Yes	Ceiling	Plaster	Tan	Partially Inaccessible	N/A	N/A	N/A	
2190	1	1	110	Principal's Office	Yes	W4	Wood	Black	None	0	N/A	N/A	
2190	1	B	PTA1	PTA Lunchroom Storage Closet 1	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	1	106B	Boy's Restroom	Yes	W1	Plaster	White	Cracking	3	21.3	Positive	
2190	1	1	106B	Boy's Restroom	Yes	W2	Plaster	White	Cracking	5	22.4	Positive	
2190	1	1	106B	Boy's Restroom	Yes	W3	Plaster	White	Moisture Damage	5	25.1	Positive	
2190	1	1	106B	Boy's Restroom	Yes	W4	Plaster	White	Cracking	5	22.1	Positive	
2190	1	1	106B	Boy's Restroom	Yes	Ceiling	Plaster	White	Moisture Damage/Flaking	15	21.4	Positive	
2190	1	B	PTA2	PTA Lunchroom Storage Closet 2	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	B	40	Boy's Restroom beside Speech Classroom	Yes	Ceiling	Plaster	White	Moisture Damage	3	19.2	Positive	
2190	1	B	40	Boy's Restroom beside Speech Classroom	Yes	W1	Brick	White	Cracking	1	24.5	Positive	
2190	1	B	40	Boy's Restroom beside Speech Classroom	Yes	W2	Brick	White	Cracking	1	21.2	Positive	
2190	1	B	40	Boy's Restroom beside Speech Classroom	Yes	W3	Brick	White	Moisture Damage	3	22.4	Positive	
2190	1	B	39	Building Engineer's Restroom beside Boy's Restroom	Yes	W2	Plaster	White	Moisture Damage/Chipping	3	21.3	Positive	
2190	1	1	111	Main Office	Yes	W1	Wood	Black	Chipping	1	0.1	Negative	
2190	1	B	H03	Hallway outside of PTA Cafeteria and Girls Restroom	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	1	111	Main Office	Yes	W2	Wood	Black	Chipping	1	0.03	Negative	
2190	1	B	39	Building Engineer's Restroom beside Boy's Restroom	Yes	Ceiling	Plaster	White	Flaking	3	21.3	Positive	
2190	1	B	39	Building Engineer's Restroom beside Boy's Restroom	Yes	W1	Brick	White	Cracking	1	24.4	Positive	
2190	1	B	39	Building Engineer's Restroom beside Boy's Restroom	Yes	W3	Brick	White	Cracking	3	22.1	Positive	
2190	1	B	S05	Stairwell beside Cafeteria B	Yes	Ceiling	Plaster	White	None	0	N/A	N/A	
2190	1	B	S05	Stairwell beside Cafeteria B	Yes	Floor	Concrete	N/A	N/A	0	N/A	N/A	
2190	1	B	S05	Stairwell beside Cafeteria B	Yes	Floor	Concrete	Grey	None	0	N/A	N/A	
2190	1	B	39	Building Engineer's Restroom beside Boy's Restroom	Yes	W4	Brick	White	Cracking	1	23.5	Positive	
2190	1	B	36	Building Engineers Office (accessed from Gymnasium)	Yes	Ceiling	Metal	Tan	Chipping	2	12.3	Positive	
2190	1	1	111	Main Office	Yes	W3	Wood	Black	Chipping	1	0.01	Negative	
2190	1	2	H28	Center Hallway	Yes	Floor	Concrete	Grey	Friction	10	4	Positive	
2190	1	1	111	Main Office	Yes	W4	Wood	Black	Chipping	1	0.04	Negative	
2190	1	2	H28	Center Hallway	Yes	W1	Plaster	Red/Yellow	Cracking	5	21.3	Positive	

				Inspection Dates: 09/21/20-09/29/20			Lead Safe Certification Assessment Report						
				Name of Inspector: Michael Barth			Fell Elementary School						
				Inspection Company: Criterion Labs									
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)	
2190	1	1	S15	Stairwell beside Classroom 102	Yes	W1	Metal	Blue	Friction	1	0.21	Negative	
2190	1	2	H28	Center Hallway	Yes	W3	Plaster	Red/Yellow	Chipping	5	23.1	Positive	
2190	1	B	S05A	Visitors Entrance Foyer to Northeast Stairwell beside Cafeteria B	Yes	Ceiling	Plaster	Blue	None	0	N/A	N/A	
2190	1	B	S05A	Visitors Entrance Foyer to Northeast Stairwell beside Cafeteria B	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	B	30	Boiler Room	No	W1	Brick	Blue	Cracking	25	21.2	Positive	
2190	1	B	30	Boiler Room	No	W2	Brick	Blue	Cracking	20	23.2	Positive	
2190	1	B	30	Boiler Room	No	W3	Brick	Blue	Cracking	30	26.1	Positive	
2190	1	B	30	Boiler Room	No	W4	Brick	Blue	Cracking	30	22.1	Positive	
2190	1	B	30	Boiler Room	No	Ceiling	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	B	30	Boiler Room	No	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	1	H15	Center Hallway between Classrooms 103 - 106	Yes	Floor	Concrete	Grey	Friction	10	3.4	Positive	
2190	1	B	H02	Hallway outside of Cafeteria B	Yes	W2	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	1	H15	Center Hallway between Classrooms 103 - 106	Yes	W3	Metal	Gray	Chipping	1	1.8	Positive	
2190	1	1	H15	Center Hallway between Classrooms 103 - 106	Yes	Ceiling	Metal	Tan	Chipping	1	5.4	Positive	
2190	1	1	H15	Center Hallway between Classrooms 103 - 106	Yes	W1	Plaster	Red	Cracking	2	21.4	Positive	
2190	1	1	S11	Stairwell beside Classroom 107	Yes	W3	Metal	Blue	Friction	1	0.21	Negative	
2190	1	B	H02	Hallway outside of Cafeteria B	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	B	B1	Kitchen Storage Room 1	No	W1	Plaster	Tan	None	0	25.3	Positive	
2190	1	B	B1	Kitchen Storage Room 1	No	W2	Plaster	Tan	Cracking	2	21.5	Positive	
2190	1	B	B1	Kitchen Storage Room 1	No	W3	Plaster	Tan	Cracking	1	24.3	Positive	
2190	1	B	B1	Kitchen Storage Room 1	No	W4	Plaster	Tan	Cracking	2	22.7	Positive	
2190	1	B	B1	Kitchen Storage Room 1	No	Ceiling	Plaster	Tan	None	0	N/A	N/A	
2190	1	1	S12	Stairwell across from 109	Yes	W1	Metal	Blue	Friction	1	0.2	Negative	
2190	1	B	B1	Kitchen Storage Room 1	No	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	B	B2	Kitchen Storage Room 2	No	W1	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	B	B2	Kitchen Storage Room 2	No	W2	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	B	B2	Kitchen Storage Room 2	No	W3	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	B	B2	Kitchen Storage Room 2	No	W4	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	B	B2	Kitchen Storage Room 2	No	Ceiling	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	B	B2	Kitchen Storage Room 2	No	Floor	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	B	B3	Kitchen Storage Room 3	Yes	W1	Plaster	Tan	None	0	21.2	Positive	
2190	1	B	B3	Kitchen Storage Room 3	Yes	W2	Plaster	Tan	None	0	22.4	Positive	

				Inspection Dates: 09/21/20-09/29/20									
				Name of Inspector: Michael Barth			Lead Safe Certification Assessment Report						
				Inspection Company: Criterion Labs			Fell Elementary School						
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)	
2190	1	B	B3	Kitchen Storage Room 3	Yes	W3	Plaster	Tan	None	0	24.1	Positive	
2190	1	1	107A	Women's Restroom	Yes	W2	Metal	Blue	None	0	0.3	Negative	
2190	1	B	B3	Kitchen Storage Room 3	Yes	W4	Plaster	Tan	None	0	23.2	Positive	
2190	1	1	S10	Stairwell outside of Main Office	Yes	W3	Metal	Brown	Friction	1	0.1	Negative	
2190	1	B	B3	Kitchen Storage Room 3	Yes	Ceiling	Plaster	Tan	None	0	N/A	N/A	
2190	1	B	B3	Kitchen Storage Room 3	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	1	H15	Center Hallway between Classrooms 103 - 106	Yes	W1	Plaster	Yellow	Flaking	5	22.7	Positive	
2190	1	B	B4	Kitchen Serving Line	No	W2	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	1	H15	Center Hallway between Classrooms 103 - 106	Yes	W3	Plaster	Red	Cracking	3	21.4	Positive	
2190	1	1	100	Classroom 100	Yes	W3	Plaster	Tan	Chipping	3	21.2	Positive	
2190	1	B	B4	Kitchen Serving Line	No	Ceiling	Concrete	Tan	None	0	N/A	N/A	
2190	1	B	B4	Kitchen Serving Line	No	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	1	101	Classroom 101	Yes	W3	Metal	Grey	Chipping	5	1.5	Positive	
2190	1	1	102	Classroom 102	Yes	W2	Plaster	Tan	Cracking	1	22.3	Positive	
2190	1	1	102	Classroom 102	Yes	W3	Plaster	Tan	Chipping	2	24.1	Positive	
2190	1	1	102	Classroom 102	Yes	W4	Plaster	Tan	Cracking	5	19.8	Positive	
2190	1	1	103	Classroom 103	Yes	W3	Metal	Grey	Chipping	3	1.6	Positive	
2190	1	1	112	Auditorium	Yes	W2	Metal	Brown	Friction	2	0.2	Negative	
2190	1	B	34	Gymnasium	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	B	31	Gas Main/Storage	No	W1	Brick	Blue	Cracking	20	21.3	Positive	
2190	1	B	31	Gas Main/Storage	No	W2	Brick	Blue	Cracking	15	29.6	Positive	
2190	1	B	31	Gas Main/Storage	No	W3	Brick	Blue	Cracking	10	32.1	Positive	
2190	1	B	31	Gas Main/Storage	No	W4	Brick	Blue	Cracking	20	15.6	Positive	
2190	1	B	31	Gas Main/Storage	No	Ceiling	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	B	31	Gas Main/Storage	No	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	B	32	Emergency Generator/Storage	No	W1	Brick	Blue	Cracking	15	19.6	Positive	
2190	1	B	32	Emergency Generator/Storage	No	W2	Brick	Blue	Cracking	15	21.3	Positive	
2190	1	B	32	Emergency Generator/Storage	No	W3	Brick	Blue	Cracking	20	25.4	Positive	
2190	1	B	32	Emergency Generator/Storage	No	W4	Brick	Blue	Cracking	10	21.2	Positive	
2190	1	B	32	Emergency Generator/Storage	No	Ceiling	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	B	32	Emergency Generator/Storage	No	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	B	33	Fan Room	No	W1	Brick	Blue	Cracking	12	26.5	Positive	
2190	1	B	33	Fan Room	No	W2	Brick	Blue	Cracking	15	24.3	Positive	
2190	1	B	33	Fan Room	No	W3	Brick	Blue	Cracking	10	26.1	Positive	
2190	1	B	33	Fan Room	No	W4	Brick	Blue	Cracking	10	21.2	Positive	
2190	1	B	33	Fan Room	No	Ceiling	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	B	33	Fan Room	No	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	B	38	Gymnasium Storage	Yes	W1	Brick	White	Partially Inaccessible	0	21.3	Positive	
2190	1	B	38	Gymnasium Storage	Yes	W2	Brick	White	Partially Inaccessible	0	N/A	N/A	

				Inspection Dates: 09/21/20-09/29/20								
				Name of Inspector: Michael Barth		Lead Safe Certification Assessment Report						
				Inspection Company: Criterion Labs		Fell Elementary School						
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)
2190	1	B	38	Gymnasium Storage	Yes	W3	Brick	White	Partially Inaccessible	0	18.9	Positive
2190	1	B	38	Gymnasium Storage	Yes	W4	Brick	White	Partially Inaccessible	0	21.7	Positive
2190	1	B	38	Gymnasium Storage	Yes	Ceiling	Plaster	White	Partially Inaccessible	0	22.8	Positive
2190	1	1	112	Auditorium	Yes	W3	Metal	Brown	Friction	2	0.2	Negative
2190	1	B	38	Gymnasium Storage	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A
2190	1	B	S04	Fire Stair Tower	Yes	W1	Brick	White	None	0	24.7	Positive
2190	1	1	103A	Classroom 103 Coat Closet	Yes	W2	Plaster	Tan	Cracking	2	22.1	Positive
2190	1	B	S04	Fire Stair Tower	Yes	W3	Brick	White	None	0	23.2	Positive
2190	1	B	S04	Fire Stair Tower	Yes	W4	Brick	White	None	0	20.2	Positive
2190	1	1	103A	Classroom 103 Coat Closet	Yes	W4	Plaster	Tan	Chipping	2	21.2	Positive
2190	1	B	S04	Fire Stair Tower	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A
2190	1	1	104	Classroom 104	Yes	W3	Metal	Grey	Chipping	5	1.8	Positive
2190	1	1	104	Classroom 104	Yes	W3	Plaster	Tan	Cracking	2	21.3	Positive
2190	1	1	104A	Classroom 104 Coat Closet	Yes	W3	Metal	Tan	Chipping	1	4.5	Positive
2190	1	1	104A	Classroom 104 Coat Closet	Yes	W2	Plaster	Tan	Cracking	2	23.2	Positive
2190	1	1	104A	Classroom 104 Coat Closet	Yes	W4	Plaster	Tan	Alligatoring/Cracking	8	27.4	Positive
2190	1	1	101B	Counselor	yes	W1	Wood	Brown	Chipping	2	0.06	Negative
2190	1	B	37	Gymnasium Office	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A
2190	1	B	36	Building Engineers Office (accessed from Gymnasium)	Yes	W1	Brick	White	None	0	N/A	N/A
2190	1	B	36	Building Engineers Office (accessed from Gymnasium)	Yes	W2	Brick	White	None	0	N/A	N/A
2190	1	B	36	Building Engineers Office (accessed from Gymnasium)	Yes	W3	Brick	White	None	0	N/A	N/A
2190	1	B	36	Building Engineers Office (accessed from Gymnasium)	Yes	W4	Brick	White	None	0	N/A	N/A
2190	1	B	36	Building Engineers Office (accessed from Gymnasium)	Yes	Ceiling	Plaster	White	None	0	N/A	N/A
2190	1	1	101B	Counselor	yes	W2	Wood	Brown	Chipping	1	0	Negative
2190	1	B	36	Building Engineers Office (accessed from Gymnasium)	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A
2190	1	B	S02	Stairwell and Foyer beside Boy's Restroom	Yes	W1	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	1	105	Classroom 105	Yes	W3	Metal	Grey	Chipping	3	1.8	Positive
2190	1	1	105	Classroom 105	Yes	W1	Plaster	Tan	Cracking	1	23.7	Positive
2190	1	1	101B	Counselor	yes	W3	Wood	Brown	Chipping	1	0.03	Negative
2190	1	1	105	Classroom 105	Yes	W3	Plaster	Tan	Chipping	5	22.4	Positive
2190	1	B	S02	Stairwell and Foyer beside Boy's Restroom	Yes	Ceiling	Plaster	White	None	0	N/A	N/A
2190	1	B	S02	Stairwell and Foyer beside Boy's Restroom	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A

				Inspection Dates: 09/21/20-09/29/20		Lead Safe Certification Assessment Report						
				Name of Inspector: Michael Barth		Fell Elementary School						
				Inspection Company: Criterion Labs								
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)
2190	1	B	S02	Stairwell and Foyer beside Boy's Restroom	Yes	Floor	Concrete	Grey	None	0	3.9	Positive
2190	1	B	S02	Stairwell and Foyer beside Boy's Restroom	Yes	Floor	Concrete	Grey	Friction	2	0.2	Negative
2190	1	1	106	Classroom 106	Yes	W3	Metal	Grey	Chipping	5	1.4	Positive
2190	1	1	106	Classroom 106	Yes	W1	Plaster	Tan	Chipping	1	23.1	Positive
2190	1	1	106	Classroom 106	Yes	W2	Plaster	Tan	Cracking	3	22.7	Positive
2190	1	B	40	Boy's Restroom beside Speech Classroom	Yes	W4	Brick	White	None	0	23.5	Positive
2190	1	1	106	Classroom 106	Yes	W3	Plaster	Tan	Cracking	6	21.3	Positive
2190	1	B	40	Boy's Restroom beside Speech Classroom	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A
2190	1	1	106A	Classroom 106 Coat Closet	Yes	W1	Plaster	Tan	Cracking	5	21.5	Positive
2190	1	1	106A	Classroom 106 Coat Closet	Yes	W2	Plaster	Tan	Cracking	10	21.2	Positive
2190	1	1	106A	Classroom 106 Coat Closet	Yes	W4	Plaster	Tan	Cracking	10	23.4	Positive
2190	1	1	107	Classroom 107	Yes	W1	Plaster	Tan	Cracking	1	21.4	Positive
2190	1	1	107	Classroom 107	Yes	W3	Plaster	Tan	Flaking	15	21.7	Positive
2190	1	B	39	Building Engineer's Restroom beside Boy's Restroom	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A
2190	1	1	107	Classroom 107	Yes	W4	Plaster	Tan	Chipping	1	24.5	Positive
2190	1	1	107A	Classroom 107 Coat Closet	Yes	W4	Plaster	Green	Cracking	10	21.4	Positive
2190	1	1	107A	Classroom 107 Coat Closet	Yes	W4	Plaster	Blue	Chipping	1	23.4	Positive
2190	1	1	107B	Classroom 107 Restroom	Yes	W1	Plaster	Tan	Cracking	1	19.1	Positive
2190	1	1	107B	Classroom 107 Restroom	Yes	W2	Plaster	Tan	Cracking	2	23.1	Positive
2190	1	1	101B	Counselor	yes	W4	Wood	Brown	Chipping	1	0.01	Negative
2190	1	B	H01	Hallway outside Rooms 1-3	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A
2190	1	1	107B	Classroom 107 Restroom	Yes	W4	Plaster	Tan	Chipping	1	21.2	Positive
2190	1	1	108	Classroom 108	Yes	W3	Plaster	Tan	Moisture Damage	3	23.6	Positive
2190	1	1	108A	Classroom 108 Coat Closet	Yes	W2	Plaster	Tan	Cracking	6	22.1	Positive
2190	1	1	108A	Classroom 108 Coat Closet	Yes	W4	Plaster	Tan	Cracking	10	29.1	Positive
2190	1	1	109	Classroom 109	Yes	W1	Plaster	Tan	Chipping	3	17.8	Positive
2190	1	B	RM1	Speech	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A
2190	1	1	109	Classroom 109	Yes	W2	Plaster	Tan	Partially Inaccessible/Cracking	5	22.1	Positive
2190	1	1	109	Classroom 109	Yes	W3	Plaster	Tan	Cracking	3	24.5	Positive
2190	1	1	109	Classroom 109	Yes	W4	Plaster	Tan	Chipping	2	21.1	Positive
2190	1	1	109A	Classroom 109 Coat Closet	Yes	W2	Metal	Tan	Flaking	3	5.4	Positive
2190	1	B	1A	RM1 Storage Closet	Yes	Ceiling	Plaster	Tan	None	0	N/A	N/A
2190	1	1	109A	Classroom 109 Coat Closet	Yes	W1	Plaster	Tan	Cracking	2	21.3	Positive
2190	1	B	1A	RM1 Storage Closet	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A
2190	1	1	109A	Classroom 109 Coat Closet	Yes	W3	Plaster	Tan	Cracking/Flaking	10	23.5	Positive

				Inspection Dates: 09/21/20-09/29/20			Lead Safe Certification Assessment Report						
				Name of Inspector: Michael Barth			Fell Elementary School						
				Inspection Company: Criterion Labs									
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)	
2190	1	1	109A	Classroom 109 Coat Closet	Yes	W4	Plaster	Tan	Cracking	8	24.7	Positive	
2190	1	B	RM2	Music Room	Yes	W2	Brick	Tan	None	0	18.7	Positive	
2190	1	2	200	Classroom 200	Yes	W1	Plaster	Tan	Cracking/Flaking	15	21.4	Positive	
2190	1	2	200	Classroom 200	Yes	W2	Plaster	Tan	Cracking/Flaking	20	22.5	Positive	
2190	1	2	200	Classroom 200	Yes	W3	Plaster	Tan	Cracking	10	26.7	Positive	
2190	1	2	200	Classroom 200	Yes	W3	Plaster	White	Flaking	15	23.2	Positive	
2190	1	B	RM2	Music Room	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	B	2A	RM2 Storage Closet A	Yes	W1	Plaster	Tan	None	0	18.9	Positive	
2190	1	B	2A	RM2 Storage Closet A	Yes	W2	Plaster	Tan	None	0	24.6	Positive	
2190	1	B	2A	RM2 Storage Closet A	Yes	W3	Plaster	Tan	None	0	23.2	Positive	
2190	1	B	2A	RM2 Storage Closet A	Yes	W4	Plaster	Tan	None	0	22.7	Positive	
2190	1	B	2A	RM2 Storage Closet A	Yes	Ceiling	Plaster	Tan	None	0	21.2	Positive	
2190	1	2	200	Classroom 200	Yes	W4	Plaster	Tan	Cracking/flaking	20	24.1	Positive	
2190	1	1	H15	Center Hallway between Classrooms 103 - 106	Yes	W1	Metal	Gray	Chipping	1	0.1	Negative	
2190	1	2	200	Classroom 200	Yes	W4	Plaster	White	Chipping	3	26.3	Positive	
2190	1	2	200	Classroom 200	Yes	W4	Wood	Tan	Chipping	1	12.2	Positive	
2190	1	2	200A	Classroom 200 Coat Closet	Yes	W3	Metal	Grey	Chipping	2	1.7	Positive	
2190	1	2	200A	Classroom 200 Coat Closet	Yes	W1	Plaster	Tan	Cracking	3	24.6	Positive	
2190	1	2	200A	Classroom 200 Coat Closet	Yes	W2	Plaster	Tan	Cracking/Partially Inaccessible	5	21.3	Positive	
2190	1	1	H15	Center Hallway between Classrooms 103 - 106	Yes	W3	Metal	Gray	Chipping	1	0.21	Negative	
2190	1	2	200A	Classroom 200 Coat Closet	Yes	W3	Plaster	Tan	Flaking	8	23.1	Positive	
2190	1	2	200A	Classroom 200 Coat Closet	Yes	W4	Plaster	Tan	Cracking/Partially Inaccessible	5	19.2	Positive	
2190	1	2	201	Classroom 201	Yes	W3	Metal	Grey	Chipping	6	1.7	Positive	
2190	1	2	201	Classroom 201	Yes	W1	Plaster	Tan	Chipping	1	24.1	Positive	
2190	1	2	201	Classroom 201	Yes	W3	Plaster	Tan	Cracking	8	23.6	Positive	
2190	1	B	RM3	Facilities Storage (former classroom)	Yes	Floor	Concrete	Blue	Friction	15	0.2	Negative	
2190	1	2	201	Classroom 201	Yes	W4	Plaster	Tan	Flaking	2	26.1	Positive	
2190	1	2	201A	Classroom 201 Coat Closet	Yes	W1	Plaster	Tan	Cracking/Alligatoring	5	24.1	Positive	
2190	1	2	201A	Classroom 201 Coat Closet	Yes	W2	Plaster	Tan	Flaking	10	23.3	Positive	
2190	1	2	201A	Classroom 201 Coat Closet	Yes	W4	Plaster	Tan	Cracking/Alligatoring	12	21.3	Positive	
2190	1	2	202	Classroom 202	Yes	W1	Plaster	Tan	Cracking	3	24.2	Positive	
2190	1	B	3A	RM3 Storage Closet A	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	2	202	Classroom 202	Yes	W2	Plaster	Tan	Cracking	1	23.4	Positive	
2190	1	2	202	Classroom 202	Yes	W3	Plaster	Tan	Chipping	10	22.3	Positive	
2190	1	2	202	Classroom 202	Yes	W2	Wood	Tan	Cracking	1	12.4	Positive	
2190	1	2	202	Classroom 202	Yes	W3	Wood	Tan	Cracking	1	11.5	Positive	

				Inspection Dates: 09/21/20-09/29/20								
				Name of Inspector: Michael Barth		Lead Safe Certification Assessment Report						
				Inspection Company: Criterion Labs		Fell Elementary School						
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)
2190	1	B	S01	Stairwell beside Basement Facilities Storage Room	Yes	Ceiling	Plaster	White	None	0	N/A	N/A
2190	1	B	S01	Stairwell beside Basement Facilities Storage Room	Yes	Floor	Concrete	N/A	N/A	0	N/A	N/A
2190	1	B	S01	Stairwell beside Basement Facilities Storage Room	Yes	Floor	Concrete	Grey	None	0	N/A	N/A
2190	1	2	203	Classroom 203	Yes	W3	Metal	Grey	Chipping	1	1.8	Positive
2190	1	2	203	Classroom 203	Yes	W1	Plaster	Tan	Cracking	15	22.3	Positive
2190	1	1	107A	Classroom 107 Coat Closet	Yes	W3	Metal	Green	None	0	0.22	Negative
2190	1	2	203	Classroom 203	Yes	W3	Plaster	Tan	Cracking	15	21.4	Positive
2190	1	1	100	Classroom 100	Yes	W3	Metal	Grey	Chipping	1	0.21	Negative
2190	1	B	S01A	Northwest Stairwell Entrance Vestibule beside Room 3	Yes	W3	Plaster	Blue	None	0	N/A	N/A
2190	1	2	203	Classroom 203	Yes	W3	Plaster	White	Chipping	1	22.5	Positive
2190	1	B	S01A	Northwest Stairwell Entrance Vestibule beside Room 3	Yes	W4	Plaster	Blue	None	0	N/A	N/A
2190	1	B	S01A	Northwest Stairwell Entrance Vestibule beside Room 3	Yes	Ceiling	Plaster	Blue	Partially Inaccessible	0	N/A	N/A
2190	1	B	S01A	Northwest Stairwell Entrance Vestibule beside Room 3	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A
2190	1	1	100	Classroom 100	Yes	W1	Plaster	Tan	None	0	23.1	Positive
2190	1	1	100	Classroom 100	Yes	W2	Plaster	Tan	None	0	24.1	Positive
2190	1	2	203	Classroom 203	Yes	W4	Plaster	Tan	Cracking	15	24.5	Positive
2190	1	2	203	Classroom 203	Yes	W4	Plaster	White	Cracking	1	22.6	Positive
2190	1	1	100	Classroom 100	Yes	W4	Plaster	Tan	None	0	24.1	Positive
2190	1	1	100	Classroom 100	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	1	102	Classroom 102	Yes	W3	Metal	Grey	Chipping	3	0.3	Negative
2190	1	1	100A	Classroom 100 Coat Closet	Yes	W1	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	1	100A	Classroom 100 Coat Closet	Yes	W2	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	1	100A	Classroom 100 Coat Closet	Yes	W3	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	1	100A	Classroom 100 Coat Closet	Yes	W4	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	1	100A	Classroom 100 Coat Closet	Yes	Ceiling	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	1	100A	Classroom 100 Coat Closet	Yes	Floor	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	1	100B	Classroom 100 Restroom	Yes	W1	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	1	100B	Classroom 100 Restroom	Yes	W2	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	1	100B	Classroom 100 Restroom	Yes	W3	No Access	No Access	No Access	No Access	No Access	No Access

				Inspection Dates: 09/21/20-09/29/20		Lead Safe Certification Assessment Report						
				Name of Inspector: Michael Barth		Fell Elementary School						
				Inspection Company: Criterion Labs								
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)
2190	1	1	100B	Classroom 100 Restroom	Yes	W4	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	1	100B	Classroom 100 Restroom	Yes	Ceiling	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	1	100B	Classroom 100 Restroom	Yes	Floor	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	2	204	Classroom 204	Yes	W3	Metal	Gray	Chipping	8	1.8	Positive
2190	1	1	100C	Women's Restroom	Yes	W2	Plaster	Tan	None	0	24.1	Positive
2190	1	2	204	Classroom 204	Yes	W3	Plaster	Tan	Chipping	1	23.4	Positive
2190	1	2	206B	Classroom 206 Closet B	Yes	W4	Plaster	White	Cracking	1	23.2	Positive
2190	1	1	100C	Women's Restroom	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	1	100C	Women's Restroom	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A
2190	1	1	S10	Stairwell outside of Main Office	Yes	W1	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	2	207	Classroom 207	Yes	W1	Plaster	Tan	Flaking	10	22.1	Positive
2190	1	2	207	Classroom 207	Yes	W2	Plaster	Tan	Cracking	5	23.2	Positive
2190	1	2	207	Classroom 207	Yes	W3	Plaster	Tan	Cracking	3	24.6	Positive
2190	1	1	S10	Stairwell outside of Main Office	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	1	S10	Stairwell outside of Main Office	Yes	Floor	Concrete	N/A	N/A	0	N/A	N/A
2190	1	1	S10	Stairwell outside of Main Office	Yes	Floor	Concrete	Grey	None	0	0.11	Negative
2190	1	2	207	Classroom 207	Yes	W3	Wood	Tan	Chipping	1	12.4	Positive
2190	1	2	207	Classroom 207	Yes	W3	Wood	Tan	Chipping	1	9.6	Positive
2190	1	2	207A	Classroom 207 Coat Closet	Yes	W1	Plaster	White	Cracking	5	22.3	Positive
2190	1	1	H16	East Hallway	Yes	W2	Plaster	Yellow	None	0	23.4	Negative
2190	1	1	H16	East Hallway	Yes	W3	Plaster	Red	None	0	25.7	Positive
2190	1	1	H16	East Hallway	Yes	W3	Plaster	Yellow	None	0	22.3	Positive
2190	1	2	207A	Classroom 207 Coat Closet	Yes	W2	Plaster	White	Cracking	15	21.7	Positive
2190	1	1	H16	East Hallway	Yes	W4	Plaster	Yellow	None	0	24.1	Positive
2190	1	1	H16	East Hallway	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	1	H16	East Hallway	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A
2190	1	2	207A	Classroom 207 Coat Closet	Yes	W3	Plaster	White	Partially Inaccessible/Cracking	3	21.2	Positive
2190	1	1	101	Classroom 101	Yes	W1	Plaster	Tan	None	0	21.2	Positive
2190	1	1	101	Classroom 101	Yes	W2	Plaster	Tan	None	0	22.3	Positive
2190	1	1	101	Classroom 101	Yes	W3	Plaster	Tan	None	0	24.1	Positive
2190	1	2	207A	Classroom 207 Coat Closet	Yes	W4	Plaster	White	Cracking/Chipping	10	22.3	Positive
2190	1	1	101	Classroom 101	Yes	W4	Plaster	Tan	None	0	23.4	Positive
2190	1	1	101	Classroom 101	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	2	208	Classroom 208	Yes	W3	Metal	Grey	Chipping	5	2.4	Positive
2190	1	1	101A	Classroom 101 Coat Closet	Yes	W1	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	1	101A	Classroom 101 Coat Closet	Yes	W2	No Access	No Access	No Access	No Access	No Access	No Access

				Inspection Dates: 09/21/20-09/29/20								
				Name of Inspector: Michael Barth		Lead Safe Certification Assessment Report						
				Inspection Company: Criterion Labs		Fell Elementary School						
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)
2190	1	1	101A	Classroom 101 Coat Closet	Yes	W3	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	1	101A	Classroom 101 Coat Closet	Yes	W4	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	1	101A	Classroom 101 Coat Closet	Yes	Ceiling	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	1	101A	Classroom 101 Coat Closet	Yes	Floor	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	1	101B	Counselor	Yes	W1	Plaster	Tan	None	0	26.5	Positive
2190	1	2	208	Classroom 208	Yes	W2	Plaster	Tan	Chipping	2	22.1	Positive
2190	1	2	208	Classroom 208	Yes	W3	Plaster	Tan	Chipping	2	24.7	Positive
2190	1	2	208	Classroom 208	Yes	W4	Plaster	Tan	Chipping	3	18.9	Positive
2190	1	2	208A	Classroom 208 Coat Closet	Yes	W1	Plaster	Tan	Flaking	1	24.1	Positive
2190	1	1	108	Classroom 108	Yes	W3	Metal	Grey	None	0	N/A	N/A
2190	1	1	109	Classroom 109	Yes	W2	Metal	Grey	Partially Inaccessible	N/A	N/A	N/A
2190	1	1	101B	Counselor	yes	W4	Plaster	Tan	None	0	23.2	Positive
2190	1	1	109	Classroom 109	Yes	W3	Metal	Grey	Partially Inaccessible	N/A	N/A	N/A
2190	1	1	101B	Counselor	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	2	208A	Classroom 208 Coat Closet	Yes	W2	Plaster	Tan	Flaking	5	22	Positive
2190	1	1	102	Classroom 102	Yes	W1	Plaster	Tan	None	0	21.2	Positive
2190	1	2	208A	Classroom 208 Coat Closet	Yes	W3	Plaster	Tan	Chipping	1	21.5	Positive
2190	1	2	208A	Classroom 208 Coat Closet	Yes	W4	Plaster	Tan	Flaking	6	23.2	Positive
2190	1	2	209	Classroom 209	Yes	W1	Plaster	Tan	Cracking	3	22.7	Positive
2190	1	2	209	Classroom 209	Yes	W2	Plaster	Tan	Chipping	5	21.4	Positive
2190	1	1	102	Classroom 102	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	1	112D	Auditorium Stage Dressing Room - Classroom 100 Side	Yes	W3	Metal	Grey	None	0	1.6	Positive
2190	1	1	102	Classroom 102 closet	Yes	W1	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	1	102	Classroom 102 closet	Yes	W2	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	1	102	Classroom 102 closet	Yes	W3	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	1	102	Classroom 102 closet	Yes	W4	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	1	102	Classroom 102 closet	Yes	Ceiling	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	1	102	Classroom 102 closet	Yes	Floor	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	1	102A	Classroom 102 Coat Closet	Yes	W1	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	1	102A	Classroom 102 Coat Closet	Yes	W2	No Access	No Access	No Access	No Access	No Access	No Access

				Inspection Dates: 09/21/20-09/29/20									
				Name of Inspector: Michael Barth			Lead Safe Certification Assessment Report						
				Inspection Company: Criterion Labs			Fell Elementary School						
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)	
2190	1	1	102A	Classroom 102 Coat Closet	Yes	W3	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	1	102A	Classroom 102 Coat Closet	Yes	W4	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	1	102A	Classroom 102 Coat Closet	Yes	Ceiling	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	1	102A	Classroom 102 Coat Closet	Yes	Floor	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	1	PC102A	Classroom 102 Coat Closet Pipe Chase	no	W1	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	1	PC102A	Classroom 102 Coat Closet Pipe Chase	no	W2	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	1	PC102A	Classroom 102 Coat Closet Pipe Chase	no	W3	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	1	PC102A	Classroom 102 Coat Closet Pipe Chase	no	W4	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	1	PC102A	Classroom 102 Coat Closet Pipe Chase	no	Ceiling	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	1	PC102A	Classroom 102 Coat Closet Pipe Chase	no	Floor	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	1	102B	Classroom 102 Restroom	Yes	W1	Plaster	Tan	None	0	21.4	Positive	
2190	1	1	102B	Classroom 102 Restroom	Yes	W2	Plaster	Tan	None	0	23.2	Positive	
2190	1	1	102B	Classroom 102 Restroom	Yes	W3	Plaster	Tan	None	0	24.2	Positive	
2190	1	1	102B	Classroom 102 Restroom	Yes	W4	Plaster	Tan	None	0	22.4	Positive	
2190	1	1	102B	Classroom 102 Restroom	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	1	109	Classroom 109	Yes	W4	Wood	Grey	None	0	0.03	Negative	
2190	1	2	209	Classroom 209	Yes	W3	Plaster	Tan	Cracking/Chipping	5	23.4	Positive	
2190	1	2	209	Classroom 209	Yes	W4	Plaster	Tan	Cracking	3	22.9	Positive	
2190	1	2	209	Classroom 209	Yes	W2	Wood	Tan	Chipping	1	12.2	Positive	
2190	1	2	209	Classroom 209	Yes	W3	Wood	Tan	Chipping	1	16.7	Positive	
2190	1	1	S15	Stairwell beside Classroom 102	Yes	Ceiling	Plaster	White	None	0	N/A	N/A	
2190	1	1	S15	Stairwell beside Classroom 102	Yes	Floor	Concrete	N/A	N/A	0	N/A	N/A	
2190	1	1	S15	Stairwell beside Classroom 102	Yes	Floor	Concrete	Grey	None	0	0.11	Negative	
2190	1	2	209A	Classroom 209 Coat Closet	Yes	W3	Plaster	White	Flaking	10	24.1	Positive	
2190	1	1	S18	Auditorium Entrance Stairwell across from Classroom 104	Yes	W1	Plaster	Tan	None	0	24.2	Positive	
2190	1	1	109A	Classroom 109 Coat Closet	Yes	W3	Metal	Grey	No Access	N/A	N/A	N/A	
2190	1	1	S18	Auditorium Entrance Stairwell across from Classroom 104	Yes	W2	Plaster	Tan	None	0	21.3	Positive	
2190	1	1	100	Classroom 100	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A	
2190	1	1	S18	Auditorium Entrance Stairwell across from Classroom 104	Yes	W3	Plaster	Tan	None	0	26.1	Positive	
2190	1	1	101	Classroom 101	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A	

				Inspection Dates: 09/21/20-09/29/20								
				Name of Inspector: Michael Barth		Lead Safe Certification Assessment Report						
				Inspection Company: Criterion Labs		Fell Elementary School						
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)
2190	1	1	S18	Auditorium Entrance Stairwell across from Classroom 104	Yes	W4	Plaster	Tan	None	0	21.4	Positive
2190	1	1	101B	Counselor	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A
2190	1	1	S18	Auditorium Entrance Stairwell across from Classroom 104	Yes	Ceiling	Plaster	White	Partially Inaccessible	N/A	N/A	N/A
2190	1	1	S18	Auditorium Entrance Stairwell across from Classroom 104	Yes	Floor	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	2	209A	Classroom 209 Coat Closet	Yes	W4	Plaster	White	Chipping	2	22.1	Positive
2190	1	1	102	Classroom 102	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A
2190	1	1	S19	Auditorium Entrance Stairwell across from Classroom 105	Yes	W2	Plaster	Tan	None	0	22.1	Positive
2190	1	1	102B	Classroom 102 Restroom	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A
2190	1	1	S19	Auditorium Entrance Stairwell across from Classroom 105	Yes	W3	Plaster	Tan	None	0	23.1	Positive
2190	1	1	103	Classroom 103	Yes	W2	Wood	N/A	N/A	N/A	N/A	N/A
2190	1	1	S19	Auditorium Entrance Stairwell across from Classroom 105	Yes	W4	Plaster	Tan	None	0	24.5	Positive
2190	1	1	103	Classroom 103	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A
2190	1	1	S19	Auditorium Entrance Stairwell across from Classroom 105	Yes	Ceiling	Plaster	White	Partially Inaccessible	N/A	N/A	N/A
2190	1	1	S19	Auditorium Entrance Stairwell across from Classroom 105	Yes	Floor	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	3	300	Classroom 300	Yes	W3	Wood	White	Chipping	2	1.6	Positive
2190	1	3	300	Classroom 300	Yes	W1	Plaster	White	Cracking	3	22.1	Positive
2190	1	1	104	Classroom 104	Yes	W2	Wood	N/A	N/A	N/A	N/A	N/A
2190	1	1	104	Classroom 104	Yes	W4	Wood	N/A	N/A	N/A	N/A	N/A
2190	1	1	104	Classroom 104	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A
2190	1	1	105	Classroom 105	Yes	W2	Wood	N/A	N/A	N/A	N/A	N/A
2190	1	3	300	Classroom 300	Yes	W4	Wood	White	Chipping	1	1.9	Positive
2190	1	1	105	Classroom 105	Yes	W4	Wood	N/A	N/A	N/A	N/A	N/A
2190	1	3	300	Classroom 300	Yes	W2	Plaster	White	Chipping	8	23.6	Positive
2190	1	3	300	Classroom 300	Yes	W3	Plaster	White	Moisture Damage/Chipping	18	24.1	Positive
2190	1	1	103B	Girl's Restroom	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A
2190	1	1	103	Classroom 103	Yes	W1	Plaster	Tan	None	0	24.1	Positive
2190	1	1	105	Classroom 105	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A
2190	1	1	103	Classroom 103	Yes	W3	Plaster	Tan	None	0	21.4	Positive
2190	1	1	106	Classroom 106	Yes	W4	Wood	N/A	N/A	N/A	N/A	N/A
2190	1	1	106	Classroom 106	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A
2190	1	1	103	Classroom 103	Yes	W4	Plaster	Tan	None	0	22.7	Positive
2190	1	1	103	Classroom 103	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	1	108	Classroom 108	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A
2190	1	1	104	Classroom 104	Yes	W1	Plaster	Tan	None	0	24.1	Positive

				Inspection Dates: 09/21/20-09/29/20									
				Name of Inspector: Michael Barth			Lead Safe Certification Assessment Report						
				Inspection Company: Criterion Labs			Fell Elementary School						
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)	
2190	1	1	109	Classroom 109	Yes	Ceiling	Wood	N/A	N/A	N/A	N/A	N/A	
2190	1	3	300	Classroom 300	Yes	W4	Plaster	White	Chipping	2	21.2	Positive	
2190	1	1	110	Principal's Office	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A	
2190	1	1	H16B	Principal's Office Hallway/Storage	yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A	
2190	1	1	104	Classroom 104	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	1	110B	Principals Office Closet	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A	
2190	1	3	301	Classroom 301	Yes	W1	Plaster	White	Cracking	10	24	Positive	
2190	1	1	112	Auditorium	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A	
2190	1	3	301	Classroom 301	Yes	W2	Plaster	White	Chipping	1	27.8	Positive	
2190	1	1	112B	Auditorium Stage	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A	
2190	1	1	112C	Auditorium Stage Dressing Room - Classroom 109 Side	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A	
2190	1	1	105	Classroom 105	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	1	112D	Auditorium Stage Dressing Room - Classroom 100 Side	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A	
2190	1	3	301	Classroom 301	Yes	W3	Plaster	White	Flaking	30	32.1	Positive	
2190	1	3	302	Classroom 302	Yes	W2	Wood	White	Chipping	1	1.8	Positive	
2190	1	3	302	Classroom 302	Yes	W3	Wood	White	Chipping	1	2.1	Positive	
2190	1	1	103A	Classroom 103 Coat Closet	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A	
2190	1	1	107A	Classroom 107 Coat Closet	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A	
2190	1	1	106	Classroom 106	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	1	108A	Classroom 108 Coat Closet	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A	
2190	1	3	302	Classroom 302	Yes	W1	Plaster	Tan	Cracking	3	27.1	Positive	
2190	1	3	302	Classroom 302	Yes	W2	Plaster	Tan	Cracking	5	22.5	Positive	
2190	1	1	109A	Classroom 109 Coat Closet	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A	
2190	1	3	302	Classroom 302	Yes	W3	Plaster	Tan	Chipping	8	31.2	Positive	
2190	1	1	S11	Stairwell beside Classroom 107	Yes	Ceiling	Plaster	White	None	0	N/A	N/A	
2190	1	1	S11	Stairwell beside Classroom 107	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	1	S11	Stairwell beside Classroom 107	Yes	Floor	Concrete	Grey	None	0	0.2	Negative	
2190	1	3	302	Classroom 302	Yes	W4	Plaster	Tan	Chipping	5	24.1	Positive	
2190	1	1	S18	Auditorium Entrance Stairwell across from Classroom 104	Yes	W3	Wood	Purple	Friction	3	0.2	Negative	
2190	1	3	303	Classroom 303	Yes	W1	Plaster	Tan	Cracking	2	22.1	Positive	
2190	1	3	303	Classroom 303	Yes	W3	Plaster	Tan	Cracking	5	23.4	Positive	
2190	1	3	303	Classroom 303	Yes	W4	Plaster	Tan	Cracking	2	22.7	Positive	
2190	1	1	S12	Stairwell across from 109	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	1	S12	Stairwell across from 109	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	1	S12	Stairwell across from 109	Yes	Floor	Concrete	Grey	None	0	0.1	N/A	
2190	1	3	304	Classroom 304	Yes	W3	Metal	Grey	Chipping	5	1.5	Positive	
2190	1	3	304	Classroom 304	Yes	W1	Plaster	Tan	Cracking	3	22.9	Positive	
2190	1	3	304	Classroom 304	Yes	W3	Plaster	Tan	Moisture Damage/Cracking	8	21.8	Positive	
2190	1	3	304A	Classroom 304 Coat Closet	Yes	W1	Plaster	Tan	Cracking	2	22.4	Positive	

				Inspection Dates: 09/21/20-09/29/20		Lead Safe Certification Assessment Report						
				Name of Inspector: Michael Barth		Fell Elementary School						
				Inspection Company: Criterion Labs								
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)
2190	1	1	S19	Auditorium Entrance Stairwell across from Classroom 105	Yes	W3	Wood	Purple	Friction	2	0.3	Negative
2190	1	1	106B	Boy's Restroom	Yes	W3	Plastic	Grey	Flaking	5	0.1	Negative
2190	1	3	304A	Classroom 304 Coat Closet	Yes	W2	Plaster	Tan	Cracking	3	21.3	Positive
2190	1	1	H16	East Hallway	Yes	W1	Metal	Red	Friction	1	0.2	Negative
2190	1	1	H14	West Hallway	Yes	W1	Metal	Red	Friction	2	0.2	Negative
2190	1	1	106B	Boy's Restroom	Yes	W4	Concrete	Black	None	0	0.2	Negative
2190	1	3	304A	Classroom 304 Coat Closet	Yes	W3	Plaster	Tan	Partially Inaccessible/Cracking	2	22.5	Positive
2190	1	1	106B	Boy's Restroom	Yes	Floor	Concrete	Blue	None	0	0.1	Negative
2190	1	3	304A	Classroom 304 Coat Closet	Yes	W4	Plaster	Tan	Cracking/Chipping	15	24.7	Positive
2190	1	1	107	Classroom 107	Yes	W2	Plaster	Tan	None	0	22.3	Positive
2190	1	3	305	Classroom 305	Yes	W1	Plaster	Tan	Chipping	5	25.1	Positive
2190	1	3	305	Classroom 305	Yes	W3	Plaster	Tan	Moisture Damage/Chipping	25	24.2	Positive
2190	1	1	107	Classroom 107	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	1	107	Classroom 107	Yes	Floor	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	3	306	Classroom 306	Yes	W1	Plaster	Tan	Cracking/Chipping	5	21.2	Positive
2190	1	3	306	Classroom 306	Yes	W2	Plaster	Tan	Cracking/Chipping	5	25.3	Positive
2190	1	1	107B	Classroom 107 Restroom	Yes	W3	Plaster	Tan	None	0	N/A	N/A
2190	1	3	306	Classroom 306	Yes	W3	Plaster	Tan	Cracking/Chipping/Moisture Damage	10	29.1	Positive
2190	1	1	107B	Classroom 107 Restroom	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	1	107B	Classroom 107 Restroom	Yes	Floor	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	1	108	Classroom 108	Yes	W1	Plaster	Tan	None	0	21.4	Positive
2190	1	1	108	Classroom 108	Yes	W2	Plaster	Tan	None	0	22.5	Positive
2190	1	3	307	Classroom 307	Yes	W1	Plaster	Tan	Cracking	5	22.1	Positive
2190	1	3	307	Classroom 307	Yes	W2	Plaster	Tan	Chipping	10	24.3	Positive
2190	1	1	108	Classroom 108	Yes	W4	Plaster	Tan	None	0	27.6	Positive
2190	1	1	108	Classroom 108	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	3	307	Classroom 307	Yes	W3	Plaster	Tan	Chipping/Cracking	10	31.2	Positive
2190	1	3	307	Classroom 307	Yes	W4	Plaster	Tan	Cracking	10	21.3	Positive
2190	1	3	307	Classroom 307	Yes	W4	Plaster	White	Cracking	5	26.2	Positive
2190	1	3	308	Classroom 308	Yes	W3	Metal	Grey	Flaking	10	3.1	Positive
2190	1	3	308	Classroom 308	Yes	W2	Plaster	Tan	Chipping/Cracking	2	22.3	Positive
2190	1	3	308	Classroom 308	Yes	W3	Plaster	Tan	Chipping/Cracking	5	24.3	Positive

				Inspection Dates: 09/21/20-09/29/20			Lead Safe Certification Assessment Report						
				Name of Inspector: Michael Barth			Fell Elementary School						
				Inspection Company: Criterion Labs									
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)	
2190	1	3	309	Classroom 309	Yes	W2	Wood	Tan	Chipping	1	24.7	Positive	
2190	1	3	309	Classroom 309	Yes	W3	Wood	Tan	Chipping	1	26.3	Positive	
2190	1	1	112A	Handicap Access to Auditorium/Auditorium Storage Closet	Yes	W3	Wood	Tan	Cracking	1	0.21	Negative	
2190	1	1	109	Classroom 109	Yes	Floor	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	1	109B	Men's Restroom beside Classroom 109	Yes	W1	Plaster	Blue	None	0	21.3	Positive	
2190	1	3	309	Classroom 309	Yes	W1	Plaster	Tan	Cracking	5	25.8	Positive	
2190	1	1	109B	Men's Restroom beside Classroom 109	Yes	W1	Concrete	Grey	None	0	1.4	Positive	
2190	1	1	109B	Men's Restroom beside Classroom 109	Yes	W2	Plaster	Blue	None	0	N/A	N/A	
2190	1	3	309	Classroom 309	Yes	W2	Plaster	Tan	Cracking	3	23.5	Positive	
2190	1	1	109B	Men's Restroom beside Classroom 109	Yes	W2	Concrete	Grey	None	0	1.6	Positive	
2190	1	1	109B	Men's Restroom beside Classroom 109	Yes	W3	Plaster	Blue	None	0	N/A	N/A	
2190	1	3	309	Classroom 309	Yes	W3	Plaster	Tan	Chipping	5	22.3	Positive	
2190	1	1	109B	Men's Restroom beside Classroom 109	Yes	W3	Concrete	Grey	None	0	1.9	Positive	
2190	1	3	309	Classroom 309	Yes	W4	Plaster	Tan	Moisture Damage	5	31.2	Positive	
2190	1	1	109B	Men's Restroom beside Classroom 109	Yes	W4	Plaster	Blue	None	0	N/A	N/A	
2190	1	3	310	Classroom 310	Yes	W3	Plaster	White	Cracking	2	21.4	Positive	
2190	1	1	109B	Men's Restroom beside Classroom 109	Yes	W4	Concrete	Grey	None	0	1.6	Positive	
2190	1	1	109B	Men's Restroom beside Classroom 109	Yes	Ceiling	Plaster	Tan	None	0	22.3	Positive	
2190	1	1	109B	Men's Restroom beside Classroom 109	Yes	Floor	Concrete	Grey	None	0	0.1	Negative	
2190	1	3	310	Classroom 310	Yes	W4	Plaster	White	Cracking	3	18.9	Positive	
2190	1	1	H15A	Closet across from Classroom 104	Yes	W1	Plaster	White	Moisture Damage	5	21.3	Positive	
2190	1	1	H15A	Closet across from Classroom 104	Yes	W2	Plaster	White	Chipping	3	24.7	Positive	
2190	1	1	112C	Auditorium Stage Dressing Room - Classroom 109 Side	Yes	W3	Wood	Tan	None	0	12.4	Positive	
2190	1	1	H15A	Closet across from Classroom 104	Yes	W3	Plaster	White	Chipping	3	24.5	Positive	
2190	1	1	110A	Principal's Office Restroom	Yes	W3	Plaster	Tan	None	0	N/A	N/A	
2190	1	1	112D	Auditorium Stage Dressing Room - Classroom 100 Side	Yes	W3	Wood	Tan	None	0	6.4	Positive	
2190	1	1	H15A	Closet across from Classroom 104	Yes	W4	Plaster	White	Moisture Damage	8	23.1	Positive	
2190	1	1	H15A	Closet across from Classroom 104	Yes	Ceiling	Plaster	White	Moisture Damage	8	22.7	Positive	
2190	1	1	103	Classroom 103	Yes	W3	Metal	Tan	Flaking	1	0.2	Negative	
2190	1	1	101B	Counselor	Yes	W3	Metal	Grey	Chipping	3	1.5	Positive	
2190	1	1	110A	Principal's Office Restroom	Yes	Floor	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	1	101B	Counselor	Yes	W2	Plaster	Tan	Chipping	1	16.8	Positive	
2190	1	1	101B	Counselor	Yes	W3	Plaster	Tan	Cracking	1	24.1	Positive	
2190	1	3	316	Dean	Yes	Floor	Concrete	Grey	Friction	5	4.1	Positive	
2190	1	1	112	Auditorium	Yes	W3	Metal	Tan	None	0	3.7	Positive	
2190	1	1	110	Principal's Office	Yes	W3	Plaster	Tan	None	0	N/A	N/A	
2190	1	1	112	Auditorium	Yes	W4	Metal	Tan	Chipping	6	2.4	Negative	

				Inspection Dates: 09/21/20-09/29/20		Lead Safe Certification Assessment Report						
				Name of Inspector: Michael Barth		Fell Elementary School						
				Inspection Company: Criterion Labs								
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)
2190	1	1	110	Principal's Office	Yes	W4	Plaster	Tan	None	0	N/A	N/A
2190	1	1	112	Auditorium	Yes	W4	Metal	Tan	Friction	5	0.3	Negative
2190	1	1	103A	Classroom 103 Coat Closet	Yes	W3	Metal	Tan	None	0	0.2	Negative
2190	1	1	110	Principal's Office	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	3	316	Dean	Yes	W3	Metal	Grey	Chipping	2	2.1	Positive
2190	1	1	H16B	Principal's Office Hallway/Storage	yes	W1	Plaster	Tan	None	0	22.4	Positive
2190	1	3	316	Dean	Yes	W1	Plaster	Tan	Cracking	3	23.1	Positive
2190	1	1	H16B	Principal's Office Hallway/Storage	yes	W3	Plaster	Tan	None	0	18.9	Positive
2190	1	1	H16B	Principal's Office Hallway/Storage	yes	W4	Plaster	Tan	Partially Inaccessible	0	23.6	Positive
2190	1	1	H16B	Principal's Office Hallway/Storage	yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	3	316	Dean	Yes	W2	Plaster	Tan	Cracking	2	22.5	Positive
2190	1	3	316	Dean	Yes	W3	Plaster	Tan	Chipping	5	27.6	Positive
2190	1	3	316	Dean	Yes	W4	Plaster	Tan	Cracking	10	21.2	Positive
2190	1	1	S18	Auditorium Entrance Stairwell across from Classroom 104	Yes	W2	Wood	White	None	0	0.2	Negative
2190	1	3	316	Dean	Yes	Ceiling	Plaster	Tan	Cracking	3	21.9	Positive
2190	1	1	S18	Auditorium Entrance Stairwell across from Classroom 104	Yes	W4	Wood	White	None	0	0.21	Negative
2190	1	1	H16	East Hallway	Yes	Floor	Concrete	Grey	Friction	10	3.4	Positive
2190	1	1	H16	East Hallway	Yes	W2	Plaster	Red	Cracking	3	22.1	Positive
2190	1	1	H16	East Hallway	Yes	W4	Plaster	Red	Chipping/Moisture Damage	5	21.3	Positive
2190	1	1	111	Main Office	Yes	W1	Plaster	Tan	None	0	24.1	Positive
2190	1	1	S19	Auditorium Entrance Stairwell across from Classroom 105	Yes	W2	Wood	White	None	0	0.21	Negative
2190	1	B	H03A	East Hallway; South End	Yes	Floor	Concrete	Blue	Friction	1	4.5	Positive
2190	1	1	S19	Auditorium Entrance Stairwell across from Classroom 105	Yes	W4	Wood	White	None	0	0.1	Negative
2190	1	B	H03A	East Hallway; South End	Yes	W2	Brick	White	Alligating	5	21.4	Positive
2190	1	1	103B	Girl's Restroom	Yes	W2	Wood	White	None	0	21.3	Positive
2190	1	B	H03A	East Hallway; South End	Yes	W3	Brick	White	Cracking	2	23.5	Positive
2190	1	1	112	Auditorium	Yes	W1	Wood	White	None	0	0.2	Negative
2190	1	1	111	Main Office	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	1	111	Main Office	Yes	Floor	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	1	111B	Main Office Storage Closet	Yes	W1	Plaster	Tan	Partially Inaccessible	0	22.1	Positive
2190	1	B	H03A	East Hallway; South End	Yes	W4	Brick	White	Cracking	5	25.1	Positive
2190	1	1	112	Auditorium	Yes	W2	Wood	White	Cracking	2	0.1	Negative
2190	1	B	RM3	Facilities Storage (former classroom)	Yes	W1	Plaster	White	Cracking	15	18.6	Positive
2190	1	B	RM3	Facilities Storage (former classroom)	Yes	W2	Plaster	Tan	Moisture Damage	51	21.3	Positive
2190	1	B	RM3	Facilities Storage (former classroom)	Yes	W3	Plaster	Tan	Chipping	2	22.9	Positive
2190	1	1	111B	Main Office Storage Closet	Yes	Floor	N/A	N/A	N/A	N/A	N/A	N/A

				Inspection Dates: 09/21/20-09/29/20									
				Name of Inspector: Michael Barth			Lead Safe Certification Assessment Report						
				Inspection Company: Criterion Labs			Fell Elementary School						
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)	
2190	1	1	PC111B	Main Office Storage Closet Pipe Chase	Yes	W1	Terracotta	N/A	N/A	N/A	N/A	N/A	
2190	1	1	PC111B	Main Office Storage Closet Pipe Chase	Yes	W2	Terracotta	N/A	N/A	N/A	N/A	N/A	
2190	1	1	PC111B	Main Office Storage Closet Pipe Chase	Yes	W3	Terracotta	N/A	N/A	N/A	N/A	N/A	
2190	1	1	PC111B	Main Office Storage Closet Pipe Chase	Yes	W4	Terracotta	N/A	N/A	N/A	N/A	N/A	
2190	1	1	PC111B	Main Office Storage Closet Pipe Chase	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	1	PC111B	Main Office Storage Closet Pipe Chase	Yes	Floor	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	1	112	Auditorium	Yes	W1	Plaster	Tan	Chipping	10	0.21	Negative	
2190	1	1	112	Auditorium	Yes	W3	Wood	White	Chipping	5	0.1	Negative	
2190	1	B	RM3	Facilities Storage (former classroom)	Yes	W4	Plaster	Tan	Chipping	1	21.4	Positive	
2190	1	1	112	Auditorium	Yes	W2	Plaster	Tan	Chipping	10	0.21	Negative	
2190	1	1	112D	Auditorium Stage Dressing Room - Classroom 100 Side	Yes	Ceiling	Wood	White	None	0	9.8	Positive	
2190	1	B	RM3	Facilities Storage (former classroom)	Yes	Ceiling	Plaster	Tan	Moisture Damage	25	24.5	Positive	
2190	1	1	106B	Boy's Restroom	Yes	W4	Metal	White	Chipping	1	0.3	Negative	
2190	1	1	110A	Principal's Office Restroom	yes	W2	Metal	White	None	0	0.3	Negative	
2190	1	1	112	Auditorium	Yes	W3	Plaster	Tan	Chipping	3	0.2	Negative	
2190	1	1	110A	Principal's Office Restroom	yes	W3	Metal	White	Chipping	6	0.4	Negative	
2190	1	B	S04	Fire Stair Tower	Yes	Ceiling	Plaster	White	Moisture Damage	1	22.3	Positive	
2190	1	B	S04	Fire Stair Tower	Yes	W2	Brick	White	Moisture Damage	1	21.2	Positive	
2190	1	1	111B	Main Office Storage Closet	yes	W2	Metal	White	Chipping	1	0.3	Negative	
2190	1	1	H15A	Closet across from Classroom 104	Yes	W3	Metal	White	Chipping	1	0.2	Negative	
2190	1	1	112	Auditorium	Yes	W4	Plaster	Tan	Cracking	5	0.1	Negative	
2190	1	2	S24	Fire Tower Stairwell	Yes	Ceiling	Plaster	White	Moisture Damage	5	23.3	Positive	
2190	1	1	103B	Girl's Restroom	yes	W2	Metal	Grey	Cracking	3	3.1	Positive	
2190	1	1	103B	Girl's Restroom	Yes	W1	Plaster	Tan	Cracking	2	22.1	Positive	
2190	1	1	112	Auditorium	Yes	Ceiling	Plaster	White	No Access	N/A	N/A	N/A	
2190	1	2	216	Teacher's Lounge 216	Yes	W3	Wood	Blue	None	0	12.3	Positive	
2190	1	1	112B	Auditorium Stage	Yes	W1	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	1	103B	Girl's Restroom	Yes	W2	Plaster	Tan	Cracking/Moisture Damage	15	24.3	Positive	
2190	1	1	103B	Girl's Restroom	Yes	W3	Plaster	Tan	Cracking	1	32.1	Positive	
2190	1	1	103B	Girl's Restroom	Yes	W4	Plaster	Tan	Cracking	1	31.3	Positive	
2190	1	1	112B	Auditorium Stage	Yes	Ceiling	Plaster	Tan	None	0	N/A	N/A	
2190	1	2	207	Classroom 207	Yes	Floor	Wood	Brown	Friction	5	0.22	Negative	
2190	1	1	103B	Girl's Restroom	Yes	Ceiling	Plaster	Tan	Moisture Damage	10	25.9	Positive	
2190	1	1	103B	Girl's Restroom	yes	W2	Metal	White	Cracking	3	5.4	Positive	
2190	1	B	24	Girl's Restroom	Yes	Ceiling	Plaster	White	Moisture Damage	2	21.4	Positive	
2190	1	2	208	Classroom 208	Yes	Floor	Wood	Brown	Friction	5	0.11	Negative	

				Inspection Dates: 09/21/20-09/29/20			Lead Safe Certification Assessment Report					
				Name of Inspector: Michael Barth			Fell Elementary School					
				Inspection Company: Criterion Labs								
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)
2190	1	B	24	Girl's Restroom	Yes	W3	Brick	White	Moisture Damage	2	21.3	Positive
2190	1	B	34	Gymnasium	Yes	Ceiling	Plaster	White	Moisture Damage	10	18.9	Positive
2190	1	1	112A	Handicap Access to Auditorium/Auditorium Storage Closet	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A
2190	1	B	34	Gymnasium	Yes	W1	Brick	White	Cracking	10	21.3	Positive
2190	1	2	209	Classroom 209	Yes	Floor	Wood	Brown	Friction	5	0.11	Negative
2190	1	B	34	Gymnasium	Yes	W2	Brick	White	Cracking	5	22.4	Positive
2190	1	B	34	Gymnasium	Yes	W3	Brick	White	Cracking	5	26.7	Positive
2190	1	B	34	Gymnasium	Yes	W4	Brick	White	Cracking	10	21.2	Positive
2190	1	2	207A	Classroom 207 Coat Closet	Yes	Floor	Wood	Brown	Friction	4	0.21	Negative
2190	1	2	208A	Classroom 208 Coat Closet	Yes	Floor	Wood	Brown	Friction	3	0.2	Negative
2190	1	B	34	Gymnasium	Yes	Ceiling	Metal	Tan	Chipping	12	17.2	Positive
2190	1	B	37	Gymnasium Office	Yes	Ceiling	Plaster	White	Moisture Damage	3	21.3	Positive
2190	1	B	37	Gymnasium Office	Yes	W1	Brick	White	Cracking	2	21.4	Positive
2190	1	2	216A	Teacher's Lounge 216 Staff Restroom	Yes	W2	Metal	Green	None	0	0.2	Negative
2190	1	2	216A	Teacher's Lounge 216 Staff Restroom	Yes	W3	Metal	Green	None	0	0.3	Negative
2190	1	B	37	Gymnasium Office	Yes	W2	Brick	White	Cracking	3	22.7	Positive
2190	1	2	200	Classroom 200	Yes	W3	Metal	Grey	Chipping	1	0.24	Negative
2190	1	B	37	Gymnasium Office	Yes	W3	Brick	White	Cracking	3	29.8	Positive
2190	1	B	37	Gymnasium Office	Yes	W4	Brick	White	Chipping	5	23.4	Positive
2190	1	2	200	Classroom 200	Yes	W4	Metal	Grey	None	1	0.3	Negative
2190	1	B	37	Gymnasium Office	Yes	Ceiling	Metal	Tan	Chipping	2	17.9	Positive
2190	1	B	38	Gymnasium Storage	Yes	Ceiling	Metal	Tan	Chipping	1	12.2	Positive
2190	1	3	H312	Hallway outside Classrooms 300 - 302	Yes	Floor	Concrete	Grey	Friction	5	4.2	Positive
2190	1	3	H312	Hallway outside Classrooms 300 - 302	Yes	W2	Plaster	Yellow/Black	Chipping	5	24.1	Positive
2190	1	2	206	IMC (Library)	Yes	W3	Metal	Grey	None	0	0.3	Negative
2190	1	3	H312	Hallway outside Classrooms 300 - 302	Yes	W3	Plaster	Yellow/Green	Chipping	2	21.2	Positive
2190	1	3	H312	Hallway outside Classrooms 300 - 302	Yes	W4	Plaster	Yellow/Black	Chipping	4	22.3	Positive
2190	1	3	H310	Hallway outside Classrooms 307 - 309	Yes	Floor	Concrete	Grey	Friction	5	3.4	Positive
2190	1	3	H310	Hallway outside Classrooms 307 - 309	Yes	W2	Metal	Grey	Chipping	2	1.6	Positive
2190	1	3	H310	Hallway outside Classrooms 307 - 309	Yes	W2	Plaster	Yellow/Green	Cracking	10	22.3	Positive
2190	1	3	H310	Hallway outside Classrooms 307 - 309	Yes	W4	Plaster	Yellow/Green	Chipping	4	22.7	Positive
2190	1	B	H02	Hallway outside of Cafeteria B	Yes	Ceiling	Plaster	White	Flaking	10	23.5	Positive
2190	1	1	H14	West Hallway	Yes	W3	Plaster	Yellow	None	0	21.7	Positive
2190	1	B	H02	Hallway outside of Cafeteria B	Yes	W1	Brick	White	Cracking	5	21.4	Positive
2190	1	B	H02	Hallway outside of Cafeteria B	Yes	W3	Brick	White	Cracking	2	24.5	Positive

				Inspection Dates: 09/21/20-09/29/20									
				Name of Inspector: Michael Barth			Lead Safe Certification Assessment Report						
				Inspection Company: Criterion Labs			Fell Elementary School						
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)	
2190	1	1	H14	West Hallway	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	1	H14	West Hallway	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	B	H02	Hallway outside of Cafeteria B	Yes	W4	Brick	White	Cracking	5	22.1	Positive	
2190	1	B	H02	Hallway outside of Cafeteria B	Yes	Ceiling	Metal	White	Chipping	5	21.2	Positive	
	1	2	H29	Hallway outside of Classrooms 200 - 202	Yes	Floor	Concrete	Grey	Friction	5	3.6	Positive	
2190	1	2	H29	Hallway outside of Classrooms 200 - 202	Yes	W2	Plaster	Red/Yellow	Cracking	8	19.5	Positive	
2190	1	1	H15	Center Hallway between Classrooms 103 - 106	Yes	W2	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	2	H29	Hallway outside of Classrooms 200 - 202	Yes	W3	Plaster	Red/Yellow	Chipping	6	21.6	Positive	
2190	1	1	H15	Center Hallway between Classrooms 103 - 106	Yes	W3	Plaster	Yellow	None	0	22.7	Positive	
2190	1	2	H29	Hallway outside of Classrooms 200 - 202	Yes	W4	Plaster	Red/Yellow	Chipping	6	21.6	Positive	
2190	1	2	H27	Hallway outside of Classrooms 207-209	yes	Floor	Concrete	Grey	Friction	5	3.4	Positive	
2190	1	1	H15	Center Hallway between Classrooms 103 - 106	Yes	W4	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	1	H15	Center Hallway between Classrooms 103 - 106	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	2	H27	Hallway outside of Classrooms 207-209	yes	W2	Metal	Grey	Chipping	1	22.1	Positive	
2190	1	1	H15	Center Hallway between Classrooms 103 - 106	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	2	H27	Hallway outside of Classrooms 207-209	yes	W1	Metal	Red	Friction	1	0.1	Positive	
2190	1	2	H27	Hallway outside of Classrooms 207-209	yes	W2	Plaster	Red/Yellow	Cracking	5	23.2	Positive	
2190	1	2	H27	Hallway outside of Classrooms 207-209	yes	W3	Plaster	Red/Yellow	Cracking	1	21.9	Positive	
2190	1	2	209A	Classroom 209 Coat Closet	Yes	W3	Metal	Grey	Chipping	1	0.4	Negative	
2190	1	2	H27	Hallway outside of Classrooms 207-209	yes	W4	Plaster	Red/Yellow	Cracking	5	24.1	Positive	
2190	1	B	H03	Hallway outside of PTA Cafeteria and Girls Restroom	Yes	Ceiling	Plaster	White	Chipping	5	18.9	Positive	
2190	1	B	H03	Hallway outside of PTA Cafeteria and Girls Restroom	Yes	W1	Brick	White	Cracking	2	27.8	Positive	
2190	1	1	H15A	Closet across from Classroom 104	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	1	103A	Classroom 103 Coat Closet	Yes	W1	Plaster	Tan	None	0	21.3	Positive	
2190	1	B	H03	Hallway outside of PTA Cafeteria and Girls Restroom	Yes	W2	Brick	White	Cracking	5	23.4	Positive	
2190	1	1	103A	Classroom 103 Coat Closet	Yes	W3	Plaster	Tan	Partially Inaccessible	0	24.3	Positive	
2190	1	2	202	Classroom 202	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A	
2190	1	B	H03	Hallway outside of PTA Cafeteria and Girls Restroom	Yes	W3	Brick	White	Cracking	2	22.5	Positive	
2190	1	1	103A	Classroom 103 Coat Closet	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	2	200	Classroom 200	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A	

				Inspection Dates: 09/21/20-09/29/20								
				Name of Inspector: Michael Barth		Lead Safe Certification Assessment Report						
				Inspection Company: Criterion Labs		Fell Elementary School						
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)
2190	1	1	104A	Classroom 104 Coat Closet	Yes	W1	Plaster	Tan	None	0	21.3	Positive
2190	1	B	H03	Hallway outside of PTA Cafeteria and Girls Restroom	Yes	W4	Brick	White	Cracking	5	21.2	Positive
2190	1	1	104A	Classroom 104 Coat Closet	Yes	W3	Plaster	Tan	Partially Inaccessible	0	21.4	Positive
2190	1	2	201	Classroom 201	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A
2190	1	B	H03	Hallway outside of PTA Cafeteria and Girls Restroom	Yes	Ceiling	Metal	White	Chipping	10	17.8	Positive
2190	1	1	104A	Classroom 104 Coat Closet	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	1	104A	Classroom 104 Coat Closet	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A
2190	1	1	PC104A	Classroom 104 Coat Closet Pipe Chase	Yes	W1	Brick	N/A	N/A	N/A	N/A	N/A
2190	1	1	PC104A	Classroom 104 Coat Closet Pipe Chase	Yes	W2	Brick	N/A	N/A	N/A	N/A	N/A
2190	1	1	PC104A	Classroom 104 Coat Closet Pipe Chase	Yes	W3	Brick	N/A	N/A	N/A	N/A	N/A
2190	1	1	PC104A	Classroom 104 Coat Closet Pipe Chase	Yes	W4	Brick	N/A	N/A	N/A	N/A	N/A
2190	1	1	PC104A	Classroom 104 Coat Closet Pipe Chase	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	1	PC104A	Classroom 104 Coat Closet Pipe Chase	Yes	Floor	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	1	105A	Classroom 105 Coat Closet	Yes	W1	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	1	105A	Classroom 105 Coat Closet	Yes	W2	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	1	105A	Classroom 105 Coat Closet	Yes	W3	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	1	105A	Classroom 105 Coat Closet	Yes	W4	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	1	105A	Classroom 105 Coat Closet	Yes	Ceiling	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	1	105A	Classroom 105 Coat Closet	Yes	Floor	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	B	H01	Hallway outside Rooms 1-3	Yes	Ceiling	Plaster	White	Flaking	10	18.2	Positive
2190	1	B	H01	Hallway outside Rooms 1-3	Yes	W1	Brick	White	Cracking	3	23.4	Positive
2190	1	1	106A	Classroom 106 Coat Closet	Yes	W3	Plaster	Tan	Partially Inaccessible	1	N/A	No Access
2190	1	B	H01	Hallway outside Rooms 1-3	Yes	W2	Brick	White	Cracking	5	24.1	Positive
2190	1	1	106A	Classroom 106 Coat Closet	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	1	106A	Classroom 106 Coat Closet	Yes	Floor	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	1	107A	Classroom 107 Coat Closet	Yes	W1	Plaster	Green	None	0	21.3	Positive
2190	1	1	107A	Classroom 107 Coat Closet	Yes	W1	Plaster	Blue	None	0	22.7	Positive
2190	1	1	107A	Classroom 107 Coat Closet	Yes	W2	Plaster	Green	None	0	23.1	Positive
2190	1	1	107A	Classroom 107 Coat Closet	Yes	W2	Plaster	Blue	None	0	22.6	Positive
2190	1	2	203	Classroom 203	Yes	W2	Wood	N/A	N/A	0	N/A	N/A
2190	1	1	107A	Classroom 107 Coat Closet	Yes	W3	Plaster	Green	None	0	21.4	Positive
2190	1	1	107A	Classroom 107 Coat Closet	Yes	W3	Plaster	Blue	None	0	22.3	Positive
2190	1	2	203	Classroom 203	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A
2190	1	B	H01	Hallway outside Rooms 1-3	Yes	W3	Brick	White	Cracking	3	22.3	Positive
2190	1	B	H01	Hallway outside Rooms 1-3	Yes	W4	Brick	White	Cracking	5	24.5	Positive

				Inspection Dates: 09/21/20-09/29/20									
				Name of Inspector: Michael Barth			Lead Safe Certification Assessment Report						
				Inspection Company: Criterion Labs			Fell Elementary School						
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)	
2190	1	1	107A	Classroom 107 Coat Closet	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	2	204	Classroom 204	Yes	W2	Wood	N/A	N/A	N/A	N/A	N/A	
2190	1	1	PC107A	Classroom 107 Coat Closet Pipe Chase	Yes	W1	Brick	N/A	N/A	N/A	N/A	N/A	
2190	1	1	PC107A	Classroom 107 Coat Closet Pipe Chase	Yes	W2	Brick	N/A	N/A	N/A	N/A	N/A	
2190	1	1	PC107A	Classroom 107 Coat Closet Pipe Chase	Yes	W3	Brick	N/A	N/A	N/A	N/A	N/A	
2190	1	1	PC107A	Classroom 107 Coat Closet Pipe Chase	Yes	W4	Brick	N/A	N/A	N/A	N/A	N/A	
2190	1	1	PC107A	Classroom 107 Coat Closet Pipe Chase	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	1	PC107A	Classroom 107 Coat Closet Pipe Chase	Yes	Floor	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	1	108A	Classroom 108 Coat Closet	Yes	W1	Plaster	Tan	None	0	24.6	Positive	
2190	1	B	H01	Hallway outside Rooms 1-3	Yes	Ceiling	Metal	Tan	Flaking	25	19.1	Positive	
2190	1	1	108A	Classroom 108 Coat Closet	Yes	W3	Plaster	Tan	Partially Inaccessible	0	23.4	Positive	
2190	1	2	H29A	Hallway/Vestibule to Teacher's Lounge	Yes	W2	Plaster	Tan	Flaking	3	21.4	Positive	
2190	1	1	108A	Classroom 108 Coat Closet	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	2	204	Classroom 204	Yes	W4	Wood	N/A	N/A	N/A	N/A	N/A	
2190	1	2	H29A	Hallway/Vestibule to Teacher's Lounge	Yes	W4	Wood	Tan	Friction	3	8.8	Positive	
2190	1	1	109A	Classroom 109 Coat Closet	Yes	W2	Plaster	Tan	Partially Inaccessible	0	24.5	Positive	
2190	1	2	204	Classroom 204	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A	
2190	1	1	112A	Handicap Access to Auditorium/Auditorium Storage Closet	Yes	W1	Plaster	Tan	Cracking	3	21.5	Positive	
2190	1	2	206	IMC (Library)	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A	
2190	1	1	112A	Handicap Access to Auditorium/Auditorium Storage Closet	Yes	W2	Plaster	Tan	Chipping	5	22.3	Positive	
2190	1	1	109A	Classroom 109 Coat Closet	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	2	207	Classroom 207	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A	
2190	1	1	PC109A	Classroom 109 Coat Closet Pipe Chase	Yes	W1	Terracotta	N/A	N/A	N/A	N/A	N/A	
2190	1	1	PC109A	Classroom 109 Coat Closet Pipe Chase	Yes	W2	Terracotta	N/A	N/A	N/A	N/A	N/A	
2190	1	1	PC109A	Classroom 109 Coat Closet Pipe Chase	Yes	W3	Terracotta	N/A	N/A	N/A	N/A	N/A	
2190	1	1	PC109A	Classroom 109 Coat Closet Pipe Chase	Yes	W4	Terracotta	N/A	N/A	N/A	N/A	N/A	
2190	1	1	PC109A	Classroom 109 Coat Closet Pipe Chase	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	1	PC109A	Classroom 109 Coat Closet Pipe Chase	Yes	Floor	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	1	112A	Handicap Access to Auditorium/Auditorium Storage Closet	Yes	W3	Plaster	Tan	Cracking	5	24.1	Positive	
2190	1	1	112A	Handicap Access to Auditorium/Auditorium Storage Closet	Yes	W4	Plaster	Tan	Chipping	3	21.2	Positive	
2190	1	2	208	Classroom 208	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A	
2190	1	2	209	Classroom 209	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A	
2190	1	1	112A	Handicap Access to Auditorium/Auditorium Storage Closet	Yes	Ceiling	Plaster	Tan	Cracking	5	23.1	Positive	
2190	1	2	210A	Nurse's Restroom	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A	
2190	1	2	210	Nurse	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A	
2190	1	2	202	Classroom 202	Yes	W4	Plaster	Tan	None	0	21.4	Positive	
2190	1	2	202	Classroom 202	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A	

				Inspection Dates: 09/21/20-09/29/20		Lead Safe Certification Assessment Report						
				Name of Inspector: Michael Barth		Fell Elementary School						
				Inspection Company: Criterion Labs								
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)
2190	1	2	215A	Teacher's Lounge 215 Storage Closet	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A
2190	1	2	206	IMC (Library)	Yes	W1	Plaster	White	Chipping	3	23.4	Positive
2190	1	2	206	IMC (Library)	Yes	W3	Plaster	White	Flaking/Moisture Damage/Cracking	3	22.1	Positive
2190	1	B	B4	Kitchen Serving Line	yes	W1	Brick	White	Cracking	5	22.3	Positive
2190	1	B	B4	Kitchen Serving Line	yes	W3	Brick	White	Cracking	2	21.4	Positive
2190	1	2	216	Teacher's Lounge 216	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A
2190	1	2	216A	Teacher's Lounge 216 Staff Restroom	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A
2190	1	B	B4	Kitchen Serving Line	yes	W4	Brick	White	Cracking	2	25.4	Positive
2190	1	3	313	Large Storage Closet outside of Classroom 309	Yes	W3	Metal	Grey	Chipping	5	7.8	Positive
2190	1	2	200A	Classroom 200 Coat Closet	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A
2190	1	2	201A	Classroom 201 Coat Closet	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A
2190	1	2	200	Classroom 200	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	2	207A	Classroom 207 Coat Closet	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A
2190	1	3	313	Large Storage Closet outside of Classroom 309	Yes	W1	Plaster	Tan	Chipping	1	22.1	Positive
2190	1	2	201	Classroom 201	Yes	W2	Plaster	Tan	Partially Inaccessible	0	22.7	Positive
2190	1	3	313	Large Storage Closet outside of Classroom 309	Yes	W2	Plaster	Tan	Flaking	10	23.4	Positive
2190	1	2	209A	Classroom 209 Coat Closet	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A
2190	1	3	313	Large Storage Closet outside of Classroom 309	Yes	W3	Plaster	Tan	Flaking	1	27.8	Positive
2190	1	2	201	Classroom 201	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	2	H29	Hallway outside of Classrooms 200 - 202	Yes	W1	Metal	Red	Friction	1	0.11	Negative
2190	1	3	313	Large Storage Closet outside of Classroom 309	Yes	W4	Plaster	Tan	Flaking	5	26.4	Positive
2190	1	3	313	Large Storage Closet outside of Classroom 309	Yes	Ceiling	Plaster	Tan	Flaking	2	23.2	Positive
2190	1	B	PTA	Lunch Room	Yes	W1	Plaster	White	Cracking	5	22.3	Positive
2190	1	B	PTA	Lunch Room	Yes	W1	Plaster	Green	Chipping	3	21.4	Positive
2190	1	B	PTA	Lunch Room	Yes	W2	Plaster	White	Cracking	3	18.7	Positive
2190	1	B	PTA	Lunch Room	Yes	W2	Plaster	Green	Cracking	3	19.2	Positive
2190	1	2	202	Classroom 202	Yes	W2	Metal	Tan	Chipping	1	0.03	Negative
2190	1	B	PTA	Lunch Room	Yes	W3	Plaster	White	Chipping	3	21.9	Positive
2190	1	B	PTA	Lunch Room	Yes	W3	Plaster	Green	Chipping	4	22.3	Positive
2190	1	2	203	Classroom 203	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	2	202	Classroom 202	Yes	W3	Metal	Tan	Chipping	1	0.01	Negative
2190	1	2	204	Classroom 204	Yes	W1	Plaster	Tan	None	0	21.2	Positive
2190	1	2	203	Classroom 203	Yes	W1	Metal	Tan	None	0	0.2	Negative
2190	1	B	PTA	Lunch Room	Yes	W4	Plaster	White	Cracking	2	24.5	Positive

				Inspection Dates: 09/21/20-09/29/20		Lead Safe Certification Assessment Report						
				Name of Inspector: Michael Barth		Fell Elementary School						
				Inspection Company: Criterion Labs								
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)
2190	1	2	200A	Classroom 200 Coat Closet	Yes	W2	Metal	Tan	None	0	22.5	Positive
2190	1	2	200A	Classroom 200 Coat Closet	Yes	W3	Metal	Tan	Flaking	5	0.21	Negative
2190	1	2	204	Classroom 204	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	2	206B	Classroom 206 Closet B	Yes	Ceiling	Metal	Tan	Chipping	1	0	Negative
2190	1	B	PTA	Lunch Room	Yes	W4	Plaster	Green	Chipping	1	22.9	Positive
2190	1	2	206	IMC (Library)	Yes	W2	Plaster	White	None	0	25.3	Positive
2190	1	B	PTA	Lunch Room	Yes	Ceiling	Metal	White	Cracking	5	15.4	Positive
2190	1	1	111	Main Office	Yes	W2	Plaster	Tan	Cracking	1	28.9	Positive
2190	1	2	206	IMC (Library)	Yes	W4	Plaster	White	Partially Inaccessible	0	21.2	Positive
2190	1	2	206	IMC (Library)	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	1	111	Main Office	Yes	W3	Plaster	Tan	Chipping/Moisture Damage	6	32.1	Positive
2190	1	2	H29A	Hallway/Vestibule to Teacher's Lounge	Yes	W1	Plaster	Tan	None	0	22.2	Positive
2190	1	1	111	Main Office	Yes	W4	Plaster	Tan	Cracking	1	21.7	Positive
2190	1	2	H29A	Hallway/Vestibule to Teacher's Lounge	Yes	W3	Plaster	Tan	None	0	23.4	Positive
2190	1	2	H29A	Hallway/Vestibule to Teacher's Lounge	Yes	W4	Plaster	Tan	None	0	25.3	Positive
2190	1	1	111B	Main Office Storage Closet	Yes	W2	Plaster	Tan	Chipping	2	16.7	Positive
2190	1	2	H29A	Hallway/Vestibule to Teacher's Lounge	Yes	Ceiling	Plaster	Tan	None	0	N/A	N/A
2190	1	2	H29A	Hallway/Vestibule to Teacher's Lounge	Yes	Floor	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	1	111B	Main Office Storage Closet	Yes	W3	Plaster	Tan	Flaking	10	12.1	Positive
2190	1	1	111B	Main Office Storage Closet	Yes	W4	Plaster	Tan	Cracking	10	24.1	Positive
2190	1	1	111B	Main Office Storage Closet	Yes	Ceiling	Plaster	Tan	Flaking	12	23.2	Positive
2190	1	1	109B	Men's Restroom beside Classroom 109	Yes	W3	Metal	Grey	Chipping	1	5.4	Positive
2190	1	2	215A	Teacher's Lounge 215 Storage Closet	Yes	W1	Wood	Tan	None	0	5.6	Positive
2190	1	2	207	Classroom 207	Yes	W4	Plaster	Tan	None	0	21.4	Positive
2190	1	1	109B	Men's Restroom beside Classroom 109	Yes	W1	Plaster	Tan	Chipping	1	31.2	Positive
2190	1	2	215A	Teacher's Lounge 215 Storage Closet	Yes	W2	Wood	Tan	None	0	6.4	Positive
2190	1	2	207	Classroom 207	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	1	109B	Men's Restroom beside Classroom 109	Yes	W2	Plaster	Tan	Cracking	10	32.2	Positive
2190	1	1	109B	Men's Restroom beside Classroom 109	Yes	W3	Plaster	Tan	Chipping	1	24.5	Positive
2190	1	2	208	Classroom 208	Yes	W1	Plaster	Tan	None	0	21.7	Positive
2190	1	1	109B	Men's Restroom beside Classroom 109	Yes	W4	Plaster	Tan	Chipping	2	26.7	Positive
2190	1	B	RM2	Music Room	Yes	W1	Plaster	Tan	Flaking	10	21.3	Positive
2190	1	B	RM2	Music Room	Yes	W2	Plaster	Tan	Cracking	15	22.7	Positive
2190	1	B	RM2	Music Room	Yes	W3	Plaster	Tan	Cracking	5	24.1	Positive
2190	1	2	208	Classroom 208	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	B	RM2	Music Room	Yes	W4	Plaster	Tan	Cracking	5	26.7	Positive
2190	1	B	RM2	Music Room	Yes	Ceiling	Plaster	Tan	Moisture Damage	15	28.9	Positive
2190	1	B	S01A	Northwest Stairwell Entrance Vestibule beside Room 3	Yes	W1	Plaster	Blue	Cracking	3	21.3	Positive
2190	1	B	S01A	Northwest Stairwell Entrance Vestibule beside Room 3	Yes	W2	Plaster	Blue	Chipping	2	23.2	Positive

				Inspection Dates: 09/21/20-09/29/20			Lead Safe Certification Assessment Report						
				Name of Inspector: Michael Barth			Fell Elementary School						
				Inspection Company: Criterion Labs									
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)	
2190	1	B	S01A	Northwest Stairwell Entrance Vestibule beside Room 3	Yes	W2	Metal	Grey	Chipping	1	1.5	Positive	
2190	1	2	210	Nurse	Yes	W2	Metal	Grey	Chipping	1	2.1	Positive	
2190	1	2	210	Nurse	Yes	W2	Wood	Tan	Cracking	8	5.7	Positive	
2190	1	2	210	Nurse	Yes	Floor	Wood	Tan	Friction	5	4.1	Positive	
2190	1	2	200	Classroom 200	Yes	W3	Wood	White	None	0	14.1	Positive	
2190	1	2	210	Nurse	Yes	W1	Wood	Tan	Friction/Cracking	5	5.4	Positive	
2190	1	2	209	Classroom 209	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	2	210	Nurse	Yes	W1	Wood	Tan	Chipping	2	4.8	Positive	
2190	1	2	210	Nurse	Yes	W2	Plaster	Blue	Cracking	8	22.1	Positive	
2190	1	2	210A	Nurse's Restroom	Yes	W1	Plaster	Blue	None	0	22.1	Positive	
2190	1	2	210	Nurse	Yes	W3	Wood	Tan	Friction/Alligatoring	5	6.5	Positive	
2190	1	2	210A	Nurse's Restroom	Yes	W3	Metal	Grey	Chipping	1	1.7	Positive	
2190	1	2	210A	Nurse's Restroom	Yes	W3	Wood	Tan	Alligatoring	10	12.1	Positive	
2190	1	2	210A	Nurse's Restroom	Yes	Floor	Wood	Tan	Friction	2	4.7	Positive	
2190	1	2	210A	Nurse's Restroom	Yes	W2	Plaster	Blue	Cracking	2	23.5	Positive	
2190	1	2	210A	Nurse's Restroom	Yes	W3	Plaster	Blue	Cracking	3	23.7	Positive	
2190	1	2	210A	Nurse's Restroom	Yes	W4	Plaster	Blue	Chipping	1	23.9	Positive	
2190	1	2	210A	Nurse's Restroom	Yes	Ceiling	Plaster	Tan	Chipping	1	12.4	Positive	
2190	1	2	210A	Nurse's Restroom	Yes	W1	Wood	Tan	Cracking	5	4.5	Positive	
2190	1	2	210A	Nurse's Restroom	Yes	W4	Wood	Tan	Alligatoring	2	14.1	Positive	
2190	1	2	210	Nurse	Yes	W1	Plaster	Blue	Partially Inaccessible	0	21.3	Positive	
2190	1	1	110	Principal's Office	Yes	W4	Metal	Grey	Chipping	1	1.5	Positive	
2190	1	1	110	Principal's Office	Yes	W1	Plaster	Tan	Cracking	2	32.1	Positive	
2190	1	1	110	Principal's Office	Yes	W2	Plaster	Tan	Cracking	1	23.5	Positive	
2190	1	2	210	Nurse	Yes	W2	Plaster	Orange	None	0	23.1	Positive	
2190	1	1	H16B	Principal's Office Hallway/Storage	yes	W2	Plaster	Tan	Cracking	3	26.1	Positive	
2190	1	1	110A	Principal's Office Restroom	Yes	W1	Plaster	Tan	Cracking/Chipping	8	26.1	Positive	
2190	1	2	210	Nurse	Yes	W3	Plaster	Mural	None	0	24.5	Positive	
2190	1	1	110A	Principal's Office Restroom	Yes	W2	Plaster	Tan	Cracking	10	23.2	Positive	
2190	1	2	210	Nurse	Yes	W4	Plaster	Blue	None	0	21.4	Positive	
2190	1	2	210	Nurse	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	1	110A	Principal's Office Restroom	Yes	W4	Plaster	Tan	Cracking/Chipping	5	22.7	Positive	
2190	1	1	110A	Principal's Office Restroom	Yes	Ceiling	Plaster	Tan	Moisture Damage/Cracking	8	21.5	Positive	
2190	1	1	110B	Principals Office Closet	Yes	W1	Plaster	Tan	Cracking	1	22.1	Positive	
2190	1	1	110B	Principals Office Closet	Yes	W2	Plaster	Tan	Cracking	2	23.2	Positive	
2190	1	1	110B	Principals Office Closet	Yes	W3	Plaster	Tan	Cracking	2	24.5	Positive	

				Inspection Dates: 09/21/20-09/29/20									
				Name of Inspector: Michael Barth			Lead Safe Certification Assessment Report						
				Inspection Company: Criterion Labs			Fell Elementary School						
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)	
2190	1	1	110B	Principals Office Closet	Yes	W4	Plaster	Tan	Cracking	3	27.1	Positive	
2190	1	1	110B	Principals Office Closet	Yes	Ceiling	Plaster	Tan	Cracking	3	16.1	Positive	
2190	1	2	210A	Storage Room beside Classroom 200	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	2	213	Janitor's Closet beside Classroom 203	No	W1	Plaster	Tan	Cracking	5	22.5	Positive	
2190	1	2	213	Janitor's Closet beside Classroom 203	No	W2	Plaster	Tan	Chipping	2	26.4	Positive	
2190	1	2	213	Janitor's Closet beside Classroom 203	No	W3	Plaster	Tan	Chipping	3	24.5	Positive	
2190	1	2	213	Janitor's Closet beside Classroom 203	No	W4	Plaster	Tan	Cracking	1	26.4	Positive	
2190	1	2	213	Janitor's Closet beside Classroom 203	No	Ceiling	Plaster	Tan	Moisture Damage	5	21.2	Positive	
2190	1	2	213	Janitor's Closet beside Classroom 203	No	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	1	110B	Principals Office Closet	yes	W2	Metal	Tan	Cracking	2	6.2	Positive	
2190	1	1	110B	Principals Office Closet	yes	W3	Metal	Tan	Cracking	2	5.4	Positive	
2190	1	2	215	Teacher's Lounge 215	Yes	W2	Wood	White	None	0	7.2	Positive	
2190	1	B	PTA1	PTA Lunchroom Storage Closet 1	Yes	W2	Plaster	Tan	Cracking	4	24.7	Positive	
2190	1	2	215	Teacher's Lounge 215	Yes	W2	Plaster	Blue	None	0	24.7	Positive	
2190	1	B	PTA1	PTA Lunchroom Storage Closet 1	Yes	W3	Plaster	Tan	Cracking	2	21.2	Positive	
2190	1	B	PTA1	PTA Lunchroom Storage Closet 1	Yes	W4	Plaster	Tan	Cracking	4	23.4	Positive	
2190	1	B	PTA1	PTA Lunchroom Storage Closet 1	Yes	W3	Metal	Tan	Chipping	1	2.8	Positive	
2190	1	2	215	Teacher's Lounge 215	Yes	W3	Plaster	Blue	None	0	N/A	N/A	
2190	1	B	PTA1	PTA Lunchroom Storage Closet 1	Yes	Ceiling	Metal	Tan	Chipping	1	20.9	Positive	
2190	1	B	PTA2	PTA Lunchroom Storage Closet 2	Yes	W1	Plaster	Tan	Chipping	2	23.2	Positive	
2190	1	B	PTA2	PTA Lunchroom Storage Closet 2	Yes	W2	Plaster	Tan	Cracking	2	22.7	Positive	
2190	1	2	215	Teacher's Lounge 215	Yes	W4	Plaster	Blue	None	0	21.4	Positive	
2190	1	2	215A	Teacher's Lounge 215 Storage Closet	Yes	W2	Wood	White	None	0	5.9	Positive	
2190	1	2	203	Classroom 203	Yes	W3	Metal	White	Chipping	1	0.2	Negative	
2190	1	2	207	Classroom 207	Yes	W3	Metal	White	Chipping	1	0.11	Negative	
2190	1	2	207	Classroom 207	Yes	W3	Metal	White	Chipping	1	0.2	Negative	
2190	1	2	215	Teacher's Lounge 215	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	2	215	Teacher's Lounge 215	Yes	Floor	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	B	PTA2	PTA Lunchroom Storage Closet 2	Yes	W3	Plaster	Tan	Cracking	1	21.8	Positive	
2190	1	2	209	Classroom 209	Yes	W2	Metal	White	Chipping	1	0.21	Negative	
2190	1	2	209	Classroom 209	Yes	W3	Metal	White	Chipping	1	0.1	Negative	
2190	1	2	215A	Teacher's Lounge 215 Storage Closet	Yes	W3	Metal	White	None	0	0.21	Negative	
2190	1	2	216A	Teacher's Lounge 216 Staff Restroom	Yes	W2	Metal	White	None	0	0.21	Negative	
2190	1	2	215A	Teacher's Lounge 215 Storage Closet	Yes	W2	Plaster	White	None	0	20.4	Positive	
2190	1	2	216A	Teacher's Lounge 216 Staff Restroom	Yes	W3	Metal	White	Chipping	1	0.22	Negative	
2190	1	2	211	Janitor's Closet beside IMC (206)	No	W3	Metal	White	Chipping	8	0.2	Negative	
2190	1	B	PTA2	PTA Lunchroom Storage Closet 2	Yes	W4	Plaster	Tan	Cracking	1	26.3	Positive	
2190	1	2	207A	Classroom 207 Coat Closet	Yes	W2	Metal	White	None	0	0.21	Negative	
2190	1	2	215A	Teacher's Lounge 215 Storage Closet	Yes	W4	Plaster	White	None	0	24.5	Positive	
2190	1	2	207A	Classroom 207 Coat Closet	Yes	W2	Metal	White	Chipping	1	0.3	Negative	
2190	1	B	PTA2	PTA Lunchroom Storage Closet 2	Yes	Ceiling	Plaster	Tan	Moisture Damage	1	18.9	Positive	

				Inspection Dates: 09/21/20-09/29/20			Lead Safe Certification Assessment Report						
				Name of Inspector: Michael Barth			Fell Elementary School						
				Inspection Company: Criterion Labs									
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)	
2190	1	3	300	Classroom 300	Yes	W1	Wood	Brown	Chipping	1	0.01	Negative	
2190	1	B	PTA3	PTA Lunchroom Storage Closet 3	Yes	W1	Plaster	Green	Cracking	1	21.4	Positive	
2190	1	3	300	Classroom 300	Yes	W2	Wood	Brown	Chipping	1	0.03	Negative	
2190	1	3	300	Classroom 300	Yes	W3	Wood	Brown	Chipping	1	0.01	Negative	
2190	1	3	300	Classroom 300	Yes	W4	Wood	Brown	Chipping	1	0.1	Negative	
2190	1	3	310	Classroom 310	Yes	Floor	Wood	Brown	Friction	3	0.21	Negative	
2190	1	B	PTA3	PTA Lunchroom Storage Closet 3	Yes	W3	Plaster	Green	Cracking	2	23.7	Positive	
2190	1	3	304	Classroom 304	Yes	Floor	Wood	Brown	Friction	5	0.11	Negative	
2190	1	3	303	Classroom 303	Yes	Floor	Wood	Brown	Friction	5	0.21	Negative	
2190	1	3	H310	Hallway outside Classrooms 307 - 309	Yes	W1	Metal	Green	Friction	2	0.2	Negative	
2190	1	B	PTA3	PTA Lunchroom Storage Closet 3	Yes	W4	Plaster	Green	Cracking	2	21.8	Positive	
2190	1	3	H312	Hallway outside Classrooms 300 - 302	Yes	W1	Metal	Green	Friction	2	0.1	Negative	
2190	1	B	PTA3	PTA Lunchroom Storage Closet 3	Yes	Ceiling	Plaster	Tan	Moisture Damage	1	14.9	Positive	
2190	1	B	PTA4	PTA Lunchroom Storage Closet 4	Yes	W1	Plaster	Green	Cracking	1	17.4	Positive	
2190	1	2	216	Teacher's Lounge 216	Yes	W4	Plaster	Blue	None	0	24.6	Positive	
2190	1	2	216	Teacher's Lounge 216	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	B	PTA4	PTA Lunchroom Storage Closet 4	Yes	W2	Plaster	Green	Cracking	1	21.9	Positive	
2190	1	2	216A	Teacher's Lounge 216 Staff Restroom	Yes	W1	Plaster	Green	None	0	19.8	Positive	
2190	1	2	216A	Teacher's Lounge 216 Staff Restroom	Yes	W1	Plaster	White	None	0	21.2	Positive	
2190	1	2	216A	Teacher's Lounge 216 Staff Restroom	Yes	W2	Plaster	Green	None	0	22.5	Positive	
2190	1	2	216A	Teacher's Lounge 216 Staff Restroom	Yes	W2	Plaster	White	None	0	24.3	Positive	
2190	1	3	301	Classroom 301	Yes	W3	Metal	Grey	Chipping	2	0.2	Negative	
2190	1	B	PTA4	PTA Lunchroom Storage Closet 4	Yes	W3	Plaster	Green	Cracking	1	22.1	Positive	
2190	1	2	216A	Teacher's Lounge 216 Staff Restroom	Yes	W2	Plastic	Green	None	0	0.01	Negative	
2190	1	2	216A	Teacher's Lounge 216 Staff Restroom	Yes	W2	Plastic	White	None	0	0.01	Negative	
2190	1	B	PTA4	PTA Lunchroom Storage Closet 4	Yes	Ceiling	Plaster	Green	Moisture Damage	1	23.2	Positive	
2190	1	2	216A	Teacher's Lounge 216 Staff Restroom	Yes	W3	Plaster	Green	None	0	24.2	Positive	
2190	1	B	1A	RM1 Storage Closet	Yes	W1	Plaster	Tan	Cracking	2	22.1	Positive	
2190	1	B	1A	RM1 Storage Closet	Yes	W2	Plaster	Tan	Cracking	3	21.7	Positive	
2190	1	3	315	Storage Closet across from 302	No	W4	Metal	Grey	Chipping	1	1.7	Positive	
2190	1	2	216A	Teacher's Lounge 216 Staff Restroom	Yes	W4	Plaster	Green	None	0	17.9	Positive	
2190	1	2	216A	Teacher's Lounge 216 Staff Restroom	Yes	W4	Plaster	White	None	0	22.4	Positive	
2190	1	B	1A	RM1 Storage Closet	Yes	W3	Plaster	Tan	Cracking	1	23.4	Positive	
2190	1	B	1A	RM1 Storage Closet	Yes	W4	Plaster	Tan	Cracking	1	20.9	Positive	
2190	1	2	211	Janitor's Closet beside IMC (206)	No	W1	Plaster	Tan	Cracking	2	24.7	Positive	
2190	1	2	211	Janitor's Closet beside IMC (206)	No	W2	Plaster	Tan	Chipping	2	21.1	Positive	
2190	1	2	211	Janitor's Closet beside IMC (206)	No	W3	Plaster	Tan	Cracking	10	22.3	Positive	
2190	1	3	310	Classroom 310	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A	
2190	1	2	211	Janitor's Closet beside IMC (206)	No	W4	Plaster	Tan	Chipping	15	21.4	Positive	
2190	1	2	211	Janitor's Closet beside IMC (206)	No	Ceiling	Plaster	Tan	Moisture Damage	8	22.7	Positive	

				Inspection Dates: 09/21/20-09/29/20									
				Name of Inspector: Michael Barth			Lead Safe Certification Assessment Report						
				Inspection Company: Criterion Labs			Fell Elementary School						
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)	
2190	1	2	211	Janitor's Closet beside IMC (206)	No	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	B	1A	RM1 Storage Closet	Yes	Ceiling	Metal	Tan	Chipping	10	12.7	Positive	
2190	1	2	H28	Center Hallway	Yes	W2	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	B	2B	RM2 Storage Closet B	Yes	W1	Plaster	Tan	Cracking	2	18.7	Positive	
2190	1	2	H28	Center Hallway	Yes	W4	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	2	H28	Center Hallway	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	2	H28	Center Hallway	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	B	2B	RM2 Storage Closet B	Yes	W2	Plaster	Tan	Cracking	2	22.3	Positive	
2190	1	3	304	Classroom 304	Yes	W2	Wood	N/A	N/A	N/A	N/A	N/A	
2190	1	B	2B	RM2 Storage Closet B	Yes	W3	Plaster	Tan	Cracking	2	21.7	Positive	
2190	1	B	2B	RM2 Storage Closet B	Yes	W4	Plaster	Tan	Cracking	2	26.5	Positive	
2190	1	B	2B	RM2 Storage Closet B	Yes	Ceiling	Plaster	Tan	Moisture Damage/Flaking	10	22.7	Positive	
2190	1	2	H29	Hallway outside of Classrooms 200 - 202	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	2	H29	Hallway outside of Classrooms 200 - 202	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	B	3A	RM3 Storage Closet A	Yes	W1	Plaster	Tan	Cracking	1	21	Positive	
2190	1	3	304	Classroom 304	Yes	W4	Wood	N/A	N/A	N/A	N/A	N/A	
2190	1	B	3A	RM3 Storage Closet A	Yes	W2	Plaster	Tan	Cracking	3	22.7	Positive	
2190	1	3	304	Classroom 304	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A	
2190	1	B	3A	RM3 Storage Closet A	Yes	W3	Plaster	Tan	Cracking	3	29.1	Positive	
2190	1	B	3A	RM3 Storage Closet A	Yes	W4	Plaster	Tan	Cracking	1	23.1	Positive	
2190	1	2	H27	Hallway outside of Classrooms 207-209	yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	2	H27	Hallway outside of Classrooms 207-209	yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	B	3A	RM3 Storage Closet A	Yes	Ceiling	Plaster	Tan	Chipping	2	17.2	Positive	
2190	1	2	S24	Fire Tower Stairwell	Yes	W1	Brick	White	None	0	21.2	Positive	
2190	1	2	S24	Fire Tower Stairwell	Yes	W2	Brick	White	None	0	22.3	Positive	
2190	1	2	S24	Fire Tower Stairwell	Yes	W3	Brick	White	None	0	24.5	Positive	
2190	1	2	S24	Fire Tower Stairwell	Yes	W4	Brick	White	None	0	21	Positive	
2190	1	B	RM1	Speech	Yes	W1	Plaster	Tan	Chipping	3	21.3	Positive	
2190	1	2	S24	Fire Tower Stairwell	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	B	RM1	Speech	Yes	W2	Plaster	Tan	Cracking	4	22.7	Positive	
2190	1	B	RM1	Speech	Yes	W3	Plaster	Tan	Moisture Damage	10	24.1	Positive	
2190	1	3	305	Classroom 305	Yes	W2	Wood	N/A	N/A	N/A	N/A	N/A	
2190	1	B	RM1	Speech	Yes	W4	Plaster	Tan	Cracking	5	22.9	Positive	
2190	1	3	305	Classroom 305	Yes	W4	Wood	N/A	N/A	N/A	N/A	N/A	
2190	1	3	305	Classroom 305	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A	
2190	1	B	RM1	Speech	Yes	Ceiling	Plaster	Tan	Moisture Damage	10	28.2	Positive	
2190	1	2	200A	Classroom 200 Coat Closet	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	3	306	Classroom 306	Yes	W4	Wood	N/A	N/A	N/A	N/A	N/A	
2190	1	2	PC200A	Classroom 200 Coat Closet Pipe Chase	Yes	W1	Brick	N/A	N/A	N/A	N/A	N/A	

				Inspection Dates: 09/21/20-09/29/20									
				Name of Inspector: Michael Barth			Lead Safe Certification Assessment Report						
				Inspection Company: Criterion Labs			Fell Elementary School						
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)	
2190	1	2	PC200A	Classroom 200 Coat Closet Pipe Chase	Yes	W2	Brick	N/A	N/A	N/A	N/A	N/A	
2190	1	2	PC200A	Classroom 200 Coat Closet Pipe Chase	Yes	W3	Brick	N/A	N/A	N/A	N/A	N/A	
2190	1	2	PC200A	Classroom 200 Coat Closet Pipe Chase	Yes	W4	Brick	N/A	N/A	N/A	N/A	N/A	
2190	1	2	PC200A	Classroom 200 Coat Closet Pipe Chase	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	2	PC200A	Classroom 200 Coat Closet Pipe Chase	Yes	Floor	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	1	S12	Stairwell across from 109	Yes	Floor	Concrete	Grey	Friction	4	2.3	Positive	
2190	1	1	S12	Stairwell across from 109	Yes	W2	Plaster	White/Mural	Cracking	4	23.5	Positive	
2190	1	2	201A	Classroom 201 Coat Closet	Yes	W3	Plaster	Tan	Partially Inaccessible	0	22.4	Positive	
2190	1	1	S12	Stairwell across from 109	Yes	W3	Plaster	White/Mural	Chipping	1	24.3	Positive	
2190	1	2	201A	Classroom 201 Coat Closet	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	3	306	Classroom 306	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A	
2190	1	2	202A	Classroom 202 Coat Closet	Yes	W1	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	2	202A	Classroom 202 Coat Closet	Yes	W2	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	2	202A	Classroom 202 Coat Closet	Yes	W3	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	2	202A	Classroom 202 Coat Closet	Yes	W4	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	2	202A	Classroom 202 Coat Closet	Yes	Ceiling	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	2	202A	Classroom 202 Coat Closet	Yes	Floor	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	2	203A	Classroom 203 Coat Closet	Yes	W1	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	2	203A	Classroom 203 Coat Closet	Yes	W2	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	2	203A	Classroom 203 Coat Closet	Yes	W3	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	2	203A	Classroom 203 Coat Closet	Yes	W4	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	2	203A	Classroom 203 Coat Closet	Yes	Ceiling	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	2	203A	Classroom 203 Coat Closet	Yes	Floor	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	2	PC203A	Classroom 203 Coat Closet Pipe Chase	no	W1	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	2	PC203A	Classroom 203 Coat Closet Pipe Chase	no	W2	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	2	PC203A	Classroom 203 Coat Closet Pipe Chase	no	W3	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	2	PC203A	Classroom 203 Coat Closet Pipe Chase	no	W4	No Access	No Access	No Access	No Access	No Access	No Access	

				Inspection Dates: 09/21/20-09/29/20		Lead Safe Certification Assessment Report						
				Name of Inspector: Michael Barth		Fell Elementary School						
				Inspection Company: Criterion Labs								
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)
2190	1	2	PC203A	Classroom 203 Coat Closet Pipe Chase	no	Ceiling	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	2	PC203A	Classroom 203 Coat Closet Pipe Chase	no	Floor	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	2	204A	Classroom 204 Coat Closet	Yes	W1	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	2	204A	Classroom 204 Coat Closet	Yes	W2	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	2	204A	Classroom 204 Coat Closet	Yes	W3	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	2	204A	Classroom 204 Coat Closet	Yes	W4	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	2	204A	Classroom 204 Coat Closet	Yes	Ceiling	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	2	204A	Classroom 204 Coat Closet	Yes	Floor	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	2	206A	Classroom 206 Closet A	Yes	W1	Plaster	White	None	0	17.9	Positive
2190	1	2	206A	Classroom 206 Closet A	Yes	W2	Plaster	White	None	0	22.1	Positive
2190	1	2	206A	Classroom 206 Closet A	Yes	W3	Plaster	White	None	0	22.3	Positive
2190	1	2	206A	Classroom 206 Closet A	Yes	W4	Plaster	White	None	0	24.1	Positive
2190	1	2	206A	Classroom 206 Closet A	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	2	206A	Classroom 206 Closet A	Yes	Floor	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	2	206B	Classroom 206 Closet B	Yes	W1	Plaster	White	None	0	25.3	Positive
2190	1	2	206B	Classroom 206 Closet B	Yes	W2	Plaster	White	None	0	22.5	Positive
2190	1	2	206B	Classroom 206 Closet B	Yes	W3	Plaster	White	None	0	24.1	Positive
2190	1	1	S12	Stairwell across from 109	Yes	W4	Plaster	White/Mural	Chipping	4	21.2	Positive
2190	1	2	206B	Classroom 206 Closet B	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	3	307	Classroom 307	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A
2190	1	2	206B	Classroom 206 Closet B	Yes	Floor	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	B	S06	Stairwell and Entrance Vestibule beside Girl's Restroom	Yes	Ceiling	Plaster	White	Moisture Damage	3	22.5	Positive
2190	1	B	S06	Stairwell and Entrance Vestibule beside Girl's Restroom	Yes	W1	Brick	White	Cracking	1	22.3	Positive
2190	1	3	308	Classroom 308	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A
2190	1	3	309	Classroom 309	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A
2190	1	B	S06	Stairwell and Entrance Vestibule beside Girl's Restroom	Yes	W2	Brick	White	Cracking	1	25.6	Positive
2190	1	B	S06	Stairwell and Entrance Vestibule beside Girl's Restroom	Yes	W3	Brick	White	Cracking	1	28.9	Positive
2190	1	2	207A	Classroom 207 Coat Closet	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	3	303	Classroom 303	Yes	W2	Wood	N/A	N/A	N/A	N/A	N/A
2190	1	3	303	Classroom 303	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A
2190	1	B	S06	Stairwell and Entrance Vestibule beside Girl's Restroom	Yes	W4	Brick	White	Cracking	1	23.4	Positive

				Inspection Dates: 09/21/20-09/29/20								
				Name of Inspector: Michael Barth		Lead Safe Certification Assessment Report						
				Inspection Company: Criterion Labs		Fell Elementary School						
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)
2190	1	B	S02	Stairwell and Foyer beside Boy's Restroom	Yes	W2	Brick	White	Cracking	3	21.2	Positive
2190	1	B	S02	Stairwell and Foyer beside Boy's Restroom	Yes	W3	Brick	White	Cracking	1	25.4	Positive
2190	1	B	S02	Stairwell and Foyer beside Boy's Restroom	Yes	W4	Brick	White	Cracking	3	22	Positive
2190	1	2	208A	Classroom 208 Coat Closet	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	3	304A	Classroom 304 Coat Closet	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A
2190	1	2	209A	Classroom 209 Coat Closet	Yes	W1	Plaster	White	None	0	24.6	Positive
2190	1	2	209A	Classroom 209 Coat Closet	Yes	W2	Plaster	White	Partially Inaccessible	0	22.1	Positive
2190	1	B	S01	Stairwell beside Basement Facilities Storage Room	Yes	Floor	Concrete	Grey	Friction	1	2.4	Positive
2190	1	3	307	Classroom 307	Yes	W3	Metal	White	Chipping	5	0.2	Negative
2190	1	B	S01	Stairwell beside Basement Facilities Storage Room	Yes	W2	Plaster	White/Blue	Cracking	2	21.2	Positive
2190	1	2	209A	Classroom 209 Coat Closet	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	3	307	Classroom 307	Yes	W3	Wood	White	None	0	1.6	Positive
2190	1	2	PC209A	Classroom 209 Coat Closet Pipe Chase	Yes	W1	Brick	N/A	N/A	N/A	N/A	N/A
2190	1	2	PC209A	Classroom 209 Coat Closet Pipe Chase	Yes	W2	Brick	N/A	N/A	N/A	N/A	N/A
2190	1	2	PC209A	Classroom 209 Coat Closet Pipe Chase	Yes	W3	Brick	N/A	N/A	N/A	N/A	N/A
2190	1	2	PC209A	Classroom 209 Coat Closet Pipe Chase	Yes	W4	Brick	N/A	N/A	N/A	N/A	N/A
2190	1	2	PC209A	Classroom 209 Coat Closet Pipe Chase	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	2	PC209A	Classroom 209 Coat Closet Pipe Chase	Yes	Floor	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	B	S01	Stairwell beside Basement Facilities Storage Room	Yes	W3	Plaster	White/Blue	Chipping	3	23.4	Positive
2190	1	B	S01	Stairwell beside Basement Facilities Storage Room	Yes	W4	Plaster	White/Blue	Chipping	2	22.1	Positive
2190	1	B	S05	Stairwell beside Cafeteria B	Yes	Floor	Concrete	Grey	Friction	3	4.5	Positive
2190	1	B	S05	Stairwell beside Cafeteria B	Yes	W2	Plaster	Blue/White	Cracking	2	22.1	Positive
2190	1	B	S05	Stairwell beside Cafeteria B	Yes	W3	Plaster	Blue/White	Cracking	1	19.5	Positive
2190	1	B	S05	Stairwell beside Cafeteria B	Yes	W4	Plaster	Blue/White	Cracking	1	21.3	Positive
2190	1	3	316	Dean	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A
2190	1	1	S15	Stairwell beside Classroom 102	Yes	Floor	Concrete	Grey	Friction	2	2.6	Positive
2190	1	1	S15	Stairwell beside Classroom 102	Yes	W2	Plaster	White/Blue	Cracking	3	22.3	Positive
2190	1	1	S15	Stairwell beside Classroom 102	Yes	W3	Plaster	White/Blue	Cracking	3	23.4	Positive
2190	1	1	S15	Stairwell beside Classroom 102	Yes	W4	Plaster	White/Mural	Cracking	5	21.2	Positive
2190	1	1	S11	Stairwell beside Classroom 107	Yes	Floor	Concrete	Grey	Friction	2	2.1	Positive

				Inspection Dates: 09/21/20-09/29/20			Lead Safe Certification Assessment Report						
				Name of Inspector: Michael Barth			Fell Elementary School						
				Inspection Company: Criterion Labs									
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)	
2190	1	1	S11	Stairwell beside Classroom 107	Yes	W1	Plaster	Yellow/White	Cracking	2	22.3	Positive	
2190	1	1	S11	Stairwell beside Classroom 107	Yes	W2	Plaster	Yellow/White	Cracking	1	23.4	Positive	
2190	1	1	S11	Stairwell beside Classroom 107	Yes	W4	Plaster	Yellow/White	Chipping	5	19.8	Positive	
2190	1	3	S35	Stairwell beside Classroom 302	Yes	Floor	Concrete	Grey	Friction	3	1.5	Positive	
2190	1	3	S35	Stairwell beside Classroom 302	Yes	W3	Metal	Green	Friction	1	2.4	Positive	
2190	1	3	300	Classroom 300	Yes	W3	Metal	White	Chipping	3	0.3	Negative	
2190	1	3	300	Classroom 300	Yes	W4	Metal	White	Chipping	1	0.1	Negative	
2190	1	3	302	Classroom 302	Yes	W2	Metal	White	None	0	0.2	Negative	
2190	1	3	300	Classroom 300	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	3	300	Classroom 300	Yes	Floor	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	3	S35	Stairwell beside Classroom 302	Yes	W1	Plaster	White	Cracking	3	21.2	Positive	
2190	1	3	S35	Stairwell beside Classroom 302	Yes	W4	Plaster	White	Cracking	2	22.1	Positive	
2190	1	3	S35	Stairwell beside Classroom 302	Yes	Ceiling	Plaster	White	Cracking	2	23.4	Positive	
2190	1	3	302	Classroom 302	Yes	W3	Metal	White	Chipping	2	0.3	Negative	
2190	1	3	301	Classroom 301	Yes	W4	Plaster	White	None	0	25.1	Positive	
2190	1	3	301	Classroom 301	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	3	301	Classroom 301	Yes	Floor	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	3	S31	Stairwell beside Classroom 307	Yes	Floor	Concrete	Grey	Friction	2	2.1	Positive	
2190	1	3	S31	Stairwell beside Classroom 307	Yes	W3	Metal	Green	Friction	1	24.1	Positive	
2190	1	3	309	Classroom 309	Yes	W2	Metal	White	None	0	0.1	Negative	
2190	1	3	309	Classroom 309	Yes	W3	Metal	White	None	0	0.2	Negative	
2190	1	3	S31	Stairwell beside Classroom 307	Yes	W1	Plaster	White	Cracking	2	21.2	Positive	
2190	1	3	315	Storage Closet across from 302	No	W3	Metal	White	Chipping	3	0.21	Negative	
2190	1	B	S05A	Visitors Entrance Foyer to Northeast Stairwell beside Cafeteria B	Yes	W3	Metal	Blue	Friction	2	0.1	Negative	
2190	1	3	S31	Stairwell beside Classroom 307	Yes	W2	Plaster	White	Chipping	2	23.1	Positive	
2190	1	3	302	Classroom 302	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	3	302	Classroom 302	Yes	Floor	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	3	PC302	Classroom 302 Pipe Chase	no	W1	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	PC302	Classroom 302 Pipe Chase	no	W2	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	PC302	Classroom 302 Pipe Chase	no	W3	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	PC302	Classroom 302 Pipe Chase	no	W4	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	PC302	Classroom 302 Pipe Chase	no	Ceiling	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	PC302	Classroom 302 Pipe Chase	no	Floor	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	310	Classroom 310	Yes	W1	Plaster	White	None	0	21.2	Positive	
2190	1	3	310	Classroom 310	Yes	W2	Plaster	White	None	0	22.3	Positive	

				Inspection Dates: 09/21/20-09/29/20								
				Name of Inspector: Michael Barth		Lead Safe Certification Assessment Report						
				Inspection Company: Criterion Labs		Fell Elementary School						
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)
2190	1	3	S31	Stairwell beside Classroom 307	Yes	W4	Plaster	White	Cracking	3	25.2	Positive
2190	1	1	S10	Stairwell outside of Main Office	Yes	Floor	Concrete	Grey	Friction	2	2.7	Positive
2190	1	3	310	Classroom 310	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	B	S01A	Northwest Stairwell Entrance Vestibule beside Room 3	Yes	W3	Metal	Blue	Friction	1	0.21	Negative
2190	1	B	H03A	East Hallway; South End	Yes	W3	Metal	Brown	Friction	1	0.01	Negative
2190	1	1	S10	Stairwell outside of Main Office	Yes	W2	Brick	White	Cracking	2	21.2	Positive
2190	1	B	S05	Stairwell beside Cafeteria B	Yes	W1	Metal	Brown	Friction	1	0.21	Negative
2190	1	1	S10	Stairwell outside of Main Office	Yes	W4	Brick	White	Cracking	2	22.7	Positive
2190	1	B	S05A	Visitors Entrance Foyer to Northeast Stairwell beside Cafeteria B	Yes	W1	Metal	Brown	Friction	2	0.21	Negative
2190	1	B	S02	Stairwell and Foyer beside Boy's Restroom	Yes	W3	Metal	Brown	Friction	1	0.21	Negative
2190	1	3	304	Classroom 304	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	B	S01	Stairwell beside Basement Facilities Storage Room	Yes	W1	Metal	Brown	Friction	1	0.11	Negative
2190	1	B	S01A	Northwest Stairwell Entrance Vestibule beside Room 3	Yes	W1	Metal	Brown	Friction	1	0.11	Negative
2190	1	3	PC304	Classroom 304 Pipe Chase	Yes	W1	Brick	N/A	N/A	N/A	N/A	N/A
2190	1	3	PC304	Classroom 304 Pipe Chase	Yes	W2	Brick	N/A	N/A	N/A	N/A	N/A
2190	1	3	PC304	Classroom 304 Pipe Chase	Yes	W3	Brick	N/A	N/A	N/A	N/A	N/A
2190	1	3	PC304	Classroom 304 Pipe Chase	Yes	W4	Brick	N/A	N/A	N/A	N/A	N/A
2190	1	3	PC304	Classroom 304 Pipe Chase	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	3	PC304	Classroom 304 Pipe Chase	Yes	Floor	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	B	23	Storage Closet beside Southeast Stairwell	Yes	Ceiling	Plaster	White	Moisture Damage	5	22.3	Positive
2190	1	B	PTA4	PTA Lunchroom Storage Closet 4	Yes	W3	Wood	Green	None	0	N/A	N/A
2190	1	B	23	Storage Closet beside Southeast Stairwell	Yes	Ceiling	Metal	Tan	Chipping	2	17.9	Positive
2190	1	B	PTA4	PTA Lunchroom Storage Closet 4	Yes	W4	Wood	Green	None	0	N/A	N/A
2190	1	3	305	Classroom 305	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	B	PTA	Lunch Room	Yes	W1	Wood	Green	None	0	0.1	Negative
2190	1	3	PC305	Classroom 305 Pipe Chase	no	W1	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	PC305	Classroom 305 Pipe Chase	no	W2	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	PC305	Classroom 305 Pipe Chase	no	W3	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	PC305	Classroom 305 Pipe Chase	no	W4	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	PC305	Classroom 305 Pipe Chase	no	Ceiling	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	PC305	Classroom 305 Pipe Chase	no	Floor	No Access	No Access	No Access	No Access	No Access	No Access

				Inspection Dates: 09/21/20-09/29/20								
				Name of Inspector: Michael Barth		Lead Safe Certification Assessment Report						
				Inspection Company: Criterion Labs		Fell Elementary School						
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)
2190	1	3	311	Storage Room across from Classroom 307	Yes	W1	Plaster	Tan	Cracking	2	23.6	Positive
2190	1	3	311	Storage Room across from Classroom 307	Yes	W2	Plaster	Tan	Moisture Damage	10	25.8	Positive
2190	1	3	311	Storage Room across from Classroom 307	Yes	Ceiling	Plaster	Tan	Chipping	2	29.1	Positive
2190	1	B	PTA	Lunch Room	Yes	W2	Wood	Green	None	0	0.3	Negative
2190	1	3	306	Classroom 306	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	B	PTA	Lunch Room	Yes	W3	Wood	Green	None	0	0.2	Negative
2190	1	3	PC306	Classroom 306 Pipe Chase	Yes	W1	Terracotta	N/A	N/A	N/A	N/A	N/A
2190	1	3	PC306	Classroom 306 Pipe Chase	Yes	W2	Terracotta	N/A	N/A	N/A	N/A	N/A
2190	1	3	PC306	Classroom 306 Pipe Chase	Yes	W3	Terracotta	N/A	N/A	N/A	N/A	N/A
2190	1	3	PC306	Classroom 306 Pipe Chase	Yes	W4	Terracotta	N/A	N/A	N/A	N/A	N/A
2190	1	3	PC306	Classroom 306 Pipe Chase	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	3	PC306	Classroom 306 Pipe Chase	Yes	Floor	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	2	210A	Storage Room beside Classroom 200	Yes	W1	Plaster	Tan	Cracking	2	21	Positive
2190	1	2	210A	Storage Room beside Classroom 200	Yes	W2	Plaster	Tan	Chipping	1	22.4	Positive
2190	1	2	210A	Storage Room beside Classroom 200	Yes	W3	Plaster	Tan	Chipping	3	23.4	Positive
2190	1	B	PTA	Lunch Room	Yes	W4	Wood	Green	None	0	0.21	Negative
2190	1	2	210A	Storage Room beside Classroom 200	Yes	W4	Plaster	Tan	Cracking	1	21.5	Positive
2190	1	2	210A	Storage Room beside Classroom 200	Yes	Ceiling	Plaster	Tan	Moisture Damage	2	26.7	Positive
2190	1	2	215	Teacher's Lounge 215	Yes	W3	Metal	Grey	Chipping	1	1.5	Positive
2190	1	3	307	Classroom 307	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	2	215	Teacher's Lounge 215	Yes	W1	Wood	White	Friction	2	8.9	Positive
2190	1	3	308	Classroom 308	Yes	W1	Plaster	Tan	None	0	26.1	Positive
2190	1	2	215	Teacher's Lounge 215	Yes	W1	Wood	White	Chipping	1	10.1	Positive
2190	1	2	215	Teacher's Lounge 215	Yes	W2	Wood	White	Friction	1	7.2	Positive
2190	1	B	2A	RM2 Storage Closet A	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A
2190	1	3	308	Classroom 308	Yes	W4	Plaster	Tan	None	0	19.1	Positive
2190	1	3	308	Classroom 308	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	B	2B	RM2 Storage Closet B	Yes	Floor	Wood	N/A	N/A	N/A	N/A	N/A
2190	1	2	215	Teacher's Lounge 215	Yes	W2	Wood	White	Friction	1	6.4	Positive
2190	1	2	215	Teacher's Lounge 215	Yes	W1	Plaster	Blue	Chipping	1	22.4	Positive
2190	1	B	B3	Kitchen Storage Room 3	Yes	W3	Wood	Tan	Chipping	1	0.2	Negative
2190	1	B	B3	Kitchen Storage Room 3	Yes	W4	Wood	Tan	Chipping	1	0.21	Negative
2190	1	2	215	Teacher's Lounge 215	Yes	W1	Plaster	Tan	Chipping	1	21.7	Positive
2190	1	B	RM2	Music Room	Yes	W2	Wood	Tan	None	0	0.1	Negative
2190	1	B	B1	Kitchen Storage Room 1	No	Ceiling	Metal	Tan	Flaking	5	12.2	Positive
2190	1	2	215	Teacher's Lounge 215	Yes	W3	Wood	White	Cracking	3	4.5	Positive
2190	1	3	309	Classroom 309	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A

				Inspection Dates: 09/21/20-09/29/20			Lead Safe Certification Assessment Report						
				Name of Inspector: Michael Barth			Fell Elementary School						
				Inspection Company: Criterion Labs									
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)	
2190	1	2	215	Teacher's Lounge 215	Yes	W3	Wood	White	Cracking	3	5.2	Positive	
2190	1	3	PC309	Classroom 309 Pipe Chase	no	W1	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	PC309	Classroom 309 Pipe Chase	no	W2	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	PC309	Classroom 309 Pipe Chase	no	W3	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	PC309	Classroom 309 Pipe Chase	no	W4	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	PC309	Classroom 309 Pipe Chase	no	Ceiling	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	PC309	Classroom 309 Pipe Chase	no	Floor	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	2	215	Teacher's Lounge 215	Yes	W4	Wood	White	Chipping	1	6.8	Positive	
2190	1	2	215	Teacher's Lounge 215	Yes	W4	Wood	White	Friction	3	8.6	Positive	
2190	1	2	215	Teacher's Lounge 215	Yes	W4	Wood	White	Friction	1	7.3	Positive	
2190	1	2	215	Teacher's Lounge 215	Yes	W4	Wood	White	Flaking	1	6.4	Positive	
2190	1	3	303	Classroom 303	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	2	215A	Teacher's Lounge 215 Storage Closet	Yes	W1	Wood	Tan	Chipping	1	5.8	Positive	
2190	1	2	215A	Teacher's Lounge 215 Storage Closet	Yes	W1	Wood	Tan	Chipping	1	20.6	Positive	
2190	1	2	215A	Teacher's Lounge 215 Storage Closet	Yes	W4	Wood	Tan	Cracking	8	4.8	Positive	
2190	1	3	311	Storage Room across from Classroom 307	Yes	W1	Concrete	Grey	None	0	4.3	Positive	
2190	1	2	215A	Teacher's Lounge 215 Storage Closet	Yes	W1	Wood	Tan	Chipping	1	21.4	Positive	
2190	1	3	311	Storage Room across from Classroom 307	Yes	W2	Concrete	Grey	None	0	2.5	Positive	
2190	1	3	311	Storage Room across from Classroom 307	Yes	W3	Plaster	Tan	Partially Inaccessible	0	21.2	Positive	
2190	1	3	311	Storage Room across from Classroom 307	Yes	W3	Concrete	Grey	None	0	4.6	Positive	
2190	1	3	311	Storage Room across from Classroom 307	Yes	W4	Plaster	Tan	Partially Inaccessible	0	23.4	Positive	
2190	1	3	311	Storage Room across from Classroom 307	Yes	W4	Concrete	Grey	None	0	3.7	Positive	
2190	1	2	215A	Teacher's Lounge 215 Storage Closet	Yes	W1	Plaster	White	Chipping	8	27.1	Positive	
2190	1	3	311	Storage Room across from Classroom 307	Yes	Floor	Concrete	N/A	None	0	N/A	N/A	
2190	1	3	312	Janitors Closet beside Classroom 306	No	W1	Plaster	Tan	Cracking	2	21.2	Positive	
2190	1	3	312	Janitors Closet beside Classroom 306	No	W2	Plaster	Tan	Cracking	1	22.3	Positive	
2190	1	3	312	Janitors Closet beside Classroom 306	No	W3	Plaster	Tan	Cracking	1	18.9	Positive	
2190	1	3	312	Janitors Closet beside Classroom 306	No	W4	Plaster	Tan	Chipping	1	17.4	Positive	
2190	1	3	312	Janitors Closet beside Classroom 306	No	Ceiling	Plaster	Tan	Moisture Damage	4	21.4	Positive	
2190	1	3	312	Janitors Closet beside Classroom 306	No	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	2	215A	Teacher's Lounge 215 Storage Closet	Yes	W3	Plaster	White	Alligatoring	5	25.7	Positive	

				Inspection Dates: 09/21/20-09/29/20		Lead Safe Certification Assessment Report						
				Name of Inspector: Michael Barth		Fell Elementary School						
				Inspection Company: Criterion Labs								
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)
2190	1	3	313	Large Storage Closet outside of Classroom 309	Yes	W1	Concrete	Grey	None	0	1.5	Positive
2190	1	2	215A	Teacher's Lounge 215 Storage Closet	Yes	Ceiling	Plaster	White	Cracking	1	18.9	Positive
2190	1	3	313	Large Storage Closet outside of Classroom 309	Yes	W2	Concrete	Grey	None	0	3.2	Positive
2190	1	2	216	Teacher's Lounge 216	Yes	W2	Wood	Tan	Chipping	1	6.7	Positive
2190	1	3	313	Large Storage Closet outside of Classroom 309	Yes	W3	Concrete	Grey	None	0	2.2	Positive
2190	1	2	216	Teacher's Lounge 216	Yes	W3	Metal	Grey	Chipping	1	1.6	Positive
2190	1	2	216	Teacher's Lounge 216	Yes	W1	Wood	Tan	Chipping	1	8.8	Positive
2190	1	3	313	Large Storage Closet outside of Classroom 309	Yes	W4	Concrete	Grey	None	0	1.4	Positive
2190	1	2	216	Teacher's Lounge 216	Yes	W1	Wood	Tan	Friction	2	9.6	Positive
2190	1	3	313	Large Storage Closet outside of Classroom 309	Yes	Floor	Concrete	Brown	None	0	1.5	Positive
2190	1	3	314	Janitors Closet beside Classroom 303	No	W1	Plaster	Tan	Cracking	2	21.2	Positive
2190	1	3	314	Janitors Closet beside Classroom 303	No	W2	Plaster	Tan	Chipping	3	23.2	Positive
2190	1	3	314	Janitors Closet beside Classroom 303	No	W3	Plaster	Tan	Chipping	3	22.7	Positive
2190	1	3	314	Janitors Closet beside Classroom 303	No	W4	Plaster	Tan	Cracking	5	24.1	Positive
2190	1	3	314	Janitors Closet beside Classroom 303	No	Ceiling	Plaster	Tan	Moisture Damage	3	19.2	Positive
2190	1	3	314	Janitors Closet beside Classroom 303	No	Floor	Concrete	N/A	N/A	N/A	N/A	N/A
2190	1	3	315	Storage Closet across from 302	No	W1	Plaster	Tan	Cracking/Partially Inaccessible	2	22.3	Positive
2190	1	3	315	Storage Closet across from 302	No	W2	Plaster	Tan	Cracking	1	22.1	Positive
2190	1	3	315	Storage Closet across from 302	No	W3	Plaster	Tan	Cracking/Partially Inaccessible	2	24.1	Positive
2190	1	2	216	Teacher's Lounge 216	Yes	W1	Wood	Tan	Friction	1	7.4	Positive
2190	1	3	315	Storage Closet across from 302	No	W4	Plaster	Tan	Cracking/Moisture Damage	8	23.4	Positive
2190	1	2	216	Teacher's Lounge 216	Yes	W1	Wood	Tan	Cracking	1	6.7	Positive
2190	1	3	315	Storage Closet across from 302	No	Ceiling	Plaster	Tan	Moisture Damage	6	21.2	Positive
2190	1	3	315	Storage Closet across from 302	No	Floor	Concrete	N/A	N/A	N/A	N/A	N/A
2190	1	2	216	Teacher's Lounge 216	Yes	W2	Wood	Tan	Cracking	2	5.4	Positive
2190	1	2	216	Teacher's Lounge 216	Yes	W2	Wood	Tan	Flaking	5	11.6	Positive
2190	1	2	216	Teacher's Lounge 216	Yes	W3	Wood	Tan	Cracking	5	14.6	Positive
2190	1	3	H310	Hallway outside Classrooms 307 - 309	Yes	W3	Plaster	Yellow/Green	None	0	21.4	Positive
2190	1	2	216	Teacher's Lounge 216	Yes	W1	Plaster	Blue	Cracking	5	21.4	Positive
2190	1	3	H310	Hallway outside Classrooms 307 - 309	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	3	H310	Hallway outside Classrooms 307 - 309	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A
2190	1	2	216	Teacher's Lounge 216	Yes	W2	Plaster	Blue	Chipping	10	25.6	Positive
2190	1	2	216	Teacher's Lounge 216	Yes	W3	Plaster	Tan	Chipping	10	24.9	Positive
2190	1	2	216A	Teacher's Lounge 216 Staff Restroom	Yes	W3	Metal	Grey	Chipping	2	1.7	Positive

				Inspection Dates: 09/21/20-09/29/20			Lead Safe Certification Assessment Report						
				Name of Inspector: Michael Barth			Fell Elementary School						
				Inspection Company: Criterion Labs									
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)	
2190	1	2	216A	Teacher's Lounge 216 Staff Restroom	Yes	W3	Plaster	White	Cracking	2	21.3	Positive	
2190	1	2	216A	Teacher's Lounge 216 Staff Restroom	Yes	Ceiling	Plaster	White	Cracking	1	25.1	Positive	
2190	1	3	H312	Hallway outside Classrooms 300 - 302	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	3	H312	Hallway outside Classrooms 300 - 302	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	B	S05A	Visitors Entrance Foyer to Northeast Stairwell beside Cafeteria B	Yes	W1	Plaster	Blue	Cracking	5	15.7	Positive	
2190	1	B	S05A	Visitors Entrance Foyer to Northeast Stairwell beside Cafeteria B	Yes	W2	Plaster	Blue	Chipping	10	18.9	Positive	
2190	1	B	S05A	Visitors Entrance Foyer to Northeast Stairwell beside Cafeteria B	Yes	W3	Plaster	Blue	Cracking	3	21.3	Positive	
2190	1	B	S05A	Visitors Entrance Foyer to Northeast Stairwell beside Cafeteria B	Yes	W4	Plaster	Blue	Moisture Damage	1	18.9	Positive	
2190	1	B	S05A	Visitors Entrance Foyer to Northeast Stairwell beside Cafeteria B	Yes	W2	Metal	Grey	Chipping	1	1.8	Positive	
2190	1	3	S31	Stairwell beside Classroom 307	Yes	Ceiling	Plaster	White	None	0	N/A	N/A	
2190	1	3	S31	Stairwell beside Classroom 307	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	3	S31	Stairwell beside Classroom 307	Yes	Floor	Concrete	Grey	None	0	0.2	Negative	
2190	1	1	H14	West Hallway	Yes	Floor	Concrete	Grey	Friction	5	4.3	Positive	
2190	1	3	S34	Fire Tower Stairwell	Yes	W1	Brick	White	None	0	18.6	Positive	
2190	1	3	S34	Fire Tower Stairwell	Yes	W2	Brick	White	None	0	16.7	Positive	
2190	1	3	S34	Fire Tower Stairwell	Yes	W3	Brick	White	None	0	20.1	Positive	
2190	1	3	S34	Fire Tower Stairwell	Yes	W4	Brick	White	None	0	19.3	Positive	
2190	1	3	S34	Fire Tower Stairwell	Yes	Ceiling	Plaster	White	None	0	21.2	Positive	
2190	1	3	S34	Fire Tower Stairwell	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	1	H14	West Hallway	Yes	W2	Metal	Grey	Chipping	2	1.5	Positive	
2190	1	3	S35	Stairwell beside Classroom 302	Yes	W2	Plaster	White	None	0	N/A	N/A	
2190	1	1	H14	West Hallway	Yes	W2	Plaster	Red	Chipping	5	21.3	Positive	
2190	1	1	H14	West Hallway	Yes	W2	Plaster	Yellow	Chipping	15	22.7	Positive	
2190	1	1	H14	West Hallway	Yes	W3	Plaster	Red	Cracking	1	23.4	Positive	
2190	1	3	S35	Stairwell beside Classroom 302	Yes	Floor	Concrete	N/A	N/A	N/A	N/A	N/A	
2190	1	3	S35	Stairwell beside Classroom 302	Yes	Floor	Concrete	Grey	None	0	0.2	Negative	
2190	1	1	H14	West Hallway	Yes	W4	Plaster	Red	Chipping/Cracking	3	18.9	Positive	
2190	1	3	300A	Classroom 300 Coat Closet	Yes	W1	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	300A	Classroom 300 Coat Closet	Yes	W2	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	300A	Classroom 300 Coat Closet	Yes	W3	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	300A	Classroom 300 Coat Closet	Yes	W4	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	300A	Classroom 300 Coat Closet	Yes	Ceiling	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	300A	Classroom 300 Coat Closet	Yes	Floor	No Access	No Access	No Access	No Access	No Access	No Access	

				Inspection Dates: 09/21/20-09/29/20								
				Name of Inspector: Michael Barth		Lead Safe Certification Assessment Report						
				Inspection Company: Criterion Labs		Fell Elementary School						
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)
2190	1	3	301A	Classroom 301 Coat Closet	Yes	W1	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	301A	Classroom 301 Coat Closet	Yes	W2	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	301A	Classroom 301 Coat Closet	Yes	W3	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	301A	Classroom 301 Coat Closet	Yes	W4	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	301A	Classroom 301 Coat Closet	Yes	Ceiling	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	301A	Classroom 301 Coat Closet	Yes	Floor	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	302A	Classroom 302 Coat Closet	Yes	W1	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	302A	Classroom 302 Coat Closet	Yes	W2	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	302A	Classroom 302 Coat Closet	Yes	W3	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	302A	Classroom 302 Coat Closet	Yes	W4	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	302A	Classroom 302 Coat Closet	Yes	Ceiling	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	302A	Classroom 302 Coat Closet	Yes	Floor	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	303A	Classroom 303 Coat Closet	Yes	W1	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	303A	Classroom 303 Coat Closet	Yes	W2	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	303A	Classroom 303 Coat Closet	Yes	W3	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	303A	Classroom 303 Coat Closet	Yes	W4	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	303A	Classroom 303 Coat Closet	Yes	Ceiling	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	303A	Classroom 303 Coat Closet	Yes	Floor	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	1	H14	West Hallway	Yes	W4	Plaster	Yellow	Chipping/Cracking	5	21.4	Positive
2190	1	1	100C	Women's Restroom	Yes	W1	Plaster	Tan	Cracking	2	21.2	Positive
2190	1	1	100C	Women's Restroom	Yes	W3	Plaster	Tan	Cracking	1	23.1	Positive
2190	1	1	100C	Women's Restroom	Yes	W4	Plaster	Tan	Cracking	1	22.3	Positive
2190	1	3	304A	Classroom 304 Coat Closet	Yes	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	B	2A	RM2 Storage Closet A	Yes	Ceiling	Metal	White	None	0	12.2	Positive
2190	1	3	305A	Classroom 305 Coat Closet	Yes	W1	No Access	No Access	No Access	No Access	No Access	No Access

				Inspection Dates: 09/21/20-09/29/20									
				Name of Inspector: Michael Barth			Lead Safe Certification Assessment Report						
				Inspection Company: Criterion Labs			Fell Elementary School						
ULCS#	E l e m e n t	F l o o r	Space #	On-Site Room Name	Student/ Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/ negative)	
2190	1	3	305A	Classroom 305 Coat Closet	Yes	W2	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	305A	Classroom 305 Coat Closet	Yes	W3	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	305A	Classroom 305 Coat Closet	Yes	W4	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	305A	Classroom 305 Coat Closet	Yes	Ceiling	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	305A	Classroom 305 Coat Closet	Yes	Floor	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	305B	Classroom 305 Rear Storage Closet	Yes	W1	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	305B	Classroom 305 Rear Storage Closet	Yes	W2	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	305B	Classroom 305 Rear Storage Closet	Yes	W3	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	305B	Classroom 305 Rear Storage Closet	Yes	W4	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	305B	Classroom 305 Rear Storage Closet	Yes	Ceiling	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	305B	Classroom 305 Rear Storage Closet	Yes	Floor	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	306A	Classroom 306 Coat Closet	Yes	W1	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	306A	Classroom 306 Coat Closet	Yes	W2	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	306A	Classroom 306 Coat Closet	Yes	W3	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	306A	Classroom 306 Coat Closet	Yes	W4	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	306A	Classroom 306 Coat Closet	Yes	Ceiling	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	306A	Classroom 306 Coat Closet	Yes	Floor	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	307A	Classroom 307 Coat Closet	Yes	W1	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	307A	Classroom 307 Coat Closet	Yes	W2	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	307A	Classroom 307 Coat Closet	Yes	W3	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	307A	Classroom 307 Coat Closet	Yes	W4	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	307A	Classroom 307 Coat Closet	Yes	Ceiling	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	3	307A	Classroom 307 Coat Closet	Yes	Floor	No Access	No Access	No Access	No Access	No Access	No Access	

				Inspection Dates: 09/21/20-09/29/20								
				Name of Inspector: Michael Barth		Lead Safe Certification Assessment Report						
				Inspection Company: Criterion Labs		Fell Elementary School						
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)
2190	1	3	308A	Classroom 308 Coat Closet	Yes	W1	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	308A	Classroom 308 Coat Closet	Yes	W2	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	308A	Classroom 308 Coat Closet	Yes	W3	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	308A	Classroom 308 Coat Closet	Yes	W4	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	308A	Classroom 308 Coat Closet	Yes	Ceiling	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	308A	Classroom 308 Coat Closet	Yes	Floor	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	309A	Classroom 309 Coat Closet	Yes	W1	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	309A	Classroom 309 Coat Closet	Yes	W2	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	309A	Classroom 309 Coat Closet	Yes	W3	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	309A	Classroom 309 Coat Closet	Yes	W4	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	309A	Classroom 309 Coat Closet	Yes	Ceiling	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	309A	Classroom 309 Coat Closet	Yes	Floor	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	310A	Classroom 310 Coat Closet	Yes	W1	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	310A	Classroom 310 Coat Closet	Yes	W2	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	310A	Classroom 310 Coat Closet	Yes	W3	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	310A	Classroom 310 Coat Closet	Yes	W4	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	310A	Classroom 310 Coat Closet	Yes	Ceiling	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	310A	Classroom 310 Coat Closet	Yes	Floor	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	PC310A	Classroom 310 Coat Closet Pipe Chase	no	W1	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	PC310A	Classroom 310 Coat Closet Pipe Chase	no	W2	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	PC310A	Classroom 310 Coat Closet Pipe Chase	no	W3	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	PC310A	Classroom 310 Coat Closet Pipe Chase	no	W4	No Access	No Access	No Access	No Access	No Access	No Access
2190	1	3	PC310A	Classroom 310 Coat Closet Pipe Chase	no	Ceiling	No Access	No Access	No Access	No Access	No Access	No Access

				Inspection Dates: 09/21/20-09/29/20									
				Name of Inspector: Michael Barth			Lead Safe Certification Assessment Report						
				Inspection Company: Criterion Labs			Fell Elementary School						
ULCS#	Element	Floor	Space #	On-Site Room Name	Student/Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/negative)	
2190	1	3	PC310A	Classroom 310 Coat Closet Pipe Chase	no	Floor	No Access	No Access	No Access	No Access	No Access	No Access	
2190	1	A	R8	Tank Room - Accessed from Janitors Closet beside Northeast Stairwell (314)	No	W1	Brick	N/A	None	0	N/A	N/A	
2190	1	A	R8	Tank Room - Accessed from Janitors Closet beside Northeast Stairwell (314)	No	W2	Brick	N/A	None	0	N/A	N/A	
2190	1	A	R8	Tank Room - Accessed from Janitors Closet beside Northeast Stairwell (314)	No	W3	Brick	N/A	None	0	N/A	N/A	
2190	1	A	R8	Tank Room - Accessed from Janitors Closet beside Northeast Stairwell (314)	No	W4	Brick	N/A	None	0	N/A	N/A	
2190	1	A	R8	Tank Room - Accessed from Janitors Closet beside Northeast Stairwell (314)	No	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	A	R8	Tank Room - Accessed from Janitors Closet beside Northeast Stairwell (314)	No	Floor	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	A	AT	Attic accessible from 3rd Floor Janitor's Closet beside Northeast Stairwell	No	W1	Brick	N/A	None	0	N/A	N/A	
2190	1	A	AT	Attic accessible from 3rd Floor Janitor's Closet beside Northeast Stairwell	No	W2	Brick	N/A	None	0	N/A	N/A	
2190	1	A	AT	Attic accessible from 3rd Floor Janitor's Closet beside Northeast Stairwell	No	W3	Brick	N/A	None	0	N/A	N/A	
2190	1	A	AT	Attic accessible from 3rd Floor Janitor's Closet beside Northeast Stairwell	No	W4	Brick	N/A	None	0	N/A	N/A	
2190	1	A	AT	Attic accessible from 3rd Floor Janitor's Closet beside Northeast Stairwell	No	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	A	AT	Attic accessible from 3rd Floor Janitor's Closet beside Northeast Stairwell	No	Floor	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	A	AT	Attic above 3rd Floor - accessible by Tank Room	No	W1	Brick	N/A	None	0	N/A	N/A	
2190	1	A	AT	Attic above 3rd Floor - accessible by Tank Room	No	W2	Brick	N/A	None	0	N/A	N/A	
2190	1	A	AT	Attic above 3rd Floor - accessible by Tank Room	No	W3	Brick	N/A	None	0	N/A	N/A	
2190	1	A	AT	Attic above 3rd Floor - accessible by Tank Room	No	W4	Brick	N/A	None	0	N/A	N/A	
2190	1	A	AT	Attic above 3rd Floor - accessible by Tank Room	No	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	A	AT	Attic above 3rd Floor - accessible by Tank Room	No	Floor	N/A	N/A	N/A	N/A	N/A	N/A	
2190	1	A	AT	Attic above Auditorium - accessible by Room next to Stage	No	W1	Brick	N/A	None	0	N/A	N/A	
2190	1	A	AT	Attic above Auditorium - accessible by Room next to Stage	No	W2	Brick	N/A	None	0	N/A	N/A	
2190	1	A	AT	Attic above Auditorium - accessible by Room next to Stage	No	W3	Brick	N/A	None	0	N/A	N/A	
2190	1	A	AT	Attic above Auditorium - accessible by Room next to Stage	No	W4	Brick	N/A	None	0	N/A	N/A	

				Inspection Dates: 09/21/20-09/29/20								
				Name of Inspector: Michael Barth		Lead Safe Certification Assessment Report						
				Inspection Company: Criterion Labs		Fell Elementary School						
ULCS#	E l e m e n t	F l o o r	Space #	On-Site Room Name	Student/ Teacher Occupied (yes/no)	Component	Substrate Material	Color	Description of Damage	Damage Quantity (sf)	XRF Reading (mg/cm2)	XRF (positive/ negative)
2190	1	A	AT	Attic above Auditorium - accessible by Room next to Stage	No	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	A	AT	Attic above Auditorium - accessible by Room next to Stage	No	Floor	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	C	CS	Crawlspace accessible by back of Stage in Auditorium	No	W1	Brick	N/A	None	0	N/A	N/A
2190	1	C	CS	Crawlspace accessible by back of Stage in Auditorium	No	W2	Brick	N/A	None	0	N/A	N/A
2190	1	C	CS	Crawlspace accessible by back of Stage in Auditorium	No	W3	Brick	N/A	None	0	N/A	N/A
2190	1	C	CS	Crawlspace accessible by back of Stage in Auditorium	No	W4	Brick	N/A	None	0	N/A	N/A
2190	1	C	CS	Crawlspace accessible by back of Stage in Auditorium	No	Ceiling	N/A	N/A	N/A	N/A	N/A	N/A
2190	1	C	CS	Crawlspace accessible by back of Stage in Auditorium	No	Floor	N/A	N/A	N/A	N/A	N/A	N/A